

इंटरनेट

मानक

Disclosure to Promote the Right To Information

Whereas the Parliament of India has set out to provide a practical regime of right to information for citizens to secure access to information under the control of public authorities, in order to promote transparency and accountability in the working of every public authority, and whereas the attached publication of the Bureau of Indian Standards is of particular interest to the public, particularly disadvantaged communities and those engaged in the pursuit of education and knowledge, the attached public safety standard is made available to promote the timely dissemination of this information in an accurate manner to the public.

“जानने का अधिकार, जीने का अधिकार”

Mazdoor Kisan Shakti Sangathan

“The Right to Information, The Right to Live”

“पुराने को छोड़ नये के तरफ”

Jawaharlal Nehru

“Step Out From the Old to the New”

IS 10124-10 (2009): Fabricated PVC-U Fittings for Potable Water Supplies - Specification, Part 10: Specific Requirements for 45o Bends [CED 50: Plastic Piping System]



“ज्ञान से एक नये भारत का निर्माण”

Satyanarayan Gangaram Pitroda

“Invent a New India Using Knowledge”



“ज्ञान एक ऐसा खजाना है जो कभी चुराया नहीं जा सकता है”

Bhartrhari—Nitiśatakam

“Knowledge is such a treasure which cannot be stolen”

BLANK PAGE



भारतीय मानक
पेय जल आपूर्ति के लिए सविरंचित
पी वी सी-यू फिटिंगें — विशिष्ट
भाग 10 45° बेंडों की विशिष्ट अपेक्षाएँ
(दूसरा पुनरीक्षण)

Indian Standard
FABRICATED PVC-U FITTINGS FOR POTABLE WATER
SUPPLIES — SPECIFICATION
PART 10 SPECIFIC REQUIREMENTS FOR 45° BENDS
(*Second Revision*)

ICS 23.040.45; 91.140.60

© BIS 2009

BUREAU OF INDIAN STANDARDS
MANAK BHAVAN, 9 BAHADUR SHAH ZAFAR MARG
NEW DELHI 110002

FOREWORD

This Indian Standard (Part 10) (Second Revision) was adopted by the Bureau of Indian Standards, after the draft finalized by the Plastics Piping Systems Sectional Committee had been approved by the Civil Engineering Division Council.

This standard was first published in 1982 and revised in 1988. In this revision, following modifications have been made:

- a) Sizes and classes of fittings have been aligned with IS 4985 : 2000 'Unplasticized PVC pipes for potable water supplies — Specification'.
- b) Requirements for bends for elastomeric sealing ring joints have also been included.

The requirements of fabricated PVC-U fittings are covered in thirteen parts. The other parts in the series are:

- Part 1 General requirements
- Part 2 Specific requirements for sockets
- Part 3 Specific requirements for straight reducers
- Part 4 Specific requirements for caps
- Part 5 Specific requirements for equal tees
- Part 6 Specific requirements for flanged tail pieces with metallic flanges
- Part 7 Specific requirements for threaded adaptors
- Part 8 Specific requirements for 90° bends
- Part 9 Specific requirements for 60° bends
- Part 11 Specific requirements for 30° bends
- Part 12 Specific requirements for 22 ½° bends
- Part 13 Specific requirements for 11 ¼° bends

For the purpose of deciding whether a particular requirement of this standard is complied with, the final value, observed or calculated, expressing the results of a test or analysis, shall be rounded off in accordance with IS 2 : 1960 'Rules for rounding off numerical values (*revised*)'. The number of significant places retained in the rounded off value should be the same as that of the specified value in this standard.

*Indian Standard***FABRICATED PVC-U FITTINGS FOR POTABLE WATER
SUPPLIES — SPECIFICATION****PART 10 SPECIFIC REQUIREMENTS FOR 45° BENDS***(Second Revision)***1 SCOPE**

This standard (Part 10) lays down the requirements for manufacture, dimensions and marking for fabricated PVC-U 45° bends for potable water supplies.

2 REFERENCES

The standards listed below contain provisions, which through reference in this text, constitute provisions of this standard. At the time of publication, the editions indicated were valid. All standards are subject to revision and parties to agreement based on this standard are encouraged to investigate the possibility of applying the most recent editions of the standards indicated below:

<i>IS No.</i>	<i>Title</i>
4985 : 2000	Unplasticized PVC pipes for potable water supplies — Specification (<i>third revision</i>)
10124 (Part 1) : 2009	Specification for fabricated PVC-U fittings for potable water supplies — Specification: Part 1 General requirements

3 REQUIREMENTS**3.1 General**

The general requirements for material, sizes, tests, sampling and criteria for conformity shall conform to IS 10124 (Part 1).

3.2 Manufacture

3.2.1 Typical illustration of 45° bend is shown in Fig.1. Typical illustration of 45° bend for elastomeric sealing ring joint is shown in Fig. 2.

3.2.2 Dimensions

The dimensions of 45° bends shall comply with those given in Table 1 read with Fig.1. The dimensions of

45° bends for elastomeric sealing ring joint shall comply with those given in Table 2 read with Fig. 2.

3.2.3 The bends may either be plain at both ends or socketed either at one end or at both ends as agreed to between the manufacturer and the purchaser. In the case of socketed bends, the socket measurement shall comply with IS 10124 (Part 1).

4 MARKING

4.1 Each 45° bend shall be clearly and indelibly marked with the following information:

- Manufacturer's name or identification mark,
- Size of the bend and the appropriate class (working pressure) of IS 4985 to which the pressure rating of the fitting corresponds,
- Degree of bend, and
- Bends shall be marked in colour as indicated below for different classes of fittings:

<i>Class of the Fittings</i>	<i>Colour</i>
Class 2 (0.4 MPa)	Blue
Class 3 (0.6 MPa)	Green
Class 4 (0.8 MPa)	Brown
Class 5 (1.0 MPa)	Yellow
Class 6 (1.25 MPa)	Black
Plumbing	Pink

4.2 BIS Certification Marking

Each 45° bend may also be marked with the Standard Mark.

4.2.1 The use of the Standard Mark is governed by the provisions of the *Bureau of Indian Standards Act*, 1986 and the Rules and Regulations made thereunder. The details of conditions under which a licence for the use of the Standard Mark may be granted to the manufacturer or producer may be obtained from the Bureau of Indian Standards.

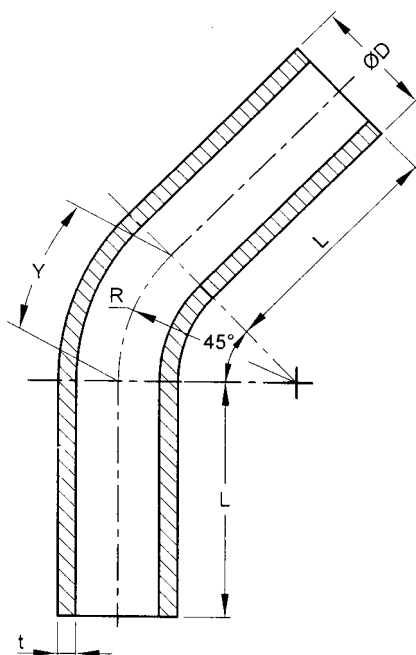


FIG. 1 45° BEND

Table 1 Dimensions of 45° Bend

(Clause 3.2.2, and Fig. 1)

All dimensions in millimetres.

Sl No.	Nominal Size	Y Min	L (Only for Plain Ends) Min	R Min	Minimum Wall Thickness (t) for Working Pressure MPa					
					0.4 (Class 2)	0.6 (Class 3)	0.8 (Class 4)	1.0 (Class 5)	1.25 (Class 6)	Plumbing
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)
i)	20	48	20	60	—	—	—	1.0	1.3	2.5
ii)	25	59	25	75	—	—	1.1	1.3	1.5	2.6
iii)	32	75	32	96	—	—	1.4	1.6	1.9	3.1
iv)	40	95	40	120	—	1.3	1.6	1.9	2.5	3.3
v)	50	118	50	150	—	1.5	2.1	2.5	3.0	3.4
vi)	63	149	63	189	1.4	2.0	2.5	3.2	3.8	—
vii)	75	177	75	225	1.7	2.4	3.1	3.8	4.6	—
viii)	90	212	90	270	1.9	2.8	3.6	4.5	5.5	—
ix)	110	259	110	330	2.3	3.4	4.4	5.5	6.7	—
x)	125	295	125	375	2.7	3.9	5.1	6.3	7.6	—
xi)	140	330	140	420	2.9	4.4	5.7	7.0	8.6	—
xii)	160	377	160	480	3.4	4.9	6.5	8.0	9.8	—
xiii)	180	424	180	540	3.8	5.5	7.2	9.0	10.9	—
xiv)	200	471	200	600	4.2	6.2	8.0	10.0	12.3	—
xv)	225	530	225	675	4.7	6.9	9.0	11.2	13.8	—
xvi)	250	589	250	750	5.2	7.7	10.0	12.5	15.3	—
xvii)	280	660	280	840	5.8	8.6	11.3	13.9	17.1	—
xviii)	315	742	315	945	6.5	9.7	12.6	15.6	19.3	—
xix)	355	837	355	1 065	7.3	10.8	14.3	17.7	21.7	—
xx)	400	842	400	1 200	8.2	12.2	16.1	19.8	24.5	—
xxi)	450	1 070	450	1 350	9.3	13.7	18.0	22.4	27.5	—
xxii)	500	1 178	500	1 500	10.3	15.3	20.1	24.8	30.5	—
xxiii)	560	1 319	560	1 680	11.6	17.2	22.4	27.8	34.2	—
xxiv)	630	1 484	630	1 890	13.0	19.2	25.2	31.8	38.4	—


NOTES

1 Minimum wall thickness is calculated on the basis of 90 percent of the minimum wall thickness of the corresponding size and pressure class of pipe rounded off to the next higher 0.1 mm.

2 Y, Min is calculated from $\frac{45^\circ \times 2 \delta R}{360^\circ}$

3 R, Min radius of the bend, is equal to 3 times the nominal outside diameter (D).

4 For 0.25 MPa pressure class, bends should not be made from 0.25 MPa pressure class pipes. For this bends made from 0.4 MPa pressure class should be used.

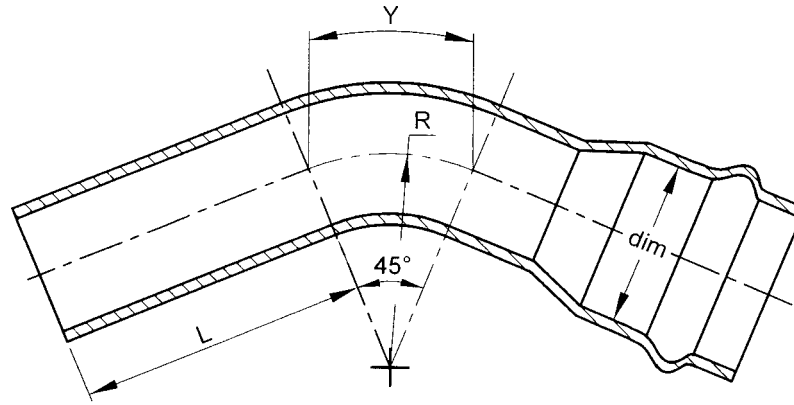

NOTE — The drawings are only intended to define the terms used in Table 1 and Table 2 and are not intended to illustrate specific design features.

FIG. 2 45° BEND FOR ELASTOMERIC SEALING RING JOINT

Table 2 Dimensions of 45° Bend for Elastomeric Sealing Ring Joint
(Clause 3.2.2, and Fig. 2)

All dimensions in millimetres.

Sl No.	Nominal Size	Y Min	L (Plain Ends) Min	R Min	Minimum Wall Thickness (t) for Working Pressure MPa				
					0.4 (Class 2)	0.6 (Class 3)	0.8 (Class 4)	1.0 (Class 5)	1.25 (Class 6)
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
i)	63	149	107	189	—	2.0	2.6	3.2	3.9
ii)	75	177	112	225	—	2.4	3.1	3.8	4.6
iii)	90	212	118	270	—	2.8	3.6	4.5	5.5
iv)	110	259	127	330	2.3	3.4	4.4	5.5	6.8
v)	125	295	133	375	2.7	3.9	5.1	6.3	7.7
vi)	140	330	139	420	2.9	4.4	5.7	7.0	8.6
vii)	160	377	146	480	3.4	4.9	6.5	8.0	9.9
viii)	180	424	156	540	3.8	5.5	7.2	9.0	11.0
ix)	200	471	164	600	4.2	6.2	8.0	10.0	12.3
x)	225	530	175	675	4.7	6.9	9.0	11.2	13.8
xi)	250	589	185	750	5.2	7.7	10.1	12.5	15.3
xii)	280	660	198	840	5.8	8.6	11.3	13.9	17.1
xiii)	315	742	215	945	6.5	9.7	12.6	15.6	19.3
xiv)	355	837	229	1 065	7.3	10.8	14.3	17.7	21.7
xv)	400	842	242	1 200	8.2	12.2	16.1	19.8	24.5
xvi)	450	1 060	259	1 350	9.3	13.7	18.0	22.4	27.5
xvii)	500	1 178	279	1 500	10.3	15.3	20.1	24.8	30.5
xviii)	560	1 319	298	1 680	11.6	17.2	22.4	27.8	34.2
xix)	630	1 484	322	1 890	13.0	19.2	25.2	31.3	38.5

Bureau of Indian Standards

BIS is a statutory institution established under the *Bureau of Indian Standards Act*, 1986 to promote harmonious development of the activities of standardization, marking and quality certification of goods and attending to connected matters in the country.

Copyright

BIS has the copyright of all its publications. No part of these publications may be reproduced in any form without the prior permission in writing of BIS. This does not preclude the free use, in course of implementing the standard, of necessary details, such as symbols and sizes, type or grade designations. Enquiries relating to copyright be addressed to the Director (Publications), BIS.

Review of Indian Standards

Amendments are issued to standards as the need arises on the basis of comments. Standards are also reviewed periodically; a standard along with amendments is reaffirmed when such review indicates that no changes are needed; if the review indicates that changes are needed, it is taken up for revision. Users of Indian Standards should ascertain that they are in possession of the latest amendments or edition by referring to the latest issue of 'BIS Catalogue' and 'Standards: Monthly Additions'.

This Indian Standard has been developed from Doc No. : CED 50 (7440).

Amendments Issued Since Publication

Amendment No.	Date of Issue	Text Affected

BUREAU OF INDIAN STANDARDS

Headquarters:

Manak Bhavan, 9 Bahadur Shah Zafar Marg, New Delhi 110002

Telephones: 2323 0131, 2323 3375, 2323 9402

Website: www.bis.org.in

Regional Offices:

Telephones

Central	: Manak Bhavan, 9 Bahadur Shah Zafar Marg NEW DELHI 110002	{ 2323 7617 2323 3841
Eastern	: 1/14, C.I.T. Scheme VII M, V.I.P. Road, Kankurgachi KOLKATA 700054	{ 2337 8499, 2337 8561 2337 8626, 2337 9120
Northern	: SCO 335-336, Sector 34-A, CHANDIGARH 160022	{ 260 3843 260 9285
Southern	: C.I.T. Campus, IV Cross Road, CHENNAI 600113	{ 2254 1216, 2254 1442 2254 2519, 2254 2315
Western	: Manakalaya, E9 MIDC, Marol, Andheri (East) MUMBAI 400093	{ 2832 9295, 2832 7858 2832 7891, 2832 7892

Branches : AHMEDABAD. BANGALORE. BHOPAL. BHUBANESHWAR. COIMBATORE. DEHRADUN. FARIDABAD. GHAZIABAD. GUWAHATI. HYDERABAD. JAIPUR. KANPUR. LUCKNOW. NAGPUR. PARWANOO. PATNA. PUNE. RAJKOT. THIRUVANATHAPURAM. VISAKHAPATNAM.