

## **BLANK PAGE**



IS 10124 (Part 8): 2009

भारतीय मानक पेय जल आपूर्ति के लिए सविरंचित पी वी सी-यू फिटिंगें — विशिष्टि भाग 8 90<sup>°</sup> बैंडों की विशिष्ट अपेक्षाएँ (दूसरा पुनरीक्षण)

Indian Standard

# FABRICATED PVC-U FITTINGS FOR POTABLE WATER SUPPLIES — SPECIFICATION

PART 8 SPECIFIC REQUIREMENTS FOR 90° BENDS

(Second Revision)

ICS 23.040.45; 91.140.60

© BIS 2009

BUREAU OF INDIAN STANDARDS MANAK BHAVAN, 9 BAHADUR SHAH ZAFAR MARG NEW DELHI 110002

May 2011 Price Group 2

#### **FOREWORD**

This standard (Part 8) (Second Revision) was adopted by the Bureau of Indian Standards, after the draft finalized by the Plastics Piping Systems Sectional Committee had been approved by the Civil Engineering Division Council.

This standard was first published in 1982 and revised in 1988. In this revision, following modifications have been made:

- a) Sizes and classes of fittings have been aligned with IS 4985 : 2000 'Unplasticized PVC pipes for potable water supplies Specification'.
- b) Requirements for bends for elastomeric sealing ring joints have also been included.

The requirements of fabricated PVC-U fittings are covered in thirteen parts. The other parts in the series are:

- Part 1 General requirements
- Part 2 Specific requirements for sockets
- Part 3 Specific requirements for straight reducers
- Part 4 Specific requirements for caps
- Part 5 Specific requirements for equal tees
- Part 6 Specific requirements for flanged tail pieces with metallic flanges
- Part 7 Specific requirements for threaded adaptors
- Part 9 Specific requirements for 60° bends
- Part 10 Specific requirements for 45° bends
- Part 11 Specific requirements for 30° bends
- Part 12 Specific requirements for 22 ½° bends
- Part 13 Specific requirements for 11 1/4° bends

For the purpose of deciding whether a particular requirement of this standard is complied with, the final value, observed or calculated, expressing the results of a test or analysis, shall be rounded off in accordance with IS 2:1960 'Rules for rounding off numerical values (*revised*)'. The number of significant places retained in the rounded off value should be the same as that of the specified value in this standard.

## Indian Standard

## FABRICATED PVC-U FITTINGS FOR POTABLE WATER SUPPLIES — SPECIFICATION

## PART 8 SPECIFIC REQUIREMENTS FOR 90° BENDS

(Second Revision)

#### 1 SCOPE

This standard (Part 8) lays down the requirements for manufacture, dimensions and marking for fabricated PVC-U 90° bends for potable water supplies.

#### 2 REFERENCES

The standards listed below contain provisions, which through reference in this text, constitute provisions of this standard. At the time of publication, the editions indicated were valid. All standards are subject to revision and parties to agreement based on this standard are encouraged to investigate the possibility of applying the most recent editions of the standards indicated below:

IS No.	Title
4985 : 2000	Unplasticized PVC pipes for potable water supplies — Specification (third revision)
10124 (Part 1): 2009	Specification for fabricated PVC-U fittings for potable water supplies — Specification: Part 1 General requirements

#### **3 REQUIREMENTS**

#### 3.1 General

The general requirements for material, sizes, tests, sampling and criteria for conformity shall conform to IS 10124 (Part 1).

#### 3.2 Manufacture

**3.2.1** Typical illustration of  $90^{\circ}$  bend is shown in Fig. 1. Typical illustration of  $90^{\circ}$  bend for elastomeric sealing ring joint is shown in Fig. 2.

#### 3.2.2 Dimensions

The dimensions of 90° bends shall comply with those given in Table 1 read with Fig.1. The dimensions of 90° bends for elastomeric sealing ring joint shall comply with those given in Table 2 read with Fig. 2.

**3.2.3** The bends may either be plain at both ends or socketed either at one end or at both ends as agreed between the manufacture and the purchaser. In the case of socketed bend, the socket measurement shall comply with IS 10124 (Part 1).

NOTE — For 0.25 MPa pressure class, bends should not be made from 0.25 MPa pressure class pipes. For this bends made from 0.4 MPa pressure class should be used.

#### 4 MARKING

- **4.1** Each 90° bend shall be clearly and indelibly marked with the following information:
  - a) Manufacture's name or identification mark,
  - b) Size of the bend and the appropriate class (working pressure) of IS 4985 to which the pressure rating of the fitting corresponds,
  - c) Degree of bend, and
  - d) Bends shall be marked in colour as indicated below for different classes of fittings:

Class of the Fittings	Colour
Class 2 (0.4 MPa)	Blue
Class 3 (0.6 MPa)	Green
Class 4 (0.8 MPa)	Brown
Class 5 (1.0 MPa)	Yellow
Class 6 (1.25 MPa)	Black
Plumbing	Pink

#### 4.2 BIS Certification Marking

Each bend may also be marked with the Standard Mark.

**4.2.1** The use of the Standard Mark is governed by the provisions of the *Bureau of Indian Standards Act*, 1986 and the Rules and Regulations made thereunder. The details of conditions under which a licence for the use of the Standard Mark may be granted to the manufacturer or producer may be obtained from the Bureau of Indian Standards.

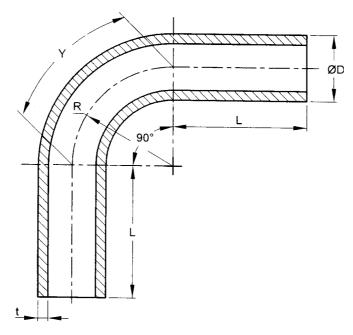


Fig.  $1\,90^{\circ}\,B$ end

### Table 1 Dimensions of 90° Bends

(Clause 3.2.2, and Fig. 1)

#### All dimensions in millimetres.


SI No.	Nominal Size	Y Min	L (Only for	<b>R</b> Min	M	inimum Wall	Thickness (t) MPa	for Working	Pressure	
			Plain Ends) <i>Min</i>		0.4 (Class 2)	0.6 (Class 3)	0.8 (Class 4)	1.0 (Class 5)	1.25 (Class 6)	Plumb- ing
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)
i)	20	95	20	60	_	_	_	1.0	1.3	2.5
ii)	25	118	25	75	_	_	1.1	1.3	1.5	2.6
iii)	32	151	32	96	_	_	1.4	1.6	1.9	3.1
iv)	40	189	40	120	_	1.3	1.6	1.9	2.5	3.3
v)	50	236	50	150	_	1.5	2.1	2.5	3.0	3.4
vi)	63	297	63	189	1.4	2.0	2.5	3.2	3.8	_
vii)	75	354	75	225	1.7	2.4	3.1	3.8	4.6	_
viii)	90	424	90	270	1.9	2.8	3.6	4.5	5.5	_
ix)	110	519	110	330	2.3	3.4	4.4	5.5	6.7	_
x)	125	589	125	375	2.7	3.9	5.1	6.3	7.6	_
xi)	140	660	140	420	2.9	4.4	5.7	7.0	8.6	_
xii)	160	754	160	480	3.4	4.9	6.5	8.0	9.8	_
xiii)	180	848	180	540	3.8	5.5	7.2	9.0	10.9	_
xiv)	200	942	200	600	4.2	6.2	8.0	10.0	12.3	_
xv)	225	1 060	225	675	4.7	6.9	9.0	11.2	13.8	_
xvi)	250	1 178	250	750	5.2	7.7	10.0	12.5	15.3	_
xvii)	280	1 319	280	840	5.8	8.6	11.3	13.9	17.1	_
xviii)	315	1 484	315	945	6.5	9.7	12.6	15.6	19.3	_
xix)	355	1 673	355	1 065	7.3	10.8	14.3	17.7	21.7	_
xx)	400	1 884	400	1 200	8.2	12.2	16.1	19.8	24.5	_
xxi)	450	2 120	450	1 350	9.3	13.7	18.0	22.4	27.5	_
xxii)	500	2 355	500	1 500	10.3	15.3	20.1	24.8	30.5	_
xxiii)	560	2 638	560	1 680	11.6	17.2	22.4	27.8	34.2	_
xxiv)	630	2 968	630	1 890	13.0	19.2	25.2	31.8	38.4	_

### NOTES

<sup>1</sup> Minimum wall thickness is calculated on the basis of 90 percent of the minimum wall thickness of the corresponding size and pressure class of pipe rounded off to the next higher  $0.1\,\mathrm{mm}$ .

<sup>2</sup> Y, Min is calculated from  $90^{\circ} \times 2 \stackrel{\circ}{\text{d}} R$ 

<sup>3</sup> R, Min radius of the bend, is equal to 3 times the nominal outside diameter (D).

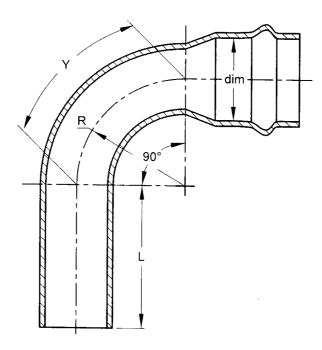

NOTE — The drawings are only intended to define the terms used in Table 1 and Table 2 and are not intended to illustrate specific design features.

Fig. 2  $90^{\circ}$  Bend for Elastomeric Sealing Ring Joint

## Table 2 Dimensions of 90° Bend for Elastomeric Sealing Ring Joint

(Clause 3.2.2, and Fig. 2)

#### All dimensions in millimetres.

SI No.	Nominal Size	<b>Y</b> Min	L (Plain Ends)	<b>R</b> Min	Minimum Wall Thickness (t) for Working Pressure  MPa				essure
			Min		0.4 (Class 2)	0.6 (Class 3)	0.8 (Class 4)	1.0 (Class 5)	1.25 (Class 6)
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
i)	63	297	107	189	_	2.0	2.6	3.2	3.9
ii)	75	354	112	225	_	2.4	3.1	3.8	4.6
iii)	90	424	118	270	_	2.8	3.6	4.5	5.5
iv)	110	519	127	330	2.3	3.4	4.4	5.5	6.8
v)	125	589	133	375	2.7	3.9	5.1	6.3	7.7
vi)	140	660	139	420	2.9	4.4	5.7	7.0	8.6
vii)	160	754	146	480	3.4	4.9	6.5	8.0	9.9
viii)	180	848	156	540	3.8	5.5	7.2	9.0	11.0
ix)	200	942	164	600	4.2	6.2	8.0	10.0	12.3
x)	225	1 060	175	675	4.7	6.9	9.0	11.2	13.8
xi)	250	1 178	185	750	5.2	7.7	10.1	12.5	15.3
xii)	280	1 319	198	840	5.8	8.6	11.3	13.9	17.1
xiii)	315	1 484	215	945	6.5	9.7	12.6	15.6	19.3
xiv)	355	1 673	229	1 065	7.3	10.8	14.3	17.7	21.7
xv)	400	1 884	242	1 200	8.2	12.2	16.1	19.8	24.5
xvi)	450	2 120	259	1 350	9.3	13.7	18.0	22.4	27.5
xvii)	500	2 355	279	1 500	10.3	15.3	20.1	24.8	30.5
xviii)	560	2 638	298	1 680	11.6	17.2	22.4	27.8	34.2
xix)	630	2 968	322	1 890	13.0	19.2	25.2	31.3	38.5

#### **Bureau of Indian Standards**

BIS is a statutory institution established under the *Bureau of Indian Standards Act*, 1986 to promote harmonious development of the activities of standardization, marking and quality certification of goods and attending to connected matters in the country.

#### Copyright

BIS has the copyright of all its publications. No part of these publications may be reproduced in any form without the prior permission in writing of BIS. This does not preclude the free use, in course of implementing the standard, of necessary details, such as symbols and sizes, type or grade designations. Enquiries relating to copyright be addressed to the Director (Publications), BIS.

#### **Review of Indian Standards**

Amendments are issued to standards as the need arises on the basis of comments. Standards are also reviewed periodically; a standard along with amendments is reaffirmed when such review indicates that no changes are needed; if the review indicates that changes are needed, it is taken up for revision. Users of Indian Standards should ascertain that they are in possession of the latest amendments or edition by referring to the latest issue of 'BIS Catalogue' and 'Standards: Monthly Additions'.

This Indian Standard has been developed from Doc No.: CED 50 (7438).

#### **Amendments Issued Since Publication**

Amendment No.	Date of Issue	Text Affected

#### **BUREAU OF INDIAN STANDARDS**

#### **Headquarters:**

Manak Bhavan, 9 Bahadur Shah Zafar Marg, New Delhi 110002

*Telephones*: 2323 0131, 2323 3375, 2323 9402 *Website*: www.bis.org.in

Regional Offices:	Telephones
Central : Manak Bhavan, 9 Bahadur Shah Zafar Marg	2323 7617
NEW DELHI 110002	2323 3841
Eastern : 1/14, C.I.T. Scheme VII M, V.I.P. Road, Kankurgachi	2337 8499, 2337 8561
KOLKATA 700054	2337 8626, 2337 9120
Northern: SCO 335-336, Sector 34-A, CHANDIGARH 160022	260 3843 260 9285
Southern : C.I.T. Campus, IV Cross Road, CHENNAI 600113	2254 1216, 2254 1442 2254 2519, 2254 2315
Western: Manakalaya, E9 MIDC, Marol, Andheri (East)	2832 9295, 2832 7858
MUMBAI 400093	2832 7891, 2832 7892

**Branches**: AHMEDABAD. BANGALORE. BHOPAL. BHUBANESHWAR. COIMBATORE. DEHRADUN. FARIDABAD. GHAZIABAD. GUWAHATI. HYDERABAD. JAIPUR. KANPUR. LUCKNOW. NAGPUR. PARWANOO. PATNA. PUNE. RAJKOT. THIRUVANATHAPURAM. VISAKHAPATNAM.