इंटरनेट मानक

Disclosure to Promote the Right To Information

Whereas the Parliament of India has set out to provide a practical regime of right to information for citizens to secure access to information under the control of public authorities, in order to promote transparency and accountability in the working of every public authority, and whereas the attached publication of the Bureau of Indian Standards is of particular interest to the public, particularly disadvantaged communities and those engaged in the pursuit of education and knowledge, the attached public safety standard is made available to promote the timely dissemination of this information in an accurate manner to the public.

"जानने का अधिकार, जीने का अधिकार"
Mazdoor Kisan Shakti Sangathan
"The Right to Information, The Right to Live"

"पुराने को छोड नये के तरफ"
Jawaharlal Nehru
"Step Out From the Old to the New"

IS 1597-2 (1992): Code of practice for construction of stone masonry, Part 2: Ashlar masonry [CED 13: Building Construction Practices including Painting, Varnishing and Allied Finishing]

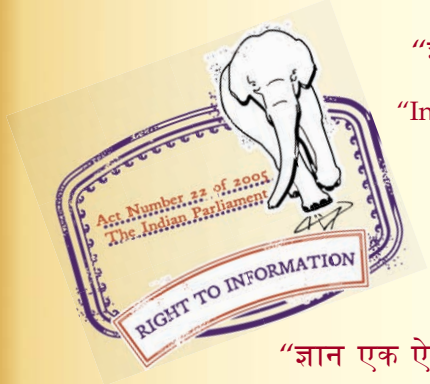

"ज्ञान से एक नये भारत का निर्माण"
Satyanarayan Gangaram Pitroda
"Invent a New India Using Knowledge"

"ज्ञान एक ऐसा खजाना है जो कभी चुराया नहीं जा सकता है"
Bhartṛhari—Nītiśatakam
"Knowledge is such a treasure which cannot be stolen"

BLANK PAGE

IS 1597 (Part 2) : 1992
(Reaffirmed 2002)

भारतीय मानक

पत्थर की चिनाई के निर्माण – रीति संहिता

भाग 2 ऐशलर चिनाई

(पहला पुनरीक्षण)

Indian Standard

CONSTRUCTION OF STONE MASONRY — CODE OF PRACTICE

PART 2 ASHLAR MASONRY

(First Revision)

First Reprint JANUARY 1998

UDC 693·156 : 006·76

BUREAU OF INDIAN STANDARDS
MANAK BHAVAN, 9 BAHADUR SHAH ZAFAR MARG
NEW DELHI 110002

July 1992

Price Group 3

FOREWORD

This Indian Standard (First Revision) was adopted by the Bureau of Indian Standards, after the draft finalized by the Building Construction Practices Sectional Committee had been approved by the Civil Engineering Division Council.

Use of stone masonry work is known and practised from the earlier days and natural building stone is extensively available in many parts of this country. The types of stone masonry construction followed depends on local factors like physical characteristics of the stone, climatic conditions, workmanship, etc. Certain broad principles in laying, bonding, breaking of joints and finish shall be complied with in order that the masonry develops adequate strength and presents a neat appearance.

This standard (Part 2) covers ashlar masonry which is commonly used in stone work in most cases. Part I of the standard covers rubble masonry. Ashlar masonry is generally used in important buildings where strength and the life of the structure is the criterion. This type of masonry is also abundantly used in facing of the stone masonry.

This standard was first published in 1967. The present revision has been taken up to incorporate the improvements found necessary in light of the usage of this standard and suggestions by various bodies implementing it.

In the preparation of this standard several construction agencies in this country having wide experience in stone work have been consulted. Due weightage has also been given to international co-ordination among the standards and practices prevailing in different countries.

For the purpose of deciding whether a particular requirement of this standard is complied with, the final value, observed or calculated, expressing the result of a test or analysis, shall be rounded off in accordance with IS 2 : 1960 'Rules for rounding off numerical values (*revised*)'. The number of significant places retained in the rounded off value should be the same as that of the specified value in this standard.

Indian Standard

CONSTRUCTION OF STONE MASONRY — CODE OF PRACTICE

PART 2 ASHLAR MASONRY

(First Revision)

1 SCOPE

1.1 This standard (Part 2) covers the design and construction of ashlar stone masonry.

1.2 This standard covers only construction practices generally met with in India.

1.3 This standard does not cover:

a) stone facing and veneering work, and

b) masonry for dams and other masonry work.

2 REFERENCES

Standards listed in Annex A are necessary adjuncts to the standard.

3 TERMINOLOGY

For the purpose of this standard, definitions pertaining to stone masonry given in **3** of IS 1597 (Part 1) : 1992 shall apply.

4 NECESSARY INFORMATION

For efficient planning, design and execution of the works detailed information with regard to the following shall be furnished to those responsible for the work:

a) Layout plan showing the orientation of the structure.

b) Dimensioned details of the structure with details of sections (to a suitably large scale, that is, 1/20 or 1 cm = 20 cm) and levels of foundations, finished ground levels, clear floor to floor height of rooms, sizes of openings, etc.

c) Type of stone and class of masonry, types of bond and final finish for the masonry; the mixes of mortar to be used, etc; details of architectural features, moulding and other special work.

d) Location and other details of openings, chases, embedments of service lines, such as for water supply, drainage and electrical installations, and location and details of hearths, flues and chimneys.

5 MATERIALS

5.1 Materials to be used for ashlar masonry shall be the same as in **5** of IS 1597 (Part 1) : 1992.

6 SELECTION OF STONE

In selecting stone, the situation in which it is to be used, has to be considered. The recommended use of common types of stones for various situations has been shown in Table 2 of IS 1597 (Part 1) : 1992.

7 DESIGN CONSIDERATION

7.1 Types

7.1.1 *Plain Ashlar* (*see* Fig. 1)

Stone blocks of the same height in each course, are used and every stone is fine tooled on all beds, joints and faces, full and true.

7.1.2 *Sunk or Moulded* (*see* Fig. 2D)

The exposed faces of each stone block shall be gauged, cut, grooved, rebated, sunk or plain moulded as the case may be. Stone blocks of same height in each course are used.

7.1.3 *Rock (Quarry) Faced* (*see* Fig. 2B)

The faces of each stone block exposed to view, shall have only chisel draft 25 mm wide alround the edges and between the drafts be left rough as the stone comes from the quarry.

7.1.3.1 *Chamfered* (*see* Fig. 2C)

In the case of chamfered masonry, the edges are bevelled to 45° for a depth of about 2·5 cm. Stone blocks of same height in each course are used.

7.1.4 *Rough Tooled or Punched* (*see* Fig. 2A)

The faces of each stone block exposed to view, shall have a fine dressed chisel draft 2·5 cm wide alround the edges and be rough tooled between the drafts and on all beds and joints. Stone blocks of same height in each course are used.

7.1.5 *Block-in-Course* (*see* Fig. 3)

This is hammer-faced or pitch-faced regular coursed masonry in large blocks. It is a superior type of coursed rubble masonry.

7.2 Weather Protection

Generally ashlar masonry is not given any further protective rendering or finish.

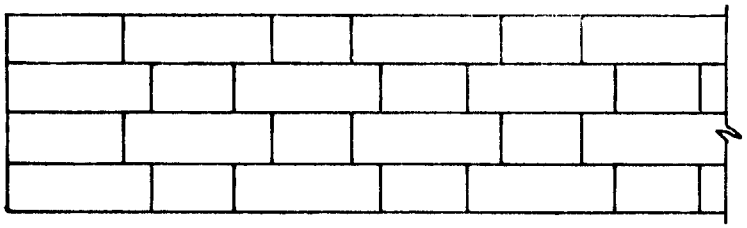

FIG. 1 PLAIN ASHLAR

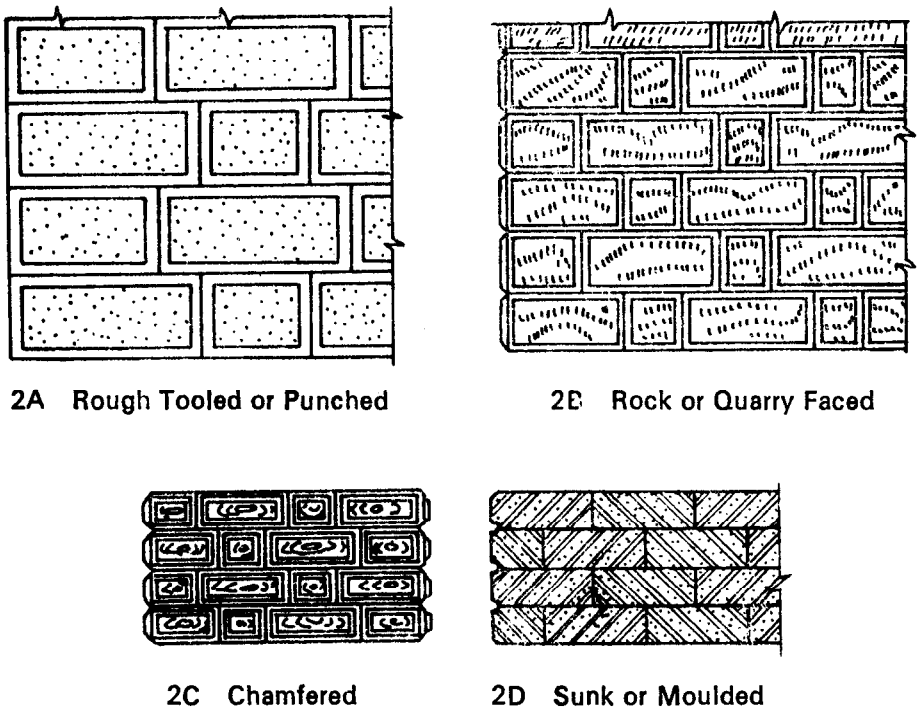

FIG. 2 ASHLAR MASONRY

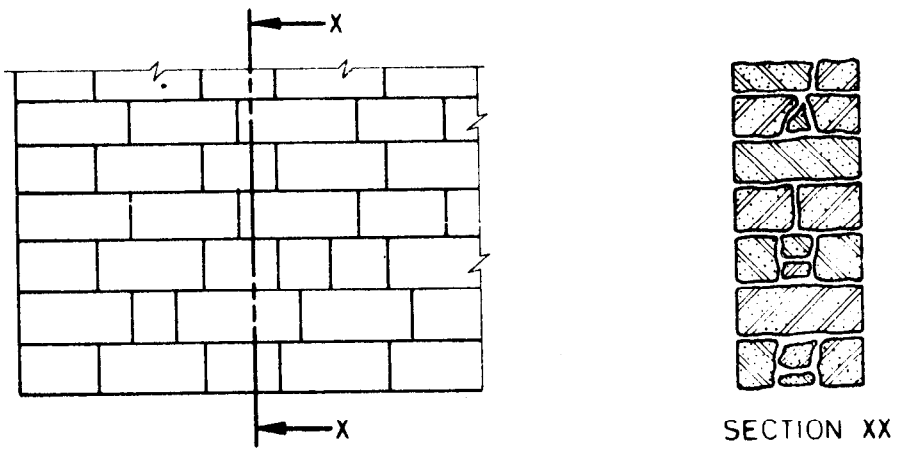

FIG. 3 BLOCK-IN-COURSE ASHLAR MASONRY

7.3 Rain Protection

Information regarding rain protection is the same as in 7.3 of IS 1597 (Part 1) : 1992.

7.4 Types of Mortar

Information regarding types of mortar to be used in the same as in 7.4 of IS 1597 (Part 1) : 1992.

7.5 Damp-Proof Course

For the functions, materials to be used, and the places where damp-proof course is provided, reference be made to 6.8 of IS 2212 : 1991.

7.6 Structural and Functional Characteristics

7.6.1 *Structural Stability and Strength*

Reference may be made to IS 1905 : 1987, IS 1893 : 1984 and IS 4326 : 1976 for design with regard to structural stability.

8 GENERAL REQUIREMENTS FOR MASONRY CONSTRUCTION

8.1 Setting Out

The information regarding setting out is the same as 8 of IS 2212 : 1991.

8.2 Dressing of Stones

The dressing of stone shall be as specified for individual types of masonry work and it shall also conform to the general requirements for dressing of stones covered in IS 1129 : 1972.

8.3 Scaffolding

Double scaffolding having two sets of vertical support shall be used in accordance with IS 2750 : 1964.

8.4 Handling

The use of grip in the tops of stones is preferable to any method of holding the stone at the ends, because it enables the stone to be set in final position before the tackle is released. Due care shall be taken to protect finished surfaces and edges of stone against damage during handling. The various methods employed in different situations for lifting stone are shown in Fig. 10 of IS 1597 (Part 1) : 1992.

8.5 Tools that are required for stone masonry work, such as plumb bob and line, straight edges, mason's square, spirit level and trowel are described in IS 1630 : 1984 and various types of mason's hammer, and chisels in IS 1129 : 1972.

8.6 Watering

Stones shall be sufficiently wetted before laying to prevent absorption of water from mortar.

8.7 In all types of ashlar masonry, the following shall be complied with.

8.7.1 The natural bed of the stratified stone shall be so laid that the pressure is always perpendicular to the strata.

8.7.2 The courses shall be built perpendicular to the pressure which the masonry will bear. In case of battered walls, the beds of stone and the plane of courses shall be at right angle to the batter.

8.7.3 Where the depth of courses vary, the largest stone shall be placed in the lower course. The thickness of courses shall also decrease gradually to the top.

8.7.4 Stones shall break joint on the face for at least half the height of the course and the bond shall be carefully maintained throughout.

8.7.5 All connected masonry in a structure shall be carried up nearly at one uniform level throughout but when breaks are unavoidable, the joint shall be raked back to a maximum angle of 30° to the horizontal so as to prevent cracks developing between new and old work.

8.7.6 All necessary chases for joggles, dowels and cramps should be formed on the stone beforehand.

8.7.7 The walls, pillars shall be carried up truely plumb or to specified batter.

8.7.8 All courses shall be laid truely horizontal and all vertical joints shall be truely vertical.

8.7.9 Storey rods showing the heights of all doors and windows and other necessary information should be used at the time of construction of masonry.

8.8 Fixing of Frames

The information regarding fixing of frames is given in 8.8 of IS 1597 (Part 1) : 1992.

8.9 Bearing of Floor

The information regarding bearing of floor is given in 8.9 of IS 1597 (Part 1) : 1992.

8.10 Jointing and Pointing

All joints shall be full of mortar. Pointing shall be avoided as far as possible, but where unavoidable it shall be carried out as the work proceeds using the same mortar as for bedding. If carried out by raking out the joint, later on after hardening, specially prepared mortars shall be used. The maximum thickness of joints shall be 3 mm except for block in course where it shall be 6 mm. The various types of pointing are shown in Fig. 10 of IS 2212 : 1991.

8.11 Curing

Green work shall be protected from rain by suitable covering. Masonry work and cement of composite mortar shall be kept constantly moist in all the faces for a minimum period of 7 days. The top of the masonry work shall be left flooded with water, with the close of the day. Watering shall be done carefully so as not to disturb or wash out green mortar and use of perforated rose spout may be suitable. In the case of lime mortar, curing should commence two days after laying of masonry and shall continue for seven days.

9 CONSTRUCTION

9.1 Plain Ashlar

9.1.1 *Dressing*

Every stone shall be cut to the required size and shape, chisel dressed on all beds and joints so as to be free from bushing dressed surface, shall not show a depth of gap of more than 3 mm from straight edge placed on it. The exposed faces and joints 6 mm, from the face shall be fine tooled so that a straight edge can be laid along the face of the stone in contact with every point. All visible angles and edges shall be true and square and free from chippings. The corner stones (quoins) shall be dressed square and corner shall be straight and vertical.

9.1.2 *Bond Stones*

Through bond stones shall be provided in walls up to 60 cm thick and in case of walls above 60 cm in thickness, a set of two or more bond stones overlapping each other by at least 15 cm shall be provided in a line from face to back. In case of highly absorbent type of stones (porous lime stone and sand stone, etc) the bond stone shall extend about two third into the wall, as through stones in this case may give rise to damp penetration and hence for all thicknesses of such walls a set of two or more bond stones overlapping each other by at least 15 cm shall be provided. Each bond stone or a set of bond stones shall be provided at 1·5 m to 1·8 m apart clear in every course.

9.1.3 *Laying*

The face stone shall be laid headers and stretchers alternately. The headers shall be so arranged to come as nearby as possible in the middle of stretchers above or below. Stones shall be laid in regular courses of not less than 30 cm in height and all courses shall be of the same height unless otherwise specified. No stone shall be less in breadth than its height or less in length than twice its height, unless otherwise specified.

9.2 Ashlar Sunk or Moulded

9.2.1 *Dressing*

Dressing shall be done in the same manner as in plain ashlar. The faces shall then be gauged, cut, grooved, rebated, sunk or plain moulded as required for the work. For this purpose a full size layout of the moulding shall be prepared on platforms for which sheet templates shall be cut and the stone dressed to the templates to a uniform and fine finish. The dressed surface shall not be more than 3 mm from straight edge placed on it. All visible angles and edges shall be true and free from chippings. The joints, 6 mm from the face shall also be fine tooled so that a straight edge placed on it is in contact with every point. It shall be finest surface that can be given to a stone with the chisel and with rubbing.

9.2.2 The requirements regarding bond stones and laying shall be the same as in plain ashlar (*see* **9.1.2** and **9.1.3**).

9.3 Ashlar Rock Faced

9.3.1 *Dressing*

The dressing of stone blocks in case of ashlar rock shall be similar to ashlar rough tooled (*see* **9.4.1**) except that the exposed faces of the stone between the drafts shall be left rough as the stone comes from the quarry; but no rock face or 'bushing' shall project more than 7·5 cm from plane of drafts.

9.3.2 The requirements regarding bond stones and laying shall be the same as in plain ashlar (*see* **9.1.2** and **9.1.3**).

9.4 Ashlar Chamfered

9.4.1 *Dressing*

Stones required for ashlar chamfered masonry shall be dressed as above except that the edges round the exposed face of each stone shall be bevelled off to 45° for a depth of about 2·5 cm or more as specified.

9.4.2 The requirements regarding bond stones and laying shall be the same as in plain ashlar (*see* **9.1.2** and **9.1.3**).

9.5 Ashlar Rough Tooled

9.5.1 *Dressing*

The dressing of stone blocks shall be similar to plain ashlar except that face exposed in view shall have a fine chisel draft 2·5 cm wide round the edges and shall be rough tooled between the draft such that the dressed surface shall not deviate more than 3 mm from the straight edge placed over it.

9.5.2 The requirements regarding bond stones and laying shall be the same as on plain ashlar (*see* **9.1.2** and **9.1.3**).

9.6 Ashlar Block in Course

9.6.1 *Dressing*

The stones are dressed all squared and laid to fine joints (*see* **8.10**) the faces usually being hammer dressed. The stones selected, may be of larger size than for plain ashlar.

9.6.2 The requirements regarding bond stone and laying shall be the same as in plain ashlar (*see* **9.1.2** and **9.1.3**) except that the courses vary between 20 to 25 cm in the thickness. This type of masonry is, therefore, slightly superior to coursed rubble masonry.

9.7 Ashlar Masonry for Special Works

9.7.1 *Arch Dome or Circular Moulded Works*

9.7.1.1 *Dressing*

The dressing shall be done in the same manner as for ashlar sunk moulded except that for arch or dome work, the stones shall be dressed to the required wedge shape so that the joints shall be truly radial.

9.7.1.2 The requirements regarding bond stone and laying shall be the same as in plain ashlar (*see* **9.1.2** and **9.1.3**). Centering and shuttering required for this work should be of approved quality.

9.7.2 *Moulded and Carved Columns*

9.7.2.1 *Dressing*

The dressing shall be done in the same manner as for plain ashlar (*see* **9.1.1**). The joints with the adjoining stones shall be truly vertical, horizontal, radial and circular as the case may be. The face shall be dressed to uniform curves of planes as required for the work in accordance with the method prescribed for ashlar plane (*see* **9.1**).

9.7.2.2 Other details shall be the same as for plain ashlar.

ANNEX A

(*Clause* 2)

LIST OF REFERRED INDIAN STANDARDS

IS No.	*Title*	*IS No.*	*Title*
1129 : 1972	Recommendations for dressing of natural building stones (*first revision*)	1905 : 1987	Code of practice for structural use of unreinforced masonry (*third revision*)
1597 (Part 1) : 1992	Code of practice for construction of stone masonry: Part 1 Rubble stone masonry (*first revision*)	2212 : 1991	Code of practice for brick work (*first revision*)
1630 : 1984	Specification for mason's tools for plaster work and pointing work (*first revision*)	2750 : 1964	Specification for steel scaffoldings
1893 : 1984	Criteria for earthquake resistant design of structures (*fourth revision*)	4326 : 1976	Code of practice for earthquake resistance design and construction of buildings (*first revision*)

Bureau of Indian Standards

BIS is a statutory institution established under the *Bureau of Indian Standards Act*, 1986 to promote harmonious development of the activities of standardization, marking and quality certification of goods and attending to connected matters in the country.

Review of Indian Standards

Amendments are issued to standards as the need arises on the basis of comments. Standards are also reviewed periodically; a standard along with amendments is reaffirmed when such review indicates that no changes are needed; if the review indicates that changes are needed, it is taken up for revision. Users of Indian Standards should ascertain that they are in possession of the latest amendments or edition by referring to the latest issue of 'BIS Handbook' and 'Standards Monthly Additions'.

This Indian Standard has been developed from Doc: No. CED 13 (4989)

Amendments Issued Since Publication

Amend No.	Date of Issue	Text Affected

BUREAU OF INDIAN STANDARDS

Headquarters:

Manak Bhavan, 9 Bahadur Shah Zafar Marg, New Delhi 110002
Telephones: 323 01 31, 323 33 75, 323 94 02

Telegrams: Manaksanstha
(Common to all offices)

Regional Offices:		Telephone
Central	: Manak Bhavan, 9 Bahadur Shah Zafar Marg NEW DELHI 110002	323 76 17, 323 38 41
Eastern	: 1/14 C.I.T. Scheme VII M, V.I.P. Road, Maniktola CALCUTTA 700054	337 84 99, 337 85 61 337 86 26, 337 91 20
Northern	: SCO 335-336, Sector 34-A, CHANDIGARH 160022	60 38 43 60 20 25
Southern	: C.I.T. Campus, IV Cross Road, CHENNAI 600113	235 02 16, 235 04 42 235 15 19, 235 23 15
Western	: Manakalaya, E9 MIDC, Marol, Andheri (East) MUMBAI 400093	832 92 95, 832 78 58 832 78 91, 832 78 92
Branches	: AHMADABAD. BANGALORE. BHOPAL. BHUBANESHWAR. COIMBATORE. FARIDABAD. GHAZIABAD. GUWAHATI. HYDERABAD. JAIPUR. KANPUR. LUCKNOW. NAGPUR. PATNA. PUNE. THIRUVANANTHAPURAM.	

Printed by Reprography Unit, BIS, New Delhi