

इंटरनेट

मानक

Disclosure to Promote the Right To Information

Whereas the Parliament of India has set out to provide a practical regime of right to information for citizens to secure access to information under the control of public authorities, in order to promote transparency and accountability in the working of every public authority, and whereas the attached publication of the Bureau of Indian Standards is of particular interest to the public, particularly disadvantaged communities and those engaged in the pursuit of education and knowledge, the attached public safety standard is made available to promote the timely dissemination of this information in an accurate manner to the public.

“जानने का अधिकार, जीने का अधिकार”

Mazdoor Kisan Shakti Sangathan

“The Right to Information, The Right to Live”

“पुराने को छोड़ नये के तरफ”

Jawaharlal Nehru

“Step Out From the Old to the New”

IS/IEC 60947-4-1 (2000): Low-Voltage Switchgear and Controlgear, Part 4: Contractors and Motor-Starters, Section 1: Electromechanical Contactors and Motors-Starters [ETD 7: Low Voltage Switchgear and Controlgear]



“ज्ञान से एक नये भारत का निर्माण”

Satyanarayan Gangaram Pitroda

“Invent a New India Using Knowledge”



“ज्ञान एक ऐसा खजाना है जो कभी चुराया नहीं जा सकता है”

Bhartrhari—Nitiśatakam

“Knowledge is such a treasure which cannot be stolen”

BLANK PAGE



भारतीय मानक
निम्न-वोल्टता के स्विचगियर और नियंत्रणगियर

भाग 4 कान्टैक्टर और मोटर स्टार्टर
अनुभाग 1 विद्युतयांत्रिक कान्टैक्टर और मोटर स्टार्टर

Indian Standard
LOW-VOLTAGE SWITCHGEAR AND CONTROLGEAR
PART 4 CONTACTORS AND MOTOR-STARTERS
Section 1 Electromechanical Contactors and Motor-Starters

ICS 29.120.99; 29.130.20

© BIS 2008

BUREAU OF INDIAN STANDARDS
MANAK BHAVAN, 9 BAHADUR SHAH ZAFAR MARG
NEW DELHI 110002

July 2008

Price Group 20

CONTENTS

1	Scope and object	1
1.1	AC and d.c. contactors	1
1.2	AC motor-starters	1
2	Normative references	4
3	Definitions	6
3.1	Definitions concerning contactors	6
3.2	Definitions concerning starters	7
3.3	Characteristic quantities	10
4	Classification	10
5	Characteristics of contactors and starters	10
5.1	Summary of characteristics	10
5.2	Type of equipment	11
5.3	Rated and limiting values for main circuits	12
5.4	Utilization category	19
5.5	Control circuits	22
5.6	Auxiliary circuits	22
5.7	Characteristics of relays and releases (overload relays)	22
5.8	Co-ordination with short-circuit protective devices	24
5.9	Switching overvoltages	25
5.10	Types and characteristics of automatic change-over devices and automatic acceleration control devices	25
5.11	Types and characteristics of auto-transformers for two-step auto-transformer starters	25
5.12	Types and characteristics of starting resistors for rheostatic rotor starters	26
6	Product information	26
6.1	Nature of information	26
6.2	Marking	26
6.3	Instructions for installation, operation and maintenance	28
7	Normal service, mounting and transport conditions	28
8	Constructional and performance requirements	28
8.1	Constructional requirements	28
8.2	Performance requirements	30
8.3	Electromagnetic compatibility (EMC)	42
9	Tests	43
9.1	Kinds of test	43
9.2	Compliance with constructional requirements	45
9.3	Compliance with performance requirements	45
9.4	EMC Tests	59

Annex A (normative) Marking and identification of terminals of contactors and associated overload relays	70
Annex B (normative) Special tests	74
Annex C Void	82
Annex D (informative) Items subject to agreement between manufacturer and user	83
Annex E (informative) Examples of control circuit configurations	84
Annex F (normative) Requirements for auxiliary contact linked with power contact (mirror contact)	87
Bibliography	90
Figure 1 – Typical curves of currents and torques during a star-delta start (see 1.2.2.1)	63
Figure 2 – Typical curves of currents and torques during an auto-transformer start (see 1.2.2.2)	64
Figure 3 – Typical variants of combination starters (see 3.2.7) and protected starters (see 3.2.8)	65
Figure 4 – Example of three-phase diagram of a rheostatic rotor starter with three starting steps (see 3.2.16) and one direction of rotation (in the case when all the mechanical switching devices are contactors)	66
Figure 5 – Typical methods and diagrams of starting alternating-current induction motors by means of auto-transformers	67
Figure 6 – Examples of speed/time curves corresponding to cases a), b), c), d), e) and f) of 5.3.5.5 (the dotted parts of the curves correspond to the periods when no current flows through the motor)	68
Figure 7 – Multiple of current setting limits for ambient air temperature compensated time-delay overload relays (see 8.2.1.5.1)	69
Figure B.1 – Examples of time-current withstand characteristic	81
Figure F.1 – Mirror contact	88
Table 1 – Utilization categories	21
Table 2 – Trip classes of thermal, time-delay magnetic or solid state overload relays	23
Table 3 – Limits of operation of time-delay overload relays when energized on all poles	33
Table 4 – Limits of operation of three-pole thermal overload relays when energized on two poles only	34
Table 5 – Temperature rise limits for insulated coils in air and in oil	35
Table 6 – Intermittent duty test cycle data	36
Table 7 – Making and breaking capacities – Making and breaking conditions according to utilization category	37
Table 7a – Relationship between current broken I_c and off-time for the verification of rated making and breaking capacities	38
Table 7b – Operational current determination for utilization categories AC-6a and AC-6b when derived from AC-3 ratings	39

Table 8 – Conventional operational performance – Making and breaking conditions according to utilization category	40
Table 9 – Overload current withstand requirements.....	41
Table 10 – Specific acceptance criteria for immunity tests.....	43
Table 12 – Value of the prospective test current according to the rated operational current	56
Table 13 – EMC immunity tests.....	60
Table 14 – Conducted radio-frequency emission test limits	61
Table 15 – Radiated emission test limits	62
Table B.1 – Verification of the number of on-load operating cycles – Conditions for making and breaking corresponding to the several utilization categories	77
Table B.2 – Test conditions.....	80
Table F 1 – Test voltage according to altitude	89

NATIONAL FOREWORD

This Indian Standard (Part 4/Sec 1) which is identical with IEC 60947-4-1 : 2000 'Low-voltage switchgear and controlgear — Part 4-1: Contactors and motor-starters — Electromechanical contactors and motor-starters' issued by the International Electrotechnical Commission (IEC) was adopted by the Bureau of Indian Standards on the recommendation of the Low-Voltage Switchgear and Controlgear Sectional Committee and approval of the Electrotechnical Division Council.

This standard supersedes IS 13947 (Part 4/Sec 1) : 1993 'Specification for low-voltage switchgear and controlgear: Part 4 Contactors and motor-starters, Section 1 Electromechanical contactors and motor-starters'. It also incorporates Amendment No. 1 published in 2002 and Technical Corrigendum 1 published in 2001.

The text of IEC Standard has been approved as suitable for publication as an Indian Standard without deviations. Certain conventions are, however, not identical to those used in Indian Standards. Attention is particularly drawn to the following:

- a) Wherever the words 'International Standard' appear referring to this standard, they should be read as 'Indian Standard'.
- b) Comma (,) has been used as a decimal marker, while in Indian Standards, the current practice is to use a point (.) as the decimal marker.

In this adopted standard, reference appears to certain International Standards for which Indian Standards also exist. The corresponding Indian Standards, which are to be substituted in their respective places, are listed below along with their degree of equivalence for the editions indicated:

<i>International Standard</i>	<i>Corresponding Indian Standard</i>	<i>Degree of Equivalence</i>
IEC 60034-1 : 2004 Rotating electrical machines — Part 1: Rating and performance	IS 4722 : 2001 Rotating electrical machines — Specification (<i>second revision</i>)	Technically Equivalent
IEC 60050 (441) : 1984 International Electrotechnical Vocabulary (IEV) — Chapter 441: Switchgear, controlgear and fuses	IS 1885 (Part 17) : 1979 Electrotechnical vocabulary: Part 17 Switchgear and controlgear (<i>first revision</i>)	do
IEC 60076-1 : 1993 Power transformers — Part 1: General	IS 2026 (Part 1) : 1977 Power transformers: Part 1 General (<i>first revision</i>)	do
IEC 60112 : 2003 Method for the determination of the proof and the comparative tracking indices of solid insulating materials	IS 2824 : 1975 Method for determining the comparative tracking index of solid insulating materials under moist conditions (<i>first revision</i>)	do
IEC 60255-8 : 1990 Electrical relays — Part 8: Thermal electrical relays	IS 3842 (Part 4) : 1966 Application guide for electrical relays for ac systems: Part 4 Thermal relays	do
IEC 60269-1 : 1998 Low-voltage fuses — Part 1: General requirements	IS 13703 (Part 1) : 1993 Low-voltage fuses for voltages not exceeding 1 000 V ac or 1 500 V dc: Part 1 General requirements	do

<i>International Standard</i>	<i>Corresponding Indian Standard</i>	<i>Degree of Equivalence</i>
IEC 60269-2 : 1986 Low-voltage fuses — Part 2: Supplementary requirements for fuses for use by authorized persons (fuses mainly for industrial application)	IS 13703 (Part 2/Sec 1) : 1993 Low-voltage fuses for voltages not exceeding 1 000 V ac or 1 500 V dc: Part 2 Fuses for use by authorized persons, Section 1 Supplementary requirements	Identical
IEC 60269-2-1 : 2004 Low-voltage fuses — Part 2-1: Supplementary requirements for fuses for use by authorized persons (fuses mainly for industrial application) — Sections I to V: Examples of types of standardized fuses	IS 13703 (Part 2/Sec 2) : 1993 Low-voltage fuses for voltages not exceeding 1 000 V ac or 1 500 V dc: Part 2 Fuses for use by authorized persons, Section 2 Examples of standardized fuses	Technically Equivalent
IEC 60410 : 1973 Sampling plans and procedures for inspection by attributes	IS 10673 : 1983 Sampling plans and procedures for inspection by attributes for electronic items	do
IEC 60947-1 : 2004 Low-voltage switchgear and controlgear — Part 1: General rules	IS/IEC 60947 (Part 1) : 2004 Low-voltage switchgear and controlgear: Part 1 General rules	Identical
IEC 60947-2 : 2003 Low-voltage switchgear and controlgear — Part 2: Circuit-breakers	IS/IEC 60947 (Part 2) : 2003 Low-voltage switchgear and controlgear: Part 2 Circuit-breakers	do
IEC 60947-3 : 1999 ¹⁾ Low-voltage switchgear and controlgear — Part 3: Switches, disconnectors, switch-disconnectors and fuse-combination units	IS/IEC 60947 (Part 3) : 2005 Low-voltage switchgear and controlgear: Part 3 Switches, disconnectors, switch-disconnectors and fuse-combination units	Technically Equivalent
IEC 60947-5-1 : 2003 Low-voltage switchgear and controlgear — Part 5: Control circuit devices and switching elements — Section 1: Electromechanical control circuit devices	IS/IEC 60947 (Part 5/Sec 1) : 2003 Low-voltage switchgear and controlgear: Part 5 Control circuit devices and switching elements, Section 1 Electromechanical control circuit devices	Identical
IEC 61000-4-2 : 1995 Electromagnetic compatibility (EMC) — Part 4: Testing and measurement techniques — Section 2: Electrostatic discharge immunity test	IS 14700 (Part 4/Sec 2) : 1999 Electromagnetic compatibility (EMC): Part 4 Testing and measurement techniques, Section 2 Electrostatic discharge immunity test	Technically Equivalent
IEC 61000-4-4 : 1995 Electromagnetic compatibility (EMC) — Part 4: Testing and measurement techniques — Section 4: Electrical fast transient/burst immunity test	IS 14700 (Part 4/Sec 4) : 1999 Electromagnetic compatibility (EMC): Part 4 Testing and measurement techniques, Section 4 Electrical fast transient/burst immunity test	do
CISPR 11 : 2003 Industrial, scientific and medical (ISM) radio-frequency equipment — Electromagnetic disturbance characteristics — Limits and methods of measurement	IS 6873 (Part 4) : 1999 Limits and methods of measurement of radio disturbance characteristics: Part 4 Industrial, scientific and medical (ISM) radio-frequency equipment (<i>first revision</i>)	do

¹⁾ Since revised in 2005.

IS/IEC 60947-4-1 : 2000

The technical committee responsible for the preparation of this standard has reviewed the provisions of the following International Standards referred in this adopted standard and has decided that they are acceptable for use in conjunction with this standard:

<i>International Standard</i>	<i>Title</i>
IEC 60034-11 : 2004	Rotating electrical machines — Part 11: Thermal protection
IEC 60085 : 2004	Electrical insulation — Thermal classification
IEC 61000-4-3 : 2002	Electromagnetic compatibility (EMC) — Part 4-3: Testing and measurement techniques — Radiated, radio-frequency electromagnetic field immunity test
IEC 61000-4-5 : 1995	Electromagnetic compatibility (EMC) — Part 4: Testing and measurement techniques — Section 5: Surge immunity test
IEC 61095 : 1992	Electromechanical contractors for household and similar purposes
IEC 61810-1 : 2003	Electromechanical elementary relays — Part 1: General and safety requirements

Amendment No. 2 to the above International Standard has been given at the end of this publication.

Only the English text of the International Standard has been retained while adopting it as an Indian Standard, and as such the page numbers given here are not the same as in the IEC Publication.

For the purpose of deciding whether a particular requirement of this standard is complied with, the final value, observed or calculated, expressing the result of a test or analysis, shall be rounded off in accordance with IS 2 : 1960 'Rules for rounding off numerical values (*revised*)'. The number of significant places retained in the rounded off value should be the same as that of the specified value in this standard.

*Indian Standard***LOW-VOLTAGE SWITCHGEAR AND CONTROLGEAR****PART 4 CONTACTORS AND MOTOR-STARTERS****Section 1 Electromechanical Contactors and Motor-Starters****1 Scope and object**

This part of IEC 60947 applies to the types of equipment listed in 1.1 and 1.2 whose main contacts are intended to be connected to circuits the rated voltage of which does not exceed 1 000 V a.c. or 1 500 V d.c.

Starters and/or contactors dealt with in this standard are not normally designed to interrupt short-circuit currents. Therefore, suitable short-circuit protection (see 9.3.4) shall form part of the installation but not necessarily of the contactor or the starter.

In this context, this standard gives requirements for:

- contactors associated with overload and/or short-circuit protective devices;
- starters associated with separate short-circuit protective devices and/or with separate short-circuit and integrated overload protective devices;
- contactors or starters combined, under specified conditions, with their own short-circuit protective devices. Such combinations, e.g. combination starters (see 3.2.7) or protected starters (see 3.2.8) are rated as units.

Circuit-breakers and fuse-combination units used as short-circuit protective devices in combination starters and in protected starters shall comply with the requirements of IEC 60947-2 and IEC 60947-3, as the case may be.

Equipment covered by this standard is as follows.

1.1 AC and d.c. contactors

AC and d.c. contactors intended for closing and opening electric circuits and, if combined with suitable relays (see 1.2), for protecting these circuits against operating overloads which may occur therein.

NOTE Contactors combined with suitable relays and which are intended to provide short-circuit protection shall additionally satisfy the relevant conditions specified for circuit-breakers (IEC 60947-2).

This standard applies also to the actuators of contactor relays and to the contacts dedicated exclusively to the coil circuit of a contactor.

Contactors or starters with an electronically controlled electromagnet are also covered by this standard.

1.2 AC motor-starters

AC motor-starters intended to start and accelerate motors to normal speed, to ensure continuous operation of motors, to switch off the supply from the motor and to provide means for the protection of motors and associated circuits against operating overloads.

Starters the operation of which depends on thermal electrical relays for motor protection complying with IEC 60255-8, or motor-incorporated thermal protective devices dealt with in IEC 60034-11 do not necessarily meet all the relevant requirements of this standard.

Overload relays for starters, including those based on solid state technology, shall meet the requirements of this standard.

1.2.1 Direct-on-line (full voltage) a.c. starters

Direct-on-line starters intended to start and accelerate a motor to normal speed, to provide means for the protection of the motor and its associated circuits against operating overloads, and to switch off the supply from the motor.

This standard applies also to reversing starters.

1.2.2 Reduced voltage a.c. starters

Reduced voltage a.c. starters intended to start and accelerate a motor to normal speed by connecting the line voltage across the motor terminals in more than one step or by gradually increasing the voltage applied to the terminals, to provide means for the protection of the motor and its associated circuits against operating overloads, and to switch off the supply from the motor.

Automatic change-over devices may be used to control the successive switching operations from one step to the others. Such automatic change-over devices are, for example, time-delay contactor relays or specified time all-or-nothing relays, under-current devices and automatic acceleration control devices (see 5.10).

1.2.2.1 Star-delta starters

Star-delta starters intended to start a three-phase motor in the star connection, to ensure continuous operation in the delta connection, to provide means for the protection of the motor and its associated circuits against operating overloads, and to switch off the supply from the motor.

The star-delta starters dealt with in this standard are not intended for reversing motors rapidly and, therefore, utilization category AC-4 does not apply.

NOTE In the star connection, the current in the line and the torque of the motor are about one-third of the corresponding values for delta connection. Therefore, star-delta starters are used when the inrush current due to the starting is to be limited, or when the driven machine requires a limited torque for starting. Figure 1 indicates typical curves of starting current, of starting torque of the motor and of torque of the driven machine.

1.2.2.2 Two-step auto-transformer starters

Two-step auto-transformer starters, intended to start and accelerate an a.c. induction motor from rest with reduced torque to normal speed and to provide means for the protection of the motor and its associated circuits against operating overloads, and to switch off the supply from the motor.

This standard applies to auto-transformers which are part of the starter or which constitute a unit specially designed to be associated with the starter.

Auto-transformer starters with more than two steps are not covered by this standard.

The auto-transformer starters dealt with in this standard are not intended for inching duty or reversing motors rapidly and, therefore, utilization category AC-4 does not apply.

NOTE In the starting position, the current in the line and the torque of the motor related to the motor starting with rated voltage are reduced approximately as the square of the ratio (starting voltage):(rated voltage). Therefore, auto-transformer starters are used when the inrush current due to the starting is to be limited or when the driven machine requires a limited torque for starting. Figure 2 indicates typical curves of starting current, of starting torque of the motor and of torque of the driven machine.

1.2.3 Rheostatic rotor starters

Starters intended to start an a.c. induction motor having a wound rotor by cutting out resistors previously inserted in the rotor circuit, to provide means for the protection of the motor against operating overloads and to switch off the supply from the motor.

In the case of asynchronous slip-ring motors (wound-rotors), the highest voltage between open slip-rings shall be not greater than twice the rated insulation voltage of the switching devices inserted in the rotor circuit (see 5.3.1.1.2).

NOTE This requirement is based on the fact that the electric stresses are less severe in the rotor than in the stator and are of short duration.

This standard applies also to starters for two directions of rotation when reversal of connections is made with the motor stopped (see 5.3.5.5). Operations including inching and plugging necessitate additional requirements and shall be subject to agreement between manufacturer and user.

This standard applies to resistors which are part of the starter or constitute a unit specially designed to be associated with the starter.

1.3 This standard does not apply to:

- d.c. starters;
- star-delta starters, rheostatic rotor starters, two-step auto-transformer starters intended for special applications and designed for continuous operation in the starting position;
- unbalanced rheostatic rotor starters, i.e. where the resistances do not have the same value in all phases;
- equipment designed not only for starting, but also for adjustment of speed;
- liquid starters and those of the "liquid-vapour" type;
- semiconductor contactors and starters making use of semiconductor contactors in the main circuit;
- rheostatic stator starters;
- contactors or starters designed for special applications;
- auxiliary contacts of contactors and contacts of contactor relays. These are dealt with in IEC 60947-5-1.

1.4 The object of this standard is to state:

- a) the characteristics of contactors and starters and associated equipment;
- b) the conditions with which contactors or starters shall comply with reference to:
 - 1) their operation and behaviour,
 - 2) their dielectric properties,
 - 3) the degrees of protection provided by their enclosures, where applicable,
 - 4) their construction;
- c) the tests intended for confirming that these conditions have been met, and the methods to be adopted for these tests;
- d) the information to be given with the equipment or in the manufacturer's literature.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60034-1:1996, *Rotating electrical machines – Part 1: Rating and performance*
Amendment 1 (1997)
Amendment 2 (1999)

IEC 60034-11:1978, *Rotating electrical machines – Part 11: Built-in thermal protection – Chapter 1: Rules for protection of rotating electrical machines*

IEC 60050(441):1984, *International Electrotechnical Vocabulary (IEV) – Chapter 441: Switchgear, controlgear and fuses*

IEC 60076-1:1993, *Power transformers – Part 1: General*
Amendment 1 (1999)

IEC 60085:1984, *Thermal evaluation and classification of electrical insulation*

IEC 60112:1979, *Method for determining the comparative and the proof tracking indices of solid insulating materials under moist conditions*

IEC 60255-8:1990, *Electrical relays – Part 8: Thermal electrical relays*

IEC 60269-1:1998, *Low-voltage fuses – Part 1: General requirements*

IEC 60269-2:1986, *Low-voltage fuses – Part 2: Supplementary requirements for fuses for use by authorized persons (fuses mainly for industrial application)*
Amendment 1 (1995)
Amendment 2 (2001)

IEC 60269-2-1:1998, *Low-voltage fuses – Part 2-1: Supplementary requirements for fuses for use by authorized persons (fuses mainly for industrial application) – Sections I to V: Examples of types of standardized fuses*
Amendment 1 (1999)
Amendment 2 (2002)

IEC 60410:1973, *Sampling plans and procedures for inspection by attributes*

IEC 60947-1:1999, *Low-voltage switchgear and controlgear – Part 1: General rules*
 Amendment 1 (2000)
 Amendment 2 (2001)

IEC 60947-2:1995, *Low-voltage switchgear and controlgear – Part 2: Circuit-breakers**
 Amendment 1 (1997)
 Amendment 2 (2001)

IEC 60947-3:1999, *Low-voltage switchgear and controlgear – Part 3: Switches, disconnectors, switch-disconnectors and fuse-combination units*
 Amendment 1 (2001)

IEC 60947-5-1:1997, *Low-voltage switchgear and controlgear – Part 5: Control circuit devices and switching elements – Section 1: Electromechanical control circuit devices***
 Amendment 1 (1999)
 Amendment 2 (1999)

IEC 61000-4-2:1995, *Electromagnetic compatibility (EMC) – Part 4: Testing and measurement techniques – Section 2: Electrostatic discharge immunity test – Basic EMC publication****
 Amendment 1 (1998)
 Amendment 2 (2000)

IEC 61000-4-3:1995, *Electromagnetic compatibility (EMC) – Part 4: Testing and measurement techniques – Section 3: Radiated radio-frequency electromagnetic field immunity test*****
 Amendment 1 (1998)
 Amendment 2 (2000)

IEC 61000-4-4:1995, *Electromagnetic compatibility (EMC) – Part 4: Testing and measurement techniques – Section 4: Electrical fast transient/burst immunity test – Basic EMC publication*
 Amendment 1 (2000)
 Amendment 2 (2001)

IEC 61000-4-5:1995, *Electromagnetic compatibility (EMC) – Part 4: Testing and measurement techniques – Section 5: Surge immunity test*
 Amendment 1 (2000)

IEC 61095:1992, *Electromechanical contactors for household and similar purposes*
 Amendment 1 (2000)

IEC 61810-1:1998, *Electromechanical all-or-nothing relays – Part 1: General requirements*

CISPR 11:1997, *Industrial, scientific and medical (ISM) radio-frequency equipment – Electromagnetic disturbance characteristics – Limits and methods of measurement*
 Amendment 1 (1999)

* There is a consolidated edition 2.1 (1998) that includes IEC 60947-2 (1995) and its amendment 1 (1997).

** There is a consolidated edition 2.1 (1999) that includes IEC 60947-5-1 (1997) and its amendment 1 (1999).

*** There is a consolidated edition 1.1 (1999) that includes IEC 61000-4-2 (1995) and its amendment 1 (1998).

**** There is a consolidated edition 1.1 (1998) that includes IEC 61000-4-3 (1995) and its amendment 1 (1998).

3 Definitions

For the purpose of this part of IEC 60947, the definitions of clause 2 of IEC 60947-1 together with the following additional definitions apply.

3.1 Definitions concerning contactors

3.1.1

contactor (mechanical)

mechanical switching device having only one position of rest, operated otherwise than by hand, capable of making, carrying and breaking currents under normal circuit conditions including operating overload conditions

NOTE Contactors may be designated according to the method by which the force for closing the main contacts is provided.

[IEV 441-14-33]

The followings notes are not included in IEV 441-14-33:

NOTE 1 The term "operated otherwise than by hand" means that the device is intended to be controlled and kept in working position from one or more external supplies.

NOTE 2 In French, a contactor the main contacts of which are closed in the position of rest is usually called a "rupteur". The word "rupteur" has no equivalent in the English language.

NOTE 3 A contactor is usually intended to operate frequently.

3.1.2

electromagnetic contactor

contactor in which the force for closing the normally open main contacts or opening the normally closed main contacts is provided by an electromagnet

NOTE The electromagnet may be electronically controlled (see 3.1.8).

3.1.3

pneumatic contactor

contactor in which the force for closing the normally open main contacts or opening the normally closed main contacts is provided by a device using compressed air, without the use of electrical means

3.1.4

electro-pneumatic contactor

contactor in which the force for closing the normally open main contacts or opening the normally closed main contacts is provided by a device using compressed air under the control of electrically operated valves

3.1.5

latched contactor

contactor, the moving elements of which are prevented by means of a latching arrangement from returning to the position of rest when the operating means are de-energized

NOTE 1 The latching, and the release of the latching, may be mechanical, electromagnetic, pneumatic, etc.

NOTE 2 Because of the latching, the latched contactor actually acquires a second position of rest and, according to the definition of a contactor, it is not, strictly speaking, a contactor. However, since the latched contactor in both its utilization and its design is more closely related to contactors in general than to any other classification of switching device, it is considered proper to require that it complies with the specifications for contactors wherever they are appropriate.

[IEV 441-14-34]

3.1.6

vacuum contactor (or starter)

contactor (or starter) in which the main contacts open and close within a highly evacuated envelope

3.1.7

position of rest (of a contactor)

position which the moving elements of the contactor take up when its electromagnet or its compressed-air device is not energized [IEV 441-16-24]

3.1.8

electronically controlled coil for electromagnet

coil controlled by a circuit with active electronic elements

3.2 Definitions concerning starters

3.2.1

starter

combination of all the switching means necessary to start and stop a motor in combination with suitable overload protection [IEV 441-14-38]

3.2.2

direct-on-line starter

starter which connects the line voltage across the motor terminals in one step [IEV 441-14-40]

3.2.3

reversing starter

starter intended to cause the motor to reverse the direction of rotation by reversing the motor primary connections while the motor may be running

3.2.4

two-direction starter

starter intended to cause the motor to reverse the direction of rotation by reversing the motor primary connections only when the motor is not running

3.2.5

reduced voltage starter

starter which connects the line voltage across the motor terminals in more than one step or by gradually increasing the voltage applied to the terminals

3.2.5.1

star-delta starter

starter for a three-phase induction motor such that in the starting position the stator windings are connected in star and in the final running position they are connected in delta [IEV 441-14-44]

3.2.5.2

auto-transformer starter

starter for an induction motor which uses for starting one or more reduced voltages derived from an auto-transformer [IEV 441-14-45]

NOTE (not included in IEC 441-14-45) An auto-transformer is defined as follows in 3.1.2 of IEC 60076-1:

"A transformer in which at least two windings have a common part."

3.2.6

rheostatic starter

starter utilizing one or several resistors for obtaining, during starting, stated motor torque characteristics and for limiting the current [IEV 441-14-42]

NOTE (not included in IEC 441-14-42) A rheostatic starter generally consists of three basic parts which may be supplied either as a composite unit or as separate units to be connected at the place of utilization:

- the mechanical switching devices for supplying the stator (generally associated with an overload protective device);
- the resistor(s) inserted in the stator or rotor circuit;
- the mechanical switching devices for cutting out the resistor(s) successively.

3.2.6.1

rheostatic stator starter

rheostatic starter for a squirrel cage motor which, during the starting period, cuts out successively one or several resistors previously provided in the stator circuit

3.2.6.2

rheostatic rotor starter

rheostatic starter for an asynchronous wound-rotor motor which, during the starting period, cuts out successively one or several resistors previously provided in the rotor circuit [IEV 441-14-43]

3.2.7

combination starter (see figure 3)

equipment consisting of a starter, a manual externally operated switching device and a short-circuit protective device, mounted and wired in a dedicated enclosure. The switching and short-circuit protective devices may be a fuse combination unit, a switch with fuses or a circuit-breaker with or without an isolating function

NOTE 1 A dedicated enclosure is an enclosure specifically designed and dimensioned for its application in which all tests are conducted.

NOTE 2 The manually operated switching device and the short-circuit protective device may be just one device and may incorporate the overload protection as well.

3.2.8

protected starter

equipment consisting of a starter, a manually operated switching device and a short-circuit protective device, mounted and wired, enclosed or unenclosed according to the instructions of the starter manufacturer

NOTE The manually operated switching device and the short-circuit protective device may be one single device and may incorporate the overload protection as well.

3.2.9

manual starter

starter in which the force for closing the main contacts is provided exclusively by manual energy [IEV 441-14-39]

3.2.10

electromagnetic starter

starter in which the force for closing the main contacts is provided by an electromagnet

3.2.11

motor-operated starter

starter in which the force for closing the main contacts is provided by an electric motor

3.2.12

pneumatic starter

starter in which the force for closing the main contacts is provided by using compressed air, without the use of electrical means

3.2.13

electro-pneumatic starter

starter in which the force for closing the main contacts is provided by using compressed air under the control of electrically operated valves

3.2.14

single-step starter

starter in which there is no intermediate accelerating position between the OFF and ON positions

NOTE This starter is a direct-on-line starter (see 3.2.2).

3.2.15

two-step starter

starter in which there is only one intermediate accelerating position between the OFF and ON positions

Example: A star-delta starter is a two-step starter.

3.2.16

***n*-step starter (see figure 4)**

starter in which there are (*n*-1) intermediate accelerating positions between the OFF and ON positions

Example: A three-step rheostatic starter has two sections of resistors used for starting.

[IEV 441-14-41]

3.2.17

phase loss sensitive thermal overload relay or release

multipole thermal overload relay or release which operates in the case of overload and also in case of loss of phase in accordance with specified requirements

3.2.18

under-current (under-voltage) relay or release

measuring relay or release which operates automatically when the current through it (or the voltage applied to it) is reduced below a pre-determined value

3.2.19

starting time (of a rheostatic starter)

period of time during which the starting resistors or parts of them carry current

3.2.20

starting time (of an auto-transformer starter)

period of time during which the auto-transformer carries current

NOTE to 3.2.19 and 3.2.20 The starting time of a starter is shorter than the total starting time of the motor which takes into account the last period of acceleration following the switching operation ON position.

3.2.21

open transition (with an auto-transformer starter or star-delta starter)

circuit arrangement such that the supply to the motor is interrupted and reconnected when changing over from one step to another

NOTE The transition stage is not considered an additional step.

3.2.22

closed transition (with an auto-transformer starter or star-delta starter)

circuit arrangement such that the supply to the motor is not interrupted (even momentarily) when changing over from one step to another

NOTE The transition stage is not considered an additional step.

3.2.23

inching (jogging)

energizing a motor or solenoid repeatedly for short periods to obtain small movements of the driven mechanism

3.2.24

plugging

stopping or reversing a motor rapidly by reversing the motor primary connections while the motor is running

3.3 Characteristic quantities

3.3.1 Transient recovery voltage (abbreviation: TRV) [IEV 441-17-26]

Subclause 2.5.34 of part 1 applies with the following addition.

NOTE 3 (not included in IEC 441-17-26) In a vacuum contactor or starter, the highest transient recovery voltage may occur on an other pole than the first pole to clear.

4 Classification

Subclause 5.2 gives all the data which may be used as criteria for classification.

5 Characteristics of contactors and starters

5.1 Summary of characteristics

The characteristics of a contactor or starter shall be stated in the following terms, where such terms are applicable:

- type of equipment (5.2);
- rated and limiting values for main circuits (5.3);
- utilization category (5.4);
- control circuits (5.5);

- auxiliary circuits (5.6);
- types and characteristics of relays and releases (5.7);
- co-ordination with short-circuit protective devices (5.8);
- switching overvoltages (5.9);
- types and characteristics of automatic change-over devices and automatic acceleration control devices (5.10);
- types and characteristics of auto-transformers for two-step auto-transformer starters (5.11);
- types and characteristics of starting resistors for rheostatic rotor starters (5.12).

5.2 Type of equipment

The following shall be stated (see also clause 6).

5.2.1 Kind of equipment

- contactor;
- direct-on-line a.c. starter;
- star-delta starter;
- two-step auto-transformer starter;
- rheostatic rotor starter;
- combination or protected starter.

5.2.2 Number of poles

5.2.3 Kind of current (a.c. or d.c.)

5.2.4 Interrupting medium (air, oil, gas, vacuum, etc.)

5.2.5 Operating conditions of the equipment

5.2.5.1 Method of operation

For example: manual, electromagnetic, motor-operated, pneumatic, electro-pneumatic.

5.2.5.2 Method of control

For example:

- automatic (by pilot switch or sequence control);
- non-automatic (such as by hand operation or by push-buttons);
- semi-automatic (i.e. partly automatic, partly non-automatic).

5.2.5.3 Method of change-over for particular types of starters

The change-over for star-delta starters, rheostatic rotor starters or auto-transformer starters may be automatic, non-automatic or semi-automatic (see figures 4 and 5).

5.2.5.4 Method of connecting for particular types of starters

For example: open transition starter, closed transition starter (see figure 5).

5.3 Rated and limiting values for main circuits

The rated values established for a contactor or starter shall be stated in accordance with subclauses 5.3.1 to 5.4, and 5.8 and 5.9, but it may not be necessary to specify all the values listed.

NOTE The rated values established for a rheostatic rotor starter are stated in accordance with 5.3.1.2, 5.3.2.3, 5.3.2.4, 5.3.2.6, 5.3.2.7 and 5.3.5.5 but it is not necessary to specify all the values listed.

5.3.1 Rated voltages

A contactor or starter is defined by the following rated voltages.

5.3.1.1 Rated operational voltage (U_e)

Subclause 4.3.1.1 of part 1 applies.

5.3.1.1.1 Rated stator operational voltage (U_{es})

For rheostatic rotor starters, a rated stator operational voltage is a value of voltage which, when combined with a rated stator operational current, determines the application of the stator circuit including its mechanical switching devices and to which are referred the making and breaking capacities, the type of duty and the starting characteristics. In no case shall the maximum rated operational voltage exceed the corresponding rated insulation voltage.

NOTE The rated stator operational voltage is expressed as the voltage between phases.

5.3.1.1.2 Rated rotor operational voltage (U_{er})

For rheostatic rotor starters, the value of rated operational voltage is that of the voltage which, when combined with a rated rotor operational current, determines the application of the rotor circuit including its mechanical switching devices and to which are referred the making and breaking capacities, the type of duty and the starting characteristics.

This voltage is taken as equal to the voltage measured between slip-rings, with the motor stopped and the rotor open-circuited, when the stator is supplied at its rated voltage.

The rated rotor operational voltage is only applied for a short duration during the starting period. For this reason, it is permissible that the rated rotor operational voltage exceed the rated rotor insulation voltage by 100 %.

The maximum voltage between the different live parts (e.g. switching devices, resistors, connecting parts, etc.) of the rotor circuit of the starter will vary and account may be taken of this fact in choosing the equipment and its disposition.

5.3.1.2 Rated insulation voltage (U_i)

Subclause 4.3.1.2 of part 1 applies.

5.3.1.2.1 Rated stator insulation voltage (U_{is})

For rheostatic rotor starters, the rated stator insulation voltage is the value of voltage which is designated for the devices inserted in the stator supply as well as the unit they are part of, and to which dielectric tests and creepage distances are referred.

Unless otherwise stated, the rated stator insulation voltage is the value of the maximum rated stator operational voltage of the starter

5.3.1.2.2 Rated rotor insulation voltage (U_{ir})

For rheostatic rotor starters, the rated rotor insulation voltage is the value of voltage which is designated to the devices inserted in the rotor circuit as well as the unit they are part of (connecting links, resistors, enclosure), and to which dielectric tests and creepage distances are referred.

5.3.1.3 Rated impulse withstand voltage (U_{imp})

Subclause 4.3.1.3 of part 1 applies.

5.3.1.4 Rated starting voltage of an auto-transformer starter

The rated starting voltage of an auto-transformer starter is the reduced voltage derived from the transformer.

Preferred values of rated starting voltage are 50 %, 65 % or 80 % of the rated operational voltage.

5.3.2 Currents or powers

A contactor or a starter is defined by the following currents.

NOTE In the case of a star-delta starter, these currents relate to the delta connection and, in the case of a two-step auto-transformer or rheostatic rotor starter, to the ON position.

5.3.2.1 Conventional free air thermal current (I_{th})

Subclause 4.3.2.1 of part 1 applies.

5.3.2.2 Conventional enclosed thermal current (I_{the})

Subclause 4.3.2.2 of part 1 applies.

5.3.2.3 Conventional stator thermal current (I_{ths})

The conventional stator thermal current of a starter may be either free air current I_{ths} or enclosed current I_{thes} , in line with 5.3.2.1 and 5.3.2.2.

For a rheostatic rotor starter, the stator thermal current is the maximum current it can carry on eight-hour duty (see 5.3.4.1) without the temperature rise of its several parts exceeding the limits specified in 8.2.2 when tested in accordance with 9.3.3.3.

5.3.2.4 Conventional rotor thermal current (I_{thr})

The conventional rotor thermal current of a starter may be either free air current I_{thr} or enclosed current I_{ther} , in line with 5.3.2.1 and 5.3.2.2.

For rheostatic rotor starters, the rotor thermal current is the maximum current that those parts of the starter through which the rotor current flows in the ON position, viz. after cutting out resistors, can carry on eight-hour duty (see 5.3.4.1) without their temperature rise exceeding the limits specified in 8.2.2 when tested in accordance with 9.3.3.3.

NOTE 1 For those elements (switching devices, connecting links, resistors) through which a current of practically no value flows in the ON position, it should be verified that, for the rated duties (see 5.3.4) stated by the manufacturer, the value of integral

$$\int_0^t i^2 dt$$

does not lead to temperature rises higher than those appearing in 8.2.2.

NOTE 2 When resistors are built-in into the starter, the temperature rise should be taken into account.

5.3.2.5 Rated operational currents (I_e) or rated operational powers

A rated operational current of a contactor or a starter is stated by the manufacturer and takes into account the rated operational voltage (see 5.3.1.1), the conventional free air or enclosed thermal current, the rated current of the overload relay, the rated frequency (see 5.3.3), the rated duty (see 5.3.4), the utilization category (see 5.4) and the type of protective enclosure, if any.

In the case of equipment for direct switching of individual motors, the indication of a rated operational current may be replaced or supplemented by an indication of the maximum rated power output, at the rated operational voltage considered, of the motor for which the equipment is intended. The manufacturer shall be prepared to state the relationship assumed between the current and the power.

For starters, the rated operational current (I_e) is the current in the ON position of the starter.

5.3.2.6 Rated stator operational current (I_{es}) or rated stator operational power

For rheostatic rotor starters, a rated stator operational current is stated by the manufacturer and takes into account the rated current of the overload relay installed in this starter, the rated stator operational voltage (see 5.3.1.1.1), the conventional free air or enclosed thermal current, the rated frequency (see 5.3.3), the rated duty (see 5.3.4), the starting characteristics (see 5.3.5.5) and the type of protective enclosure.

The indication of a rated stator operational current may be replaced by the indication of the maximum rated power output, at the rated stator operational voltage considered, of the motor for which the stator elements of the starter are intended. The manufacturer shall be prepared to state the relationship assumed between the motor power and the stator current.

5.3.2.7 Rated rotor operational current (I_{er})

For rheostatic rotor starters, a rated rotor operational current is stated by the manufacturer and takes into account the rated rotor operational voltage (see 5.3.1.1.2), the conventional free air or enclosed rotor thermal current, the rated frequency (see 5.3.3), the rated duty (see 5.3.4), the starting characteristics (see 5.3.5.5) and the type of protective enclosure.

It is taken as equal to the current flowing in the connections to the rotor when the latter is short-circuited and the motor is running at full load and the stator is supplied at its rated voltage and rated frequency.

When the rotor part of a rheostatic rotor starter is rated separately, the indication of a rated rotor operational current may be supplemented by the maximum rated power output, for motors having the rated rotor operational voltage considered, of the motor for which that part of the starter (switching devices, connecting links, relays, resistors) is intended. This power varies in particular with the breakaway torque foreseen and consequently takes into account the starting characteristics (see 5.3.5.5).

5.3.2.8 Rated uninterrupted current (I_u)

Subclause 4.3.2.4 of part 1 applies.

5.3.3 Rated frequency

Subclause 4.3.3 of part 1 applies.

5.3.4 Rated duties

Subclause 4.3.4 of part 1 applies.

5.3.4.1 Eight-hour duty (continuous duty)

Subclause 4.3.4.1 of part 1 applies with the following addition.

For a star-delta starter, a two-step auto-transformer starter or a rheostatic rotor-starter, the continuous duty is the duty in which the starter is in the ON position and the main contacts of the switching devices which constitute it, which are closed in this position, remain closed while each of them carries a steady current long enough for the starter to reach thermal equilibrium, but not for more than 8 h without interruption.

5.3.4.2 Uninterrupted duty

Subclause 4.3.4.2 of part 1 applies with the following addition.

For a star-delta starter, a two-step auto-transformer starter or a rheostatic rotor starter, the uninterrupted duty is the duty in which the starter is in the ON position and the main contacts of the switching devices which constitute it, which are closed in this position, remain closed without interruption while each of them carries a steady current for periods of more than 8 h (weeks, months or even years).

5.3.4.3 Intermittent periodic duty or intermittent duty

Subclause 4.3.4.3 of part 1 applies with the following addition.

For a reduced voltage starter, the intermittent duty is the duty in which the starter is in the ON position and the main contacts of the switching devices which constitute it remain closed for periods bearing a definite relation to the no-load periods, both periods being too short to allow the starter to reach thermal equilibrium.

Preferred classes of intermittent duty are:

- for contactors: 1, 3, 12, 30, 120, 300 and 1 200 (operating cycles per hour);
- for starters: 1, 3, 12 and 30 (operating cycles per hour).

It is recalled that an operating cycle is a complete working cycle comprising one closing operation and one opening operation.

For starters, an operating cycle comprises starting, running to full speed and switching off the supply from the motor.

NOTE In the case of starters for intermittent duty, the difference between the thermal time-constant of the overload relay and that of the motor may render a thermal relay unsuited for overload protection. It is recommended that, for installations intended for intermittent duty, the question of overload protection be subject to agreement between manufacturer and user.

5.3.4.4 Temporary duty

Subclause 4.3.4.4 of part 1 applies.

5.3.4.5 Periodic duty

Subclause 4.3.4.5 of part 1 applies.

5.3.5 Normal load and overload characteristics

Subclause 4.3.5 of part 1 applies with the following additions.

5.3.5.1 Ability to withstand motor switching overload currents

Requirements to meet these conditions are given for contactors in 8.2.4.4.

5.3.5.2 Rated making capacity

Requirements for the various utilization categories (see 5.4) are given in 8.2.4.1. The rated making and breaking capacities are only valid when the contactor or the starter is operated in accordance with the requirements of 8.2.1.1 and 8.2.1.2.

5.3.5.3 Rated breaking capacity

Requirements for the various utilization categories (see 5.4) are given in 8.2.4.1. The rated making and breaking capacities are only valid when the contactor or the starter is operated in accordance with the requirements of 8.2.1.1 and 8.2.1.2.

5.3.5.4 Conventional operational performance

This performance is specified as a series of making and breaking operations in 8.2.4.2.

5.3.5.5 Starting and stopping characteristics of starters (see figure 6)

Typical service conditions for starters are:

- a) one direction of rotation with the motor being switched off during running in normal service conditions (utilization categories AC-2 and AC-3);
- b) two directions of rotation, but the running in the second direction is realized after the starter has been switched off and the motor has completely stopped (utilization categories AC-2 and AC-3);
- c) one direction of rotation, or two directions of rotation as in item b), but with the possibility of infrequent inching (jogging). For this service condition, direct-on-line starters are usually employed (utilization category AC-3);
- d) one direction of rotation with frequent inching (jogging). Usually direct-on-line starters (utilization category AC-4) are used for this duty;
- e) one or two directions of rotation, but with the possibility of infrequent plugging for stopping the motor, plugging being associated, if so provided, with rotor resistor braking (reversing starter with braking). Usually a rheostatic rotor starter is used for this duty condition (utilization category AC-2);
- f) two directions of rotation, but with the possibility of reversing the supply connections to the motor while it is running in the first direction (plugging), in order to obtain its rotation in the other direction, with switching off the motor running in normal service conditions. Usually a direct-on-line reversing starter is used for this duty condition (utilization category AC-4).

Unless otherwise stated, starters are designed on the basis of the starting characteristics of the motors compatible with the making capacities of table 7. These making capacities cover both the transient and steady-state starting currents of the great majority of standard motors. However, the starting currents for some large motors may attain peak values corresponding to power factors considerably lower than those specified for the test circuit in table 7. In these cases, the operational current of the contactor or starter should be decreased to a value lower than its rated value such that the making capacity of the contactor or starter is not exceeded.

5.3.5.5.1 Starting characteristics of rheostatic rotor starters

A distinction shall be drawn between the currents and voltages in the stator and rotor circuits of slip-ring motors. However, the changes of the current values in stator and rotor circuits, caused by the various steps of the starting process, are nearly proportional under normal operating conditions.

The following definitions deal mainly with the characteristics of the rotor circuit:

U_{er} = rated rotor operational voltage;

I_{er} = rated rotor operational current;

Z_r = characteristic impedance of the rotor of an a.c. slip-ring induction motor;

where

$$Z_r = \frac{U_{er}}{\sqrt{3} \cdot I_{er}};$$

I_1 is the current in the rotor circuit immediately before shorting out a resistor section;

I_2 is the current in the rotor circuit immediately after shorting out a resistor section;

$I_m = 1/2 (I_1 + I_2)$;

T_e is the rated motor operational torque;

t_s is the starting time (see 3.2.19);

k is the severity of start = $\frac{I_m}{I_{er}}$.

It is recognized that many rheostatic rotor starter applications have very specific starting requirements which may result not only in a different number of starting steps and different values of I_1 and I_2 , but also in the values of I_1 and I_2 being different for individual resistor sections. Therefore, no attempt has been made to lay down standard parameters, but the following factors should be taken into consideration:

- for most applications, between two and six starting steps are adequate depending upon load torque, inertia and the severity of start required;
- the resistor sections should be designed to have adequate thermal ratings bearing in mind the starting time of the drive, which will be dependent upon load torque and load inertia.

5.3.5.5.2 Standard conditions for making and breaking corresponding to the starting characteristics for rheostatic rotor starters

These conditions are given in table 7 and apply to starting with high torque. (For the designation of the mechanical switching devices, see figure 4.)

NOTE Conditions for starting with full torque and half torque are under consideration.

The conditions for making and breaking as given in table 7 for AC-2 utilization category are considered as standard.

The starter circuit shall be designed to open all rotor resistor switching devices before or approximately simultaneously with the opening of the stator switching device. Otherwise, the stator switching device shall comply with AC-3 requirements.

5.3.5.5.3 Starting characteristics for two-step auto-transformer starters

Unless otherwise stated, the auto-transformer starters and specifically the auto-transformers are designed on the condition that the starting time (see 3.2.20) for all classes of duty (see 5.3.4) shall not exceed 15 s. The number of starting cycles per hour assumes equal periods between starts except that, in the event of two operating cycles being made in rapid succession, the starter and the auto-transformer shall be allowed to cool to ambient air temperature before a further start is made.

When a starting time in excess of 15 s is required, this shall be the subject of agreement between manufacturer and user.

5.3.6 Rated conditional short-circuit current

Subclause 4.3.6.4 of part 1 applies.

5.4 Utilization category

Subclause 4.4 of part 1 applies with the following additions.

For contactors and starters, the utilization categories as given in table 1 are considered standard. Any other type of utilization shall be based on agreement between manufacturer and user, but information given in the manufacturer's catalogue or tender may constitute such an agreement.

Each utilization category is characterized by the values of the currents, voltages, power-factors or time-constants and other data of tables 7 and 8, and by the test conditions specified in this standard.

For contactors or starters defined by their utilization category, it is therefore unnecessary to specify separately the rated making and breaking capacities as these values depend directly on the utilization category as shown in table 7.

The voltage for all utilization categories is the rated operational voltage of a contactor or a starter other than a rheostatic rotor starter, and the rated stator operational voltage for a rheostatic rotor starter.

All direct-on-line starters belong to one or more of the following utilization categories: AC-3, AC-4, AC-7b, AC-8a and AC-8b.

All star-delta and two-step auto-transformer starters belong to utilization category AC-3.

Rheostatic rotor starters belong to utilization category AC-2.

5.4.1 Assignment of utilization categories based on the results of tests

- a) A contactor or starter which has been tested for one utilization category or at any combination of parameters (such as highest operational voltage and current, etc.) can be assigned other utilization categories without testing provided that the test currents, voltages, power-factors or time-constants, number of operating cycles, on and off times given in tables 7 and 8, and the test circuit for the assigned utilization categories are not more severe than those at which the contactor or starter has been tested and the temperature rise has been verified at a current not less than the highest assigned rated operational current in continuous duty.

For example, when tested for utilization category AC-4, a contactor may be assigned utilization category AC-3 provided I_e for AC-3 is not higher than $1,2 I_e$ for AC-4 at the same rated operational voltage.

- b) DC-3 and DC-5 contactors are assumed to be capable of opening and closing loads other than those on which they have been tested provided that:
- the voltage and current do not exceed the specified values of U_e and I_e ;
 - the energy J stored in the actual load is equal to or less than the energy J_c stored in the load with which they were tested.

The values of the energy stored in the test circuit are as follows:

Utilization category	Stored energy J_c
DC-3	$0,00525 \times U_e \times I_e$
DC-5	$0,0315 \times U_e \times I_e$

The values of the constants 0,00525 and 0,0315 are derived from:

$$J_c = 1/2 L I^2$$

where the time-constant has been replaced by:

$2,5 \times 10^{-3} \text{ s}$ (DC-3) and:

$15 \times 10^{-3} \text{ s}$ (DC-5)

and where $U = 1,05 U_e$, $I = 4 I_e$ and L is the inductance of the test circuit.

(See table 7 of this standard.)

Table 1 – Utilization categories

Kind of current	Utilization categories	Typical applications
AC	AC-1	Non-inductive or slightly inductive loads, resistance furnaces
	AC-2	Slip-ring motors: starting, switching off
	AC-3	Squirrel-cage motors: starting, switching off motors during running ¹⁾
	AC-4	Squirrel-cage motors: starting, plugging, inching
	AC-5a	Switching of electric discharge lamp controls
	AC-5b	Switching of incandescent lamps
	AC-6a	Switching of transformers
	AC-6b	Switching of capacitor banks
	AC-7a ³⁾	Slightly inductive loads in household appliances and similar applications
	AC-7b ³⁾	Motor-loads for household applications
DC	AC-8a	Hermetic refrigerant compressor motor ²⁾ control with manual resetting of overload releases
	AC-8b	Hermetic refrigerant compressor motor ²⁾ control with automatic resetting of overload releases
	DC-1	Non-inductive or slightly inductive loads, resistance furnaces
	DC-3	Shunt-motors: starting, plugging, inching Dynamic breaking of d.c. motors
	DC-5	Series-motors: starting, plugging, inching Dynamic breaking of d.c. motors
	DC-6	Switching of incandescent lamps
¹⁾ AC-3 category may be used for occasional inching (jogging) or plugging for limited time periods such as machine set-up; during such limited time periods, the number of such operations should not exceed five per minute or more than ten in a 10-min period. ²⁾ A hermetic refrigerant compressor motor is a combination consisting of a compressor and a motor, both of which are enclosed in the same housing, with no external shaft or shaft seals, the motor operating in the refrigerant. ³⁾ For AC-7a and AC-7b, see IEC 61095.		

5.5 Control circuits

Subclause 4.5 of IEC 60947-1 applies; moreover, for an electronically controlled electromagnet, 4.5.1 of IEC 60947-1 applies with the following addition.

The electronic part may form an integral part or a separate part provided it is an intrinsic function of the device. In both cases, the device shall be tested with this electronic part mounted as in normal use.

The characteristics of electronic control circuits are as follows:

- type of current;
- power consumption;
- rated frequency (or d.c.);
- rated control circuit voltage, U_c (nature: a.c./d.c.);
- rated control supply voltage, U_s (nature: a.c./d.c.);
- nature of external control circuit devices (contacts, sensors, optocouplers, electronic active components, etc).

Annex E gives examples and illustrations of different circuit configurations.

NOTE A distinction is made between the control circuit voltage U_c , which is the controlling input signal, and the control supply voltage U_s , which is the voltage applied to energize the power supply terminals of the control circuit equipment and may be different from U_c due to the presence of built-in transformers, rectifiers, resistors, electronic circuitry, etc.

5.6 Auxiliary circuits

Subclause 4.6 of part 1 applies.

5.7 Characteristics of relays and releases (overload relays)

NOTE In the remainder of this standard, the words "overload relay" will be taken to apply equally to an overload relay or an overload release, as appropriate.

5.7.1 Summary of characteristics

The characteristics of relays and releases shall be stated in the following terms, whenever applicable:

- types of relay or release (see 5.7.2);
- characteristic values (see 5.7.3);
- designation and current settings of overload relays (see 5.7.4);
- time-current characteristics of overload relays (see 5.7.5);
- influence of ambient air temperature (see 5.7.6).

5.7.2 Types of relay or release

- a) Release with shunt coil (shunt trip).
- b) Under-voltage and under-current opening relay or release.
- c) Overload time-delay relay the time-lag of which is:

- 1) substantially independent of previous load (e.g. time-delay magnetic overload relay);
 - 2) dependent on previous load (e.g. thermal overload relay);
 - 3) dependent on previous load (e.g. thermal overload relay) and also sensitive to phase loss (see 3.2.17).
- d) Instantaneous over-current relay or release (when applicable).
- e) Other relays or releases (e.g. phase loss sensitive relay, control relay associated with devices for the thermal protection of the starter).

NOTE Types referred to in items d) and e) require consultation between manufacturer and user according to the particular application.

5.7.3 Characteristic values

- a) Release with shunt coil, under-voltage (under-current) opening relay or release:
- rated voltage (current);
 - rated frequency;
 - operating voltage (current).
- b) Overload relay:
- designation and current settings (see 5.7.4);
 - rated frequency, when necessary (for example in the case of a current transformer operated overload relay);
 - time-current characteristics (or range of characteristics), when necessary;
 - trip class according to classification in table 2, or the value of the maximum tripping time, in seconds, under the conditions specified in 8.2.1.5.1, table 3, column D, when this time exceeds 30 s;
 - number of poles;
 - nature of the relay: thermal, magnetic or solid state.

Table 2 – Trip classes of thermal, time-delay magnetic or solid state overload relays

Trip class	Tripping time T_p under the conditions specified in 8.2.1.5.1, table 3, column D s
10A	$2 < T_p \leq 10$
10	$4 < T_p \leq 10$
20	$6 < T_p \leq 20$
30	$9 < T_p \leq 30$

NOTE 1 Depending on the nature of the relay, the tripping conditions are given in 8.2.1.5.

NOTE 2 In the case of a rheostatic rotor starter, the overload relay is commonly inserted in the stator circuit. As a result, it cannot efficiently protect the rotor circuit and more particularly the resistors (generally more easily damageable than the rotor itself or the switching devices in case of a faulty start); protection of the rotor circuit should be the subject of a specific agreement between manufacturer and user (see, inter alia, 8.2.1.1.3).

NOTE 3 In the case of a two-step auto-transformer starter, the starting auto-transformer is normally designed for use during the starting period only: as a result, it cannot be efficiently protected by the overload relay in the event of faulty starting. Protection of the auto-transformer should be the subject of specific agreement between manufacturer and user (see 8.2.1.1.4).

NOTE 4 The lower limiting values of T_p are selected to allow for differing heater characteristics and manufacturing tolerances.

5.7.4 Designation and current settings of overload relays

Overload relays are designated by their current setting (or the upper and lower limits of the current setting range, if adjustable) and their trip class.

The current setting (or current setting range) shall be marked on the relays.

However, if the current setting is influenced by the conditions of use or other factors which cannot readily be marked on the relay, then the relay or any interchangeable parts thereof (e.g. heaters, operating coils or current transformers) shall carry a number or an identifying mark which makes it possible to obtain the relevant information from the manufacturer or his catalogue or, preferably, from data furnished with the starter.

In the case of current transformer operated overload relays, the marking may refer either to the primary current of the current transformer through which they are supplied or to the current setting of the overload relays. In either case, the ratio of the current transformer shall be stated.

5.7.5 Time-current characteristics of overload relays

Typical time-current characteristics shall be given in the form of curves supplied by the manufacturer. These curves shall indicate how the tripping time, starting from the cold state (see 5.7.6), varies with the current up to a value of at least eight times the full-load current of the motor with which it is intended that the relay be used. The manufacturer shall be prepared to indicate, by suitable means, the general tolerances applicable to these curves and the conductor cross-sections used for establishing these curves (see 9.3.3.2.2, item c)).

NOTE It is recommended that the current be plotted as abscissae and the time as ordinates, using logarithmic scales. It is recommended that the current be plotted as multiples of the setting current and the time in seconds on the standard graph sheet detailed in 5.6.1 of IEC 60269-1, in IEC 60269-2 (figure 1) and in figures 4(I), 3(II) and 4(II) of IEC 60269-2-1.

5.7.6 Influence of ambient air temperature

The time-current characteristics (see 5.7.5) refer to a stated value of ambient air temperature, and are based on no previous loading of the overload relay (viz. from an initial cold state). This value of the ambient air temperature shall be clearly given on the time curves; the preferred values are +20 °C or +40 °C.

The overload relays shall be able to operate within the ambient air temperature range of -5 °C to +40 °C, and the manufacturer shall be prepared to state the effect of variation in ambient air temperature on the characteristics of overload relays.

5.8 Co-ordination with short-circuit protective devices

The co-ordination of contactors and starters is characterized by the type, ratings and characteristics of the short-circuit protective devices (SCPD) that provide protection of the contactor and starter against short-circuit currents. Requirements are given in 8.2.5.1 and 8.2.5.2 of this standard, and in 4.8 of IEC 60947-1.

5.9 Switching overvoltages

Subclause 4.9 of part 1 applies.

Requirements are given in 8.2.6.

5.10 Types and characteristics of automatic change-over devices and automatic acceleration control devices

5.10.1 Types

- a) Time-delay devices, e.g. time-delay contactor relays (see IEC 60947-5-1) applicable to control-circuit devices or specified-time all-or-nothing relays (see IEC 61810-1).
- b) Undercurrent devices (undercurrent relays).
- c) Other devices for automatic acceleration control:
 - devices dependent on voltage;
 - devices dependent on power;
 - devices dependent on speed.

5.10.2 Characteristics

- a) The characteristics of time-delay devices are:
 - the rated time-delay or its range, if adjustable;
 - for time-delay devices fitted with a coil, the rated voltage, when it differs from the starter line voltage.
- b) The characteristics of the undercurrent devices are:
 - the rated current (thermal current and/or rated short-time withstand current, according to the indications given by the manufacturer);
 - the current setting or its range, if adjustable.
- c) The characteristics of the other devices shall be determined by agreement between manufacturer and user.

5.11 Types and characteristics of auto-transformers for two-step auto-transformer starters

Account being taken of the starting characteristics (see 5.3.5.5.3), starting auto-transformers shall be characterized by:

- the rated voltage of the auto-transformer;
- the number of taps available for adjusting the starting torque and current;
- the starting voltage, i.e. the voltage at the tapping terminals, as a percentage of the rated voltage of the auto-transformer;
- the current they can carry for a specified duration;
- the rated duty (see 5.3.4);
- the method of cooling

{	air-cooling; oil-cooling.
---	------------------------------

The auto-transformer can be:

- either built-in into the starter, in which case the resulting temperature rise has to be taken into account in determining the ratings of the starter;
- or provided separately, in which case the nature and dimensions of the connecting links have to be specified by agreement between the manufacturer of the transformer and the manufacturer of the starter.

5.12 Types and characteristics of starting resistors for rheostatic rotor starters

Account being taken of the starting characteristics (see 5.3.5.5.1), the starting resistors shall be characterized by:

- the rated rotor insulation voltage (U_{ir});
- their resistance value;
- the mean thermal current, defined by the value of steady current they can carry for a specified duration;
- the rated duty (see 5.3.4);
- the method of cooling

{	free air;
	forced air;
	oil-immersion.

They can be:

- either built-in into the starter, in which case the resulting temperature rise has to be limited in order not to cause any damage to the other parts of the starter;
- or provided separately, in which case the nature and dimensions of the connecting links have to be specified by agreement between the manufacturer of the resistors and the manufacturer of the starter.

6 Product information

6.1 Nature of information

The following information shall be given by the manufacturer.

6.1.1 Identification

- a) manufacturer's name or trade mark;
- b) type designation or serial number;
- c) number of this standard, if the manufacturer claims compliance.

6.1.2 Characteristics, basic rated values and utilization

Characteristics:

- d) rated operational voltages (see 5.3.1.1);
- e) utilization category and rated operational currents (or rated powers), at the rated operational voltages of the equipment (see 5.3.2.5 and 5.4);
- f) either the value of the rated frequency/frequencies, e.g. 50 Hz or 50 Hz/60 Hz, or the indication "d.c." (or the symbol \equiv);
- g) rated duty with the indication of the class of intermittent duty, if any (see 5.3.4).

Associated values:

- h) rated making and breaking capacities. These indications may be replaced, where applicable, by the indication of the utilization category (see table 7).

Safety and installation:

- i) rated insulation voltage (see 5.3.1.2);
- j) rated impulse withstand voltage (see 5.3.1.3);

- k) IP code, in case of an enclosed equipment (see 8.1.11);
- l) pollution degree (see 7.1.3.2);
- m) rated conditional short-circuit current (see 5.3.6) and type of co-ordination of the contactor or starter (see 8.2.5.1) and the type, current rating and characteristics of the associated SCPD;
rated conditional short-circuit current (see 5.3.6) of the combination starter or protected starter and type of co-ordination (see 8.2.5.1);
- n) switching overvoltages (see 5.9).

Control circuits:

The following information concerning control circuits shall be placed either on the coil or on the equipment:

- o) rated control circuit voltage (U_c), nature of current and rated frequency;
- p) if necessary, nature of current, rated frequency and rated control supply voltage (U_s).

Air supply systems for starters or contactors operated by compressed air:

- q) rated supply pressure of the compressed air and limits of variation of this pressure, if they are different from those specified in 8.2.1.2.

Auxiliary circuits:

- r) ratings of auxiliary circuits (see 5.6).

Overload relays and releases:

- s) characteristics according to 5.7.

Additional information for certain types of contactor and starter:

Rheostatic rotor starters:

- t) circuit diagram;
- u) severity of start (see 5.3.5.5.1);
- v) starting time (see 5.3.5.5.1).

Auto-transformer starters:

- w) rated starting voltage(s), i.e. voltage(s) at the tapping terminals.

NOTE This value may be expressed as a percentage of the rated operational voltage of the starter.

Vacuum contactors and starters:

- x) maximum permissible altitude of the site of installation, if less than 2 000 m.

EMC:

- y) environment A or B: see 7.3.1 of IEC 60947-1;
- z) special requirements, if applicable, for example shielded or twisted conductors.

NOTE Unshielded or untwisted conductors are considered as normal installation conditions.

6.2 Marking

Subclause 5.2 of part 1 applies to contactors, starters and overload relays with the following additions.

Data under items d) to x) in 6.1.2 shall be included on the nameplate or on the equipment or in the manufacturer's published literature.

Data under items c) and k) in 6.1.2 shall preferably be marked on the equipment.

In the case of electronically controlled electromagnets, information other than that given in o) and p) of 6.1.2 may also be necessary; see also 5.5 and annex E.

6.3 Instructions for installation, operation and maintenance

Subclause 5.3 of part 1 applies with the following addition.

Information shall be provided by the manufacturer to advise the user on the measures to be taken with regard to the equipment in the event of a short-circuit and the measures to be taken with regard to the equipment, if any, concerning EMC.

In the case of protected starters (see 3.2.8), the manufacturer shall also provide the necessary mounting and wiring instructions.

7 Normal service, mounting and transport conditions

Clause 6 of part 1 applies with the following additions.

7.1.3.2 Degrees of pollution

Unless otherwise stated by the manufacturer, a contactor or a starter is for use in pollution degree 3 environmental conditions, as defined in 6.1.3.2 of part 1. However, other pollution degrees may be considered to apply, depending upon the micro-environment.

8 Constructional and performance requirements

8.1 Constructional requirements

NOTE Further requirements concerning materials and current-carrying parts are under consideration for subclauses 7.1.1 and 7.1.2 of part 1. Their application to this standard will be subject to further consideration.

8.1.1 Materials

Subclause 7.1.1 of part 1 applies (see note to 8.1).

8.1.2 Current-carrying parts and their connections

Subclause 7.1.2 of part 1 applies (see note to 8.1).

8.1.3 Clearances and creepage distances

Subclause 7.1.3 of IEC 60947-1 applies.

8.1.4 Actuator

Subclause 7.1.4 of part 1 applies when the actuator is manually operated with the following addition.

The operating handle of the manually operated switching device of a combination starter shall be provided with means for padlocking it in the OFF position.

8.1.4.3 Mounting

Actuators mounted on removable panels or opening doors shall be so designed that, when the panels are replaced or the doors closed, the actuator will engage correctly with the associated mechanism.

8.1.5 Indication of the contact position

8.1.5.1 Indicating means

Subclause 7.1.5.1 of part 1 applies to manually operated starters.

8.1.5.2 Indication by the actuator

Subclause 7.1.5.2 of part 1 applies.

8.1.6 Additional safety requirements for equipment with isolating function

Subclause 7.1.6 of IEC 60947-1 applies with the addition of the following paragraphs to subclause 7.1.6.1 of that standard.

Devices provided with positions like trip position or stand-by position which are not the indicated open position shall be clearly marked.

An actuator having only one position of rest shall not be considered as appropriate to indicate the position of the main contact.

8.1.7 Terminals

Subclause 7.1.7 of part 1 applies with, however, the following additional requirement.

8.1.7.4 Terminal identification and marking

Subclause 7.1.7.4 of part 1 applies with additional requirements as given in annex A.

8.1.8 Additional requirements for contactors or starters provided with a neutral pole

Subclause 7.1.8 of part 1 applies.

8.1.9 Provisions for earthing

Subclause 7.1.9 of part 1 applies.

8.1.10 Enclosures for equipment

Subclause 7.1.10 of part 1 applies with the following additions.

Starting resistors mounted within an enclosure shall be so located or guarded that issuing heat is not detrimental to other apparatus and materials within the enclosure.

For the specific case of combination starters, the cover or door shall be interlocked so that it cannot be opened without the manually operated switching device being in the open position. However, provision may be made to open the door or cover with the manually operated switching device in the ON position by the use of a tool.

8.1.11 Degrees of protection of enclosed contactors and starters

Subclause 7.1.11 of part 1 applies.

8.2 Performance requirements

8.2.1 Operating conditions

8.2.1.1 General

Subclause 7.2.1.1 of part 1 applies with the following additions.

8.2.1.1.1 Starters shall be so constructed that they:

- a) are trip free;
- b) can be caused to open their contacts by the means provided when running and at any time during the starting sequence;
- c) will not function in other than the correct starting sequence.

8.2.1.1.2 Starters employing contactors shall not trip due to the shocks caused by operation of the contactors when tested according to 9.3.3.1, after the starter has carried its rated full load current at the reference ambient temperature (i.e. +20 °C) and has reached thermal equilibrium at both minimum and maximum settings of the overload relay, if adjustable.

8.2.1.1.3 For rheostatic starters, the overload relay shall be connected in the stator circuit. Special arrangements may be made to protect the rotor contactors and resistors against overheating, if requested by the user.

8.2.1.1.4 When starters are used in conditions in which the overheating of the starting resistors or transformers would represent an exceptional hazard, it is recommended that a suitable device be fitted to switch off the starter automatically before a dangerous temperature is reached.

8.2.1.1.5 The moving contacts of multipole equipment intended to make and break together shall be so mechanically coupled that all poles make and break substantially together, whether operated manually or automatically.

8.2.1.2 Limits of operation of contactors and power-operated starters**8.2.1.2.1 Electromagnetic contactors and starters**

Electromagnetic contactors, whether used separately or in starters, shall close satisfactorily at any value between 85 % and 110 % of their rated control supply voltage U_s . Where a range is declared, 85 % shall apply to the lower value and 110 % to the higher.

The limits between which contactors shall drop out and open fully are 75 % to 20 % for a.c. and 75 % to 10 % for d.c. of their rated control supply voltage U_s . Where a range is declared, 20 % or 10 %, as the case may be, shall apply to the higher value and 75 % to the lower.

Limits for closing are applicable after the coils have reached a stable temperature corresponding to indefinite application of 100 % U_s in an ambient temperature equivalent to the ambient temperature declared by the manufacturer but not less than +40 °C.

Limits for drop-out are applicable with the coil circuit resistance at -5 °C. This can be verified by calculation using values obtained at normal ambient air temperature.

The limits apply to d.c. and a.c. at declared frequency.

8.2.1.2.2 Contactors and starters with electronically controlled electromagnet

Subclause 8.2.1.2.1 applies with the following modification.

Replace the second paragraph as follows:

The limits between which contactors with an electronically controlled electromagnet shall drop out and open fully are

- for d.c.: 75 % to 10 % of their rated control supply voltage U_s ,
- for a.c.: 75 % to 20 % of their rated control supply voltage U_s ,
- for a.c.: 75 % to 10 % of their rated control supply voltage U_s if specified by the manufacturer,
- for a.c., where a range is declared with limits between 75 % to 10 % of their rated control supply voltage U_s , the contactor shall, in addition, be submitted to the capacitive drop out test of 8.2.1.2.4.

Where a range is declared, 20 % or 10 % as the case may be, shall apply to the higher value of the range and 75 % to the lower value of the range.

8.2.1.2.3 Electro-pneumatic contactors and starters

Electro-pneumatic and pneumatic contactors shall close satisfactorily with the air supply pressure between 85 % and 110 % of the rated pressure and open between 75 % and 10 % of the rated pressure.

8.2.1.2.4 Capacitive drop out test

A capacitor C shall be inserted in series in the supply circuit U_s , the total length of the connecting conductors being ≤ 3 m. The capacitor is short-circuited by a switch of negligible impedance. The supply voltage shall then be adjusted to 110 % U_s .

It shall be verified that the contactor drops out when the switch is operated to the open position.

The value of the capacitor shall be

$$C \text{ (nF)} = 30 + 200\,000 / (f \times U_s)$$

e.g. for a coil rated 12...24 V – 50 Hz, the capacitor value is 196 nF (calculation made with U_s max., see note 1).

NOTE 1 The test voltage is the highest value of the declared rated supply voltage range U_s .

NOTE 2 The value of the capacitor is calculated in order to simulate a 100 m long cable of 1,5 mm² connected to a static output having a 1,3 mA leakage current.

NOTE 3 The drop out time should be specified for particular uses, e.g. emergency breaking.

8.2.1.3 Limits of operation of under-voltage relays and releases

Subclause 7.2.1.3 of part 1 applies.

8.2.1.4 Limits of operation of shunt-coil operated releases (shunt trip)

Subclause 7.2.1.4 of part 1 applies.

8.2.1.5 Limits of operation of current operated relays and releases

8.2.1.5.1 Limits of operation of time-delay overload relays when all poles are energized

The relays shall comply with the requirements of table 3 when tested as follows:

- a) with the overload relay or starter in its enclosure, if normally fitted, and at A times the current setting, tripping shall not occur in less than 2 h starting from the cold state, at the value of reference ambient air temperature stated in table 3. However, when the overload relay terminals have reached thermal equilibrium at the test current in less than 2 h, the test duration can be the time needed to reach such thermal equilibrium;
- b) when the current is subsequently raised to B times the current setting, tripping shall occur in less than 2 h;
- c) for class 10 A overload relays energized at C times the current setting, tripping shall occur in less than 2 min starting from thermal equilibrium, at the current setting, in accordance with 8.2.3 of IEC 60034-1;
- d) for class 10, 20 and 30 overload relays energized at C times the current setting, tripping shall occur in less than 4, 8 or 12 min respectively, starting from thermal equilibrium, at the current setting;
- e) at D times the current setting, tripping shall occur within the limits given in table 2 for the appropriate trip class, starting from the cold state.

In the case of overload relays having a current setting range, the limits of operation shall apply when the relay is carrying the current associated with the maximum setting and also when the relay is carrying the current associated with the minimum setting.

For non-compensated overload relays, the current multiple/ambient temperature characteristic shall not be greater than 1,2%/K.

NOTE 1,2%/K is the derating characteristic of PVC-insulated conductors.

An overload relay is regarded as compensated if it complies with the relevant requirements of table 3 at +20 °C and is within the limits shown in figure 7 at other temperatures.

Table 3 – Limits of operation of time-delay overload relays when energized on all poles

Type of overload relay	Multiples of current setting				Reference ambient air temperature
	A	B	C	D	
– Thermal type not compensated for ambient air temperature variations – Magnetic type	1,0	1,2	1,5	7,2	+40 °C
Thermal type compensated for ambient air temperature variations	1,05	1,2	1,5	7,2	+20 °C

8.2.1.5.2 Limits of operation of three-pole thermal overload relays energized on two poles

With reference to table 4:

The overload relay or starter shall be tested in its enclosure if normally fitted. With the relay energized on three poles, at A times the current setting, tripping shall not occur in less than 2 h, starting from the cold state, at the value of the ambient air temperature stated in table 4.

Moreover, when the value of the current flowing in two poles (in phase loss sensitive relays, those carrying the higher current) is increased to B times the current setting, and the third pole de-energized, tripping shall occur in less than 2 h.

The values shall apply to all combinations of poles.

In the case of thermal overload relays having an adjustable current setting, the characteristics shall apply both when the relay is carrying the current associated with the maximum setting and when the relay is carrying the current associated with the minimum setting.

**Table 4 – Limits of operation of three-pole thermal overload relays
when energized on two poles only**

Type of thermal overload relay	Multiples of current setting		Reference ambient air temperature
	A	B	
Compensated for ambient air temperature variations. Not phase loss sensitive	3 poles 1,0	2 poles 1,32 1 pole 0	+20 °C
Not compensated for ambient air temperature variations. Not phase loss sensitive	3 poles 1,0	2 poles 1,25 1 pole 0	+40 °C
Compensated for ambient air temperature variations. Phase loss sensitive	2 poles 1,0 1 pole 0,9	2 poles 1,15 1 pole 0	+20 °C

8.2.1.5.3 Limits of operation of instantaneous magnetic overload relays

For all values of the current setting, instantaneous magnetic overload relays shall trip with an accuracy of $\pm 10\%$ of the value of the published current value corresponding to the current setting.

NOTE Magnetic instantaneous overload relays covered by this standard are not intended for short-circuit protection.

8.2.1.5.4 Limits of operation of automatic change over by under-current relays

- for star-delta starters from star to delta, and
- for auto-transformer starters from the starting to the ON position

The lowest drop-out current of an under-current relay shall be not greater than 1,5 times the actual current setting of the overload relay which is active in the starting or star connection. The under-current relay shall be able to carry any value of current, from its lowest current setting to the stalled current in the starting position or the star connection, for the tripping times determined by the overload relay at its highest current setting.

8.2.2 Temperature rise

The requirements of 7.2.2, 7.2.2.1, 7.2.2.2 and 7.2.2.3 of part 1 apply to contactors and starters in a clean, new condition.

The temperature rises of the several parts of the contactor or starter measured during a test carried out under the conditions specified in 9.3.3.3 shall not exceed the limiting values stated in table 5 of this standard and in 7.2.2.1 and 7.2.2.2 of part 1.

In the case of an electronically controlled electromagnet, coil temperature measuring by variation of resistance may be impracticable; in such a case, other methods are permitted, e.g. thermocouples or other suitable methods.

Table 5 – Temperature rise limits for insulated coils in air and in oil

Class of insulating material	Temperature rise limit (measured by resistance variation) K	
	Coils in air	Coils in oil
A	85	60
E	100	60
B	110	60
F	135	–
H	160	–

NOTE The classification of insulations is that given in clause 2 of IEC 60085.

Because, in an auto-transformer starter, the auto-transformer is energized only intermittently, a maximum temperature rise of 15 K greater than the figures in table 5 is permissible for the windings of the transformer when the starter is operated according to the requirements of 5.3.4 and 5.3.5.3.

NOTE The temperature rise limits given in table 5 of this standard and in 7.2.2.2 of part 1 are applicable only if the ambient air temperature remains within the limits -5°C , $+40^{\circ}\text{C}$.

8.2.2.4 Main circuit

The main circuit of a contactor or a starter which carries current in the ON position, including the over-current releases which may be associated with it, shall be capable of carrying, without the temperature rises exceeding the limits specified in 7.2.2.1 of part 1 when tested in accordance with 9.3.3.3.4:

- for a contactor or starter intended for continuous duty: its conventional thermal current (see 5.3.2.1 and/or 5.3.2.2);
- for a contactor or starter intended for uninterrupted duty, intermittent duty or temporary duty: its relevant rated operational current (see 5.3.2.5).

8.2.2.5 Control circuits

Subclause 7.2.2.5 of part 1 applies.

8.2.2.6 Windings of coils and electromagnets

8.2.2.6.1 Uninterrupted and eight-hour duty windings

With the maximum value of current according to 8.2.2.4 flowing through the main circuit, the windings of the coils, including those of electrically operated valves of electro-pneumatic contactors or starters, shall withstand, under continuous load and at the rated frequency, if applicable, their maximum rated control supply voltage without the temperature rise exceeding the limits specified in table 5 of this standard and in 7.2.2.2 of part 1.

NOTE Depending on the technology, e.g. for some kinds of electronically controlled electromagnets, the control supply voltage may not be directly applied on the coil winding when connected as in normal service.

8.2.2.6.2 Intermittent duty windings

With no current flowing through the main circuit, the windings of the coils shall withstand, at the rated frequency, if applicable, their maximum rated control supply voltage applied as detailed in table 6 according to their intermittent duty class, without the temperature rise exceeding the limits specified in table 5 of this standard and in 7.2.2.2 of part 1.

NOTE Depending on the technology, e.g. for some kind of electronically controlled electromagnet, the control supply voltage may not be directly applied on the coil winding when connected as in normal service.

Table 6 – Intermittent duty test cycle data

Intermittent duty class		One close-open operating cycle every	Interval of time during which the supply to the control coil is maintained
Contactors	Starters		
1	1	3 600 s	"ON" time should correspond to the on-load factor specified by the manufacturer
3	3	1 200 s	
12	12	300 s	
30	30	120 s	
120		30 s	
300		12 s	
1 200		3 s	

8.2.2.6.3 Specially rated (temporary or periodic duty) windings

Specially rated windings shall be tested under operating conditions corresponding to the most severe duty for which they are intended and their ratings shall be stated by the manufacturer.

NOTE Specially rated windings may include coils of starters which are energized during the starting period only, trip coils of latched contactors and certain magnetic valve coils for interlocking pneumatic contactors or starters.

8.2.2.7 Auxiliary circuits

Subclause 7.2.2.7 of part 1 applies.

8.2.3 Dielectric properties

Subclause 7.2.3 of IEC 60947-1 applies.

8.2.4 Normal load and overload performance requirements

Requirements concerning normal load and overload characteristics according to 5.3.5 are given in 8.2.4.1, 8.2.4.2 and 8.2.4.4.

8.2.4.1 Making and breaking capacities

Contactors or starters shall be capable of making and breaking currents without failure under the conditions stated in table 7 for the required utilization categories and the number of operations indicated, as specified in 9.3.3.5.

The off-time and on-time values given in tables 7 and 7a shall not be exceeded.

**Table 7 – Making and breaking capacities –
Making and breaking conditions according to utilization category**

Utilization category	Make and break conditions					
	I_c/I_e	U_r/U_e	$\cos \phi$	On-time ²⁾ s	Off-time s	Number of operating cycles
AC-1	1,5	1,05	0,8	0,05	6)	50
AC-2	4,0 ⁸⁾	1,05	0,65 ⁸⁾	0,05	6)	50
AC-3 ⁹⁾	8,0	1,05	1)	0,05	6)	50
AC-4 ⁹⁾	10,0	1,05	1)	0,05	6)	50
AC-5a	3,0	1,05	0,45	0,05	6)	50
AC-5b	1,5 ³⁾	1,05	3)	0,05	60	50
AC-6a	10)					
AC-6b	5)					
AC-8a	6,0	1,05	1)	0,05	6)	50
AC-8b	6,0	1,05	1)	0,05	6)	50
			— L/R ms			
DC-1	1,5	1,05	1,0	0,05	6)	50 ⁴⁾
DC-3	4,0	1,05	2,5	0,05	6)	50 ⁴⁾
DC-5	4,0	1,05	15,0	0,05	6)	50 ⁴⁾
DC-6	1,5 ³⁾	1,05	3)	0,05	60	50 ⁴⁾
Utilization category	Make conditions ⁹⁾					
	I/I_e	U/U_e	$\cos \phi$	On-time ²⁾ s	Off-time s	Number of operating cycles
AC-3	10	1,05 ⁷⁾	1)	0,05	10	50
AC-4	12	1,05 ⁷⁾	1)	0,05	10	50
<p>I = current made. The making current is expressed in d.c. or a.c. r.m.s. symmetrical values but it is understood that, for a.c., the actual peak value during the making operation may assume a higher value than the symmetrical peak value.</p> <p>I_c = current made and broken, expressed in d.c. or a.c. r.m.s. symmetrical values</p> <p>I_e = rated operational current</p> <p>U = applied voltage</p> <p>U_r = power frequency or d.c. recovery voltage</p> <p>U_e = rated operational voltage</p> <p>$\cos \phi$ = power factor of test circuit</p> <p>L/R = time-constant of test circuit</p>						

Table 7 – (continued)

- 1)

Cos ϕ = 0,45 for $I_e \leq 100$ A; 0,35 for $I_e > 100$ A.
- 2)

The time may be less than 0,05 s, provided that contacts are allowed to become properly seated before re-opening.
- 3)

Tests to be carried out with an incandescent light load.
- 4)

25 operating cycles with one polarity and 25 operating cycles with reverse polarity.
- 5)

Capacitive ratings may be derived by capacitor switching tests or assigned on the basis of established practice and experience. As a guide, reference may be made to the formula given in table 7b. This formula takes no account of thermal effects due to harmonic currents, and values derived must consequently be considered taking temperature rise into account.
- 6)

See table 7a.
- 7)

For U/U_e , a tolerance of ± 20 % is accepted.
- 8)

The values shown are for stator contactors. For rotor contactors, the test shall be made with a current of four times the rated rotor operational current and a power factor of 0,95.
- 9)

The make conditions for utilization categories AC-3 and AC-4 shall also be verified. The verification may be made during the make and break test, but only with the manufacturer's agreement. In this case, the making current multiples shall be as shown for I/I_e and the breaking current as shown for I_c/I_e . 25 operating cycles shall be made at a control supply voltage equal to 110 % of the rated control supply voltage U_c and 25 operating cycles at 85 % of U_e . The off-times are to be determined from table 7a.
- 10)

The manufacturer shall verify the AC-6a rating by testing with a transformer or may derive the rating from the values for AC-3 according to table 7b.

Table 7a – Relationship between current broken I_c and off-time for the verification of rated making and breaking capacities

Current broken I_c A	Off-time s
$I_c \leq 100$	10
$100 < I_c \leq 200$	20
$200 < I_c \leq 300$	30
$300 < I_c \leq 400$	40
$400 < I_c \leq 600$	60
$600 < I_c \leq 800$	80
$800 < I_c \leq 1\,000$	100
$1\,000 < I_c \leq 1\,300$	140
$1\,300 < I_c \leq 1\,600$	180
$1\,600 < I_c$	240

The off-time values may be reduced if agreed by the manufacturer.

Table 7b – Operational current determination for utilization categories AC-6a and AC-6b when derived from AC-3 ratings

Rated operational current	Determination from making current for utilization category AC-3
I_o (AC-6a) for switching of transformers having inrush current peaks of not more than 30 times peak of rated current	$0,45 I_o$ (AC-3)
I_o (AC-6b) for switching of single capacitor banks in circuits having a prospective short-circuit current i_k at the location of the capacitor bank	$i_k \frac{x^2}{(x-1)^2}$ <p>with</p> $x = 13,3 \cdot \frac{I_o \text{ (AC-3)}}{i_k}$ <p>and for</p> $i_k > 205 I_o \text{ (AC-3)}$
<p>The expression for the operational current I_o (AC-6b) emanates from the formula for the highest inrush current peak:</p> $I_{pmax} = \frac{U_o \cdot \sqrt{2}}{\sqrt{3}} \cdot \frac{1 + \sqrt{\frac{X_c}{X_L}}}{X_L - X_c}$ <p>where</p> <p>U_o is the rated operational voltage;</p> <p>X_L is the short-circuit impedance of the circuit;</p> <p>X_c is the reactance of the capacitor bank.</p> <p>This formula is valid on condition that capacitance on the supply side of the contactor or starter can be neglected and that there is no initial charge on the capacitor.</p>	

8.2.4.2 Conventional operational performance

Subclause 7.2.4.2 of part 1 applies with the following addition.

Contactors or starters shall be capable of making and breaking currents without failure under the conventional conditions stated in table 8 for the required utilization categories and the number of operating cycles indicated as specified in 9.3.3.6.

**Table 8 – Conventional operational performance –
Making and breaking conditions according to utilization category**

Utilization category	Make and break test conditions					
	I_d/I_e	U_r/U_e	$\cos \phi$	On-time ²⁾ s	Off-time s	Number of operating cycles
AC-1	1,0	1,05	0,80	0,05	3)	6 000 ¹¹⁾
AC-2	2,0	1,05	0,65	0,05	3)	6 000 ¹¹⁾
AC-3	2,0	1,05	1)	0,05	3)	6 000 ¹¹⁾
AC-4	6,0	1,05	1)	0,05	3)	6 000 ¹¹⁾
AC-5a	2,0	1,05	0,45	0,05	3)	6 000 ¹¹⁾
AC-5b	1,0 ⁷⁾	1,05	7)	0,05	4)	6 000 ¹¹⁾
AC-6	9)	9)	9)	9)	9)	9)
AC-8a	1,0	1,05	0,80	0,05	3)	30 000
AC-8b ¹⁰⁾	6,0	1,05	0,35	1 10	5) 6)	5 900 100
			— L/R ms			
DC-1	1,0	1,05	1,0	0,05	3)	6 000 ⁸⁾
DC-3	2,5	1,05	2,0	0,05	3)	6 000 ⁸⁾
DC-5	2,5	1,05	7,5	0,05	3)	6 000 ⁸⁾
DC-6	1,0 ⁷⁾	1,05	7)	0,05	4)	6 000 ⁸⁾
<p>I_c = current made or broken. Except for AC-5b, AC-6 or DC-6 categories, the making current is expressed in d.c. or a.c. r.m.s. symmetrical values but it is understood that for a.c. the actual peak value during the making operation may assume a higher value than the symmetrical peak value.</p> <p>I_e = rated operational current</p> <p>U_r = power frequency or d.c. recovery voltage</p> <p>U_e = rated operational voltage</p> <p>1) $\cos \phi = 0,45$ for $I_e \leq 100$ A; 0,35 for $I_e > 100$ A.</p> <p>2) The time may be less than 0,05 s, provided that contacts are allowed to become properly seated before re-opening.</p> <p>3) These off-times shall be not greater than the values specified in table 7a.</p> <p>4) Off-time is 60 s.</p> <p>5) Off-time is 9 s.</p> <p>6) Off-time is 90 s.</p> <p>7) Tests to be carried out with an incandescent light load.</p> <p>8) 3 000 operating cycles with one polarity and 3 000 operating cycles with reverse polarity.</p> <p>9) Under consideration.</p> <p>10) Tests for category AC-8b shall be accompanied by tests for category AC-8a. The tests may be made on different samples.</p> <p>11) For manually operated switching devices, the number of operating cycles shall be 1 000 on-load, followed by 5 000 off-load.</p>						

8.2.4.3 Durability

Subclause 7.2.4.3 of part 1 applies with the following additions.

8.2.4.3.1 Mechanical durability

The mechanical durability of a contactor or starter is verified by a special test conducted at the discretion of the manufacturer. Recommendations for conducting this test are given in annex B.

8.2.4.3.2 Electrical durability

Electrical durability of a contactor or starter is verified by a special test conducted at the discretion of the manufacturer. Recommendations for conducting this test are given in annex B.

8.2.4.4 Overload current withstand capability of contactors

Contactors with utilization categories AC-3 or AC-4 shall withstand the overload currents given in table 9, as specified in 9.3.5.

Table 9 – Overload current withstand requirements

Rated operational current	Test current	Duration of test
≤ 630 A	$8 \times I_e \text{ max/AC-3}$	10 s
> 630 A	$6 \times I_e \text{ max/AC-3}^*$	10 s
* With a minimum value of 5 040 A.		

NOTE This test also covers duties where the current is less than shown in table 9 and the test duration is longer than 10 s, provided that the tested value of I^2t is not exceeded.

8.2.5 Co-ordination with short-circuit protective devices

8.2.5.1 Performance under short-circuit conditions (rated conditional short-circuit current)

The rated conditional short-circuit current of contactors and starters backed up by short-circuit protective device(s) (SCPD(s)), combination starters and protected starters shall be verified by short-circuit tests as specified in 9.3.4. These tests are mandatory:

- at the appropriate value of prospective current shown in table 12 (test current " r "), and
- at the rated conditional short-circuit current I_q , if higher than test current " r ".

The rating of the SCPD shall be adequate for any given rated operational current, rated operational voltage and the corresponding utilization category.

Two types of co-ordination are permissible, "1" or "2". The test conditions for both are given in 9.3.4.2.1 and 9.3.4.2.2.

Type "1" co-ordination requires that, under short-circuit conditions, the contactor or starter shall cause no danger to persons or installation and may not be suitable for further service without repair and replacement of parts.

Type "2" co-ordination requires that, under short-circuit conditions, the contactor or starter shall cause no danger to persons or installation and shall be suitable for further use. The risk of contact welding is recognized, in which case the manufacturer shall indicate the measures to be taken as regards the maintenance of the equipment.

NOTE Use of an SCPD not in compliance with the manufacturer's recommendations may invalidate the co-ordination.

8.2.5.2 Co-ordination at the crossover current between starter and associated SCPD

Co-ordination at the crossover current between the starter and the SCPD is a special test. The way to verify it is described in clause B.4.

8.2.6 Switching overvoltages

Subclause 7.2.6 of part 1 applies to contactors and starters for which the manufacturer has declared a value of the rated impulse withstand voltage U_{imp} .

Suitable test circuits and measuring methods are under consideration.

8.2.7 Additional requirements for combination starters and protected starters suitable for isolation

Under consideration.

8.3 Electromagnetic compatibility (EMC)

8.3.1 General

Subclause 7.3.1 of part 1 applies with the following addition.

Power frequency magnetic field tests are not required because the devices are naturally submitted to such fields. Immunity is demonstrated by the successful completion of the operational performance capability tests (see 9.3.3.5 and 9.3.3.6).

This equipment is inherently sensitive to voltage dips and short time interruptions on the control supply; it shall react within the limits of 8.2.1.2 and this is verified by the operating limits tests given in 9.3.3.2.

8.3.2 Immunity

8.3.2.1 Equipment not incorporating electronic circuits

Subclause 7.3.2.1 of part 1 applies.

8.3.2.2 Equipment incorporating electronic circuits

Subclause 7.3.2.2 of part 1 applies.

The test results are specified using the performance criteria of IEC 61000-4. For convenience the performance criteria are quoted here and described in more detail in table 10.

Performance criteria	Test result
1	Normal performance within the specification limits
2	Temporary degradation, or loss of function or performance which is self-recoverable
3	Temporary degradation, or loss of function or performance which requires operator's intervention or system reset. Normal functions shall be restorable by simple intervention, for example by manual reset or restart. There shall not be any damaged component.

Table 10 – Specific acceptance criteria for immunity tests

Item	Acceptance criteria		
	1	2	3
Operation of power and control circuits	No maloperation	Temporary maloperation which cannot cause tripping Unintentional separation or closure of contacts is not accepted Self-recoverable	Tripping of overload relay Unintentional separation or closure of contacts Not self-recoverable
Operation of displays and auxiliary circuits	No changes to visible display information Only slight light intensity fluctuations of LEDs or movement of characters	Temporary visible changes, for example unwanted LED illumination No maloperation of auxiliary contacts	Permanent loss of display information Maloperation of auxiliary contacts

8.3.3 Emission

The level of severity required for environment B covers those required for environment A.

The devices covered by this standard do not generate significant levels of harmonics and therefore no harmonic tests are required.

8.3.3.1 Equipment not incorporating electronic circuits

Subclause 7.3.3.1 of part 1 applies with the following addition.

Equipment incorporating only components such as diodes, varistors, resistors or capacitors is not required to be tested (e.g. in surge suppressors).

8.3.3.2 Equipment incorporating electronic circuits

Subclause 7.3.3.2 of part 1 applies with the following addition.

Radiated radio-frequency emission tests are required only for equipment incorporating circuits with fundamental switching frequency greater than 9 kHz, for example chopped supplies or high-frequency clocks of microprocessors.

9 Tests

9.1 Kinds of test

9.1.1 General

Subclause 8.1.1 of part 1 applies.

9.1.2 Type tests

Type tests are intended to verify compliance of the design of contactors and starters of all types with this standard. They comprise the verification of:

- a) temperature rise limits (see 9.3.3.3);
- b) dielectric properties (see 9.3.3.4);
- c) rated making and breaking capacities (see 9.3.3.5);
- d) change-over ability and reversibility, where applicable (see 9.3.3.5);
- e) conventional operational performance (see 9.3.3.6);
- f) operation and operating limits (see 9.3.3.1 and 9.3.3.2);
- g) ability of contactors to withstand overload current (see 9.3.5);
- h) performance under short-circuit conditions (see 9.3.4);
- i) mechanical properties of terminals (see 8.2.4 of part 1);
- j) degrees of protection of enclosed contactors and starters (see annex C of part 1).
- k) EMC tests, where applicable (see 9.4).

9.1.3 Routine tests

Subclause 8.1.3 of part 1 applies where sampling tests (see 9.1.4) are not made.

Routine tests for contactors and starters comprise:

- operation and operating limits (see 9.3.6.2);
- dielectric tests (see 9.3.6.3).

9.1.4 Sampling tests

Sampling tests for contactors and starters comprise:

- operation and operating limits (see 9.3.6.2)
- dielectric tests (see 9.3.6.3).

Subclause 8.1.4 of part 1 applies with the following additions.

A manufacturer may use sampling tests instead of routine tests at his own discretion. Sampling shall meet or exceed the following requirements as specified in IEC 60410 (see table II-A: Single sampling plans for normal inspection):

- sampling based on $AQL \leq 1$;
- acceptance number $A_c = 0$ (no defect accepted);
- rejection number $R_e = 1$ (if 1 defect, the entire lot shall be tested);

Sampling shall be made at regular intervals for each specific lot.

Alternative statistical methods that ensure compliance with the above IEC 60410 requirements can be used, e.g. statistical methods controlling continuous manufacturing or process control with capability index.

Sampling tests for clearance verification shall be performed according to 8.3.3.4.3 of IEC 60947-1

9.1.5 Special tests

Special tests are mechanical and electrical durability tests and verification of co-ordination at the crossover current between the starter and the SCPD (see annex B).

9.2 Compliance with constructional requirements

Subclause 8.2 of part 1 applies (see, however, note to 8.1).

9.3 Compliance with performance requirements

9.3.1 Test sequences

Each test sequence is made on a new sample.

NOTE 1 With the agreement of the manufacturer, more than one test sequence or all test sequences may be conducted on one sample. However, the tests are to be conducted in the sequence given for each sample.

NOTE 2 Some tests are included in the sequences solely to reduce the number of samples required, the results have no significance for the preceding or following tests in the sequence. Therefore, for convenience of testing and by agreement with the manufacturer, these tests may be conducted on separate new samples and omitted from the relevant sequence. This only applies to the following tests when called for:

Subclause 8.3.3.4.1, item 7) of part 1 – *Verification of creepage distances.*

Subclause 8.2.4 of part 1 – *Mechanical properties of terminals;*

Annex C of part 1 – *Degrees of protection of enclosed equipment.*

The test sequence shall be as follows.

a) Test sequence 1

- (i) verification of temperature rise (see 9.3.3.3)
- (ii) verification of operation and operating limits (see 9.3.3.1 and 9.3.3.2)
- (iii) verification of dielectric properties (see 9.3.3.4)

b) Test sequence 2

- (i) verification of rated making and breaking capacities, change-over ability and reversibility, where applicable (see 9.3.3.5)
- (ii) verification of conventional operational performance (see 9.3.3.6)

c) Test sequence 3

performance under short-circuit conditions (see 9.3.4);

d) Test sequence 4 (applicable to contactors only)

verification of ability to withstand overload currents (see 9.3.5);

e) Test sequence 5

- (i) verification of mechanical properties of terminals (see 8.2.4 of part 1);
- (ii) verification of degrees of protection of enclosed contactors and starters (see annex C of part 1).

There shall be no failure in any of the tests.

9.3.2 General test conditions

Subclause 8.3.2 of part 1 applies with the following addition.

Unless otherwise specified in the relevant test clause, the clamping torque for connections shall be that specified by the manufacturer or, if not specified, the torque given in table 4 of part 1.

9.3.3 Performance under no load, normal load and overload conditions

9.3.3.1 Operation

It shall be verified that contactors and starters operate according to the requirements of 8.2.1.1.2.

To verify the insensitivity of the starter to contactor operation, the starter shall be loaded to attain a steady state temperature as stated in 8.2.2 and the contactor operated in the normal switching sequence three times without intentional delay between operations. The starter shall not trip due to the contactor operation.

When the overload relay has a combined stop and reset actuating mechanism, with the contactor closed, the resetting mechanism shall be operated and this shall cause the contactor to drop out. When the overload relay has either a reset only or separate stop and reset actuating mechanisms, with the contactor closed and the resetting mechanism in the reset position, the tripping mechanism shall be operated and the contactor shall have been caused to drop out. These tests are to verify that the overload tripping action cannot be defeated by holding the resetting mechanism in the reset position.

In the case of rheostatic rotor starters, tests shall be performed to verify that the time setting of time-delay relays and the calibration of any other devices used for controlling the rate of starting are within the limits stated by the manufacturer.

The value of the starting resistors shall be verified for each section to be within $\pm 10\%$ of the stated figures.

It shall also be verified that the rotor switching devices cut out the steps of resistors in the correct sequence.

It shall also be verified that the open-circuit voltages on the tapping terminals of the auto-transformer are in accordance with the designed figures and that the phase sequence at the motor terminals of the two-step auto-transformer starter is correct in both the starting and ON positions of the starter.

9.3.3.2 Operating limits

9.3.3.2.1 Power-operated equipment

Contactors and starters shall be tested to verify their performance according to the requirements given in 8.2.1.2.

9.3.3.2.2 Relays and releases

a) Operation of under-voltage relays and releases

Under-voltage relays or releases shall be tested for compliance with the requirements of 8.2.1.3. Each limit shall be verified three times.

For the drop-out test, the voltage shall be reduced from the rated value to zero at an uniform rate in approximately 1 min.

b) Shunt-coil operated releases

Shunt-coil operated releases shall be tested for compliance with the requirements of 8.2.1.4. Operation shall be verified at 70 % and 110 % of rated voltage under all operating conditions of the starter.

c) Thermal and time-delay magnetic overload relays

Overload relays and starters shall be connected using conductors in accordance with tables 9, 10 and 11 of part 1 for test currents corresponding to:

- 100 % of the current setting of the overload relay for overload relays of trip class 10A;
- 125 % of the current setting of the overload relay for overload relays of trip classes 10, 20 and 30 and for overload relays for which a maximum tripping time greater than 30 s is specified (see 5.7.3).

Thermal and time-delay magnetic overload relays with all poles energized shall be tested as stated in 8.2.1.5.1.

Moreover, the characteristics defined in 8.2.1.5.1 shall be verified by tests at -5°C , $+20^{\circ}\text{C}$, $+40^{\circ}\text{C}$ and may be verified at minimum and maximum temperatures given by the manufacturer if larger. However, for relays or releases declared compensated for ambient temperature, in case of temperature range declared by the manufacturer larger than those given in figure 7, the characteristics at -5°C and/or $+40^{\circ}\text{C}$ need not be verified if, when tested at the declared minimum and maximum temperatures, the corresponding tripping current values are in compliance with the limits specified for -5°C and/or $+40^{\circ}\text{C}$ in that figure.

Three-pole thermal overload relays energized on two poles only shall be tested as stated in 8.2.1.5.2 on all combinations of poles and at the maximum and minimum current settings for relays with adjustable settings.

d) Instantaneous magnetic overload relays

Each relay shall be tested separately. The current through the relay shall be increased at a rate suitable for an accurate reading to be made. The values shall be as stated in 8.2.1.5.3.

e) Under-current relays in automatic change-over

The limits of operation shall be verified in accordance with 8.2.1.5.4.

9.3.3.3 Temperature rise

9.3.3.3.1 Ambient air temperature

Subclause 8.3.3.3.1 of part 1 applies.

9.3.3.3.2 Measurement of the temperature of parts

Subclause 8.3.3.3.2 of part 1 applies.

9.3.3.3.3 Temperature rise of a part

Subclause 8.3.3.3.3 of part 1 applies.

9.3.3.3.4 Temperature rise of the main circuit

Subclause 8.3.3.3.4 of part 1 applies with the following additions:

The main circuit shall be loaded as stated in 8.2.2.4.

All auxiliary circuits which normally carry current shall be loaded at their maximum rated operational current (see 5.6) and the control circuits shall be energized at their rated voltages.

The starter shall be fitted with an overload relay complying with 5.7.4 and selected as follows:

- Non-adjustable relay
The current setting shall be equal to the maximum operational current of the starter and the test shall be made at this current;
- Adjustable relay
The maximum current setting shall be that which is nearest to but not greater than the maximum operational current of the starter.
The test shall be made with that overload relay for which the current setting is nearest to the maximum of its scale.

NOTE The selection method described above is designed to ensure that the temperature rise of the field wiring terminals of the overload relay and the power dissipated by the starter are not less than those that will occur under any combination of relay and contactor. In cases where the effect of the overload relay on these values is insignificant (i.e. solid state overload relays), the test current shall always be the maximum operational current of the starter.

9.3.3.3.5 Temperature rise of control circuits

Subclause 8.3.3.3.5 of part 1 applies with the following addition.

The temperature rise shall be measured during the test of 9.3.3.3.4.

9.3.3.3.6 Temperature rise of coils and electromagnets

Subclause 8.3.3.3.6 of part 1 applies with the following additions.

- a) Electromagnets of contactors or starters intended for uninterrupted or 8 h duty are subjected only to the conditions prescribed in 8.2.2.6.1, with the corresponding rated current flowing through the main circuit for the duration of the test. The temperature rise shall be measured during the test of 9.3.3.3.4.
- b) Electromagnets of contactors or starters intended for intermittent duty shall be subjected to the test as stated above, and also to the test prescribed in 8.2.2.6.2 dealing with their duty class, with no current flowing through the main circuit.
- c) Specially rated (temporary and periodic duty) windings shall be tested as stated in 8.2.2.6.3, without the current in the main circuit.

9.3.3.3.7 Temperature rise of auxiliary circuits

Subclause 8.3.3.3.7 of part 1 applies with the following addition.

The temperature rise shall be measured during the test of 9.3.3.3.4.

9.3.3.3.8 Temperature rise of starting resistors for rheostatic rotor starters

The temperature rise of resistors shall not exceed the limits specified in table 3 of part 1, when the starter is operated at its rated duty (see 5.3.4) and according to its starting characteristics (see 5.3.5.5.1).

The current through each section of the resistors shall be thermally equivalent to the current during the starting time when the controlled motor is operating with the maximum starting torque and the starting time for which the starter is rated (see 5.3.4 and 5.3.5.5.1); in practice, the current value I_m can be used.

Starting operations shall be evenly spaced in time according to the number of starts per hour.

The temperature rise of the enclosures and of the issuing air shall not exceed the limits specified in table 3 of part 1.

NOTE It is not practical to test the performance of starting resistors of every combination of motor output and rotor voltage and current; it is required only that a sufficient number of tests be made to prove, by interpolation or deduction, compliance with this standard.

9.3.3.3.9 Temperature rise of the auto-transformer for two-step auto-transformer starters

The temperature rise of the auto-transformer shall not exceed the limits specified in table 5 increased by 15 % (see 8.2.2) and those specified in table 3 of part 1, when the starter is operated at its rated duty (see 5.3.4).

The current through each winding of the auto-transformer shall be thermally equivalent to the current carried when the controlled motor is operating with the maximum starting current and starting time for which the starter is rated (see 5.3.5.5.3); this condition is assumed to be reached when the current drawn from the auto-transformer during the starting time is equal to the maximum starting current specified in 5.3.5.5.3 multiplied by:

$$0,8 \times \frac{\text{starting voltage}}{U_e} \quad (\text{see } 5.3.1.4)$$

The operating cycles shall be evenly spaced in time according to the number of starts per hour (see 5.3.4.3).

In the event of two successive operating cycles (see 5.3.4.3), the temperature rise of the auto-transformer may exceed the maximum value given in 8.2.2 but no damage shall result to the auto-transformer.

In the case of an auto-transformer with several sets of taps, the test shall be made with the taps giving the highest power loss in the transformer; it shall be made over a period of time sufficient for the temperature rise to reach a constant value.

In order to facilitate this test, star-connected impedances may be used in place of a motor.

9.3.3.4 Dielectric properties

Subclause 8.3.3.4 of IEC 60947-1 applies with the following modifications.

9.3.3.4.1 Type tests

Subclause 8.3.3.4.1 of IEC 60947-1 applies with the addition of

- the following sentences, at the end of item 1):

The metal foil shall be applied to all surfaces where these are likely to be touched by people during normal operation or adjustment of the equipment and where such surfaces can also be touched by the standard test finger.

The metal foil shall not be applied for power frequency withstand verification after switching and short-circuit tests.

- the following sentence, after the second paragraph of item 2) b):

Circuits of a contactor or starter including devices which have been subjected to U_{imp} test voltages lower than those specified in 7.2.3.1 and 8.3.3.4.2 of IEC 60947-1 may be disconnected for the test, according to the manufacturer's instructions.

- the following sentence, after the paragraph of item 2) c) ii):

Where the control circuit normally connected to the main circuit is disconnected (according to 8.3.3.4.1, item 2) b)), the method used to maintain the main contacts closed shall be indicated in the test report.

- the following sentence at the end of 8.3.3.4.1, item 8):

For equipment suitable for isolation, the leakage current shall be measured through each pole with the contacts in the open position, at a test voltage of $1,1 U_e$ and shall not exceed 0,5 mA.

Verification of impulse withstand voltage across open contacts is not required for equipment not suitable for isolation (see 8.3.3.4.1, item 2) c) iv) of IEC 60947-1).

9.3.3.5 Making and breaking capacities

Subclause 8.3.3.5 of part 1 applies with the following additions.

9.3.3.5.1 General test conditions

The tests shall be made, under the operating conditions stated in table 7, without failure, see 9.3.3.5.5 f).

The control supply voltage shall be 100 % of U_s , except that, for the make only test of utilization categories AC-3 and AC-4, the control supply voltage shall be 110 % of U_s for half the number of operating cycles and 85 % of U_s for the other half.

Connections to the main circuit shall be similar to those intended to be used when the contactor or starter is in service. If necessary, or for convenience, the control and auxiliary circuits, and in particular the magnet coil of the contactor or starter, may be supplied by an independent source. Such a source shall deliver the same kind of current and the same voltage as specified for service conditions.

The overload relay and the SCPD of the starter may be short-circuited for the purpose of carrying out the rated making and breaking capacity tests.

9.3.3.5.2 Test circuit

Subclause 8.3.3.5.2 of part 1 applies.

9.3.3.5.3 Characteristics of transient recovery voltage

Subclause 8.3.3.5.3 of part 1 applies to utilization categories AC-2, AC-3, AC-4, AC-8a and AC-8b | (see table 1).

It is not necessary to adjust factor γ or the oscillatory frequency for testing making capacity | only (in AC-3 and AC-4).

9.3.3.5.4 Switching overvoltages

Subclause 8.3.3.5.4 of part 1 applies with the following addition:

The switching overvoltages shall be verified on the load side between phases for multipole devices and across the load for single-pole devices.

The test procedure is under consideration.

9.3.3.5.5 Rated making and breaking capacities

If the contactor in a starter has separately satisfied the requirements of item a) hereafter for the utilization category of the starter, the starter need not be tested.

a) Rated making and breaking capacities of contactors

The contactor shall make and break the current corresponding to its utilization category and for the number of operating cycles given in table 7. See also item d) hereafter for reversing contactors.

Contactors of utilization categories AC-3 and AC-4 shall be subjected to 50 making only operations followed by 50 making and breaking operations.

b) Rated making and breaking capacity of direct-on-line and two direction starters (AC-3) and stator switching devices of rheostatic rotor starters (AC-2) |

The starter shall make and break the current corresponding to its utilization category for the number of operating cycles given in table 7.

Starters of utilization category AC-3 shall be subjected to 50 making only operations followed by 50 making and breaking operations.

c) Rated making and breaking capacities and change-over ability of star-delta starters (AC-3) and two-step auto-transformer starters (AC-3)

The starter shall make and break the currents corresponding to its utilization category given in table 7.

Both the starting and the ON or delta position of the starters shall first be subjected to 50 making only operations, the current being broken by a separate switching device.

The starter shall then be subjected to the 50 making and breaking operations. Each operating cycle shall consist of the following sequences:

- make the current in the starting or star position;
- break the current in the starting or star position;
- make the current in the ON or delta position;
- break the current in the ON or delta position;
- off period.

The load circuit shall be connected to the starter as would be the windings of a motor. The rated operational current of the starter (I_e) is the current in the ON or delta position.

NOTE In the case of star-delta starters, it is important that the test currents be measured in star and delta since the supply impedance has a significant effect on the transformation ratio.

When a transformer has more than one output voltage, it shall be connected to give the highest starting voltage.

The on-time in the starting and ON positions and the off-time shall be as stated in table 7.

d) Rated making and breaking capacities of direct-on-line and reversing starters (AC-4)

The starters shall make and break the currents given in table 7.

The 50 making only operations shall be done first, the current being broken by a separate switching device, followed by the 50 making and breaking operations.

The load circuit shall be connected to the starter as would be the windings of a motor.

For starters incorporating two contactors, two contactors A and B shall be used and wired as in normal application. Each sequence of the 50 operations shall be:

close A – open A – close B –
open B – off period

The change-over from "open A" to "close B" shall be made as fast as the normal control system will allow.

Mechanical or electrical interlocking means provided in the starter or available for associating contactors as reversing devices shall be used.

If the reversing circuit arrangement is such that both contactors can be energized simultaneously, ten additional sequences shall be conducted with both contactors energized simultaneously.

e) Rated making and breaking capacities of the rotor switching devices of a rheostatic rotor starter

Verification of the making and breaking capacities of the rotor switching devices shall be performed as in 9.3.3.5.5 b) for AC-2 category where $I_e = I_{er}$, the maximum rated rotor current for which the starter is designed. $U_e = U_{er}$ (rated rotor operational voltage) and U/U_e shall be 0,8. The power factor shall be 0,95. The starting resistors may be disconnected for these tests and, for starters having more than two steps, the test shall be performed on each switching device in turn. Since the rotor switching devices in starters having more than two steps do not break and make at the full rotor voltage, the voltage for these tests may be reduced in the ratio:

$$\frac{\text{Starting resistance switched}}{\text{Total starting resistance}}$$

When a starter is so connected that the circuit is opened by the stator switch before the rotor switching devices open, no verification of the breaking capacity is necessary.

For rotor switching devices which have previously satisfied the requirements corresponding to those specified above, no further tests are needed.

- f) Behaviour and condition of the contactor or starter during and after the making and breaking capacity, change-over and reversing tests

During the tests within the limits of the specified making and breaking capacities of 9.3.3.5 and the verification of conventional operational performance of 9.3.3.6.1 to 9.3.3.6.6, there shall be no permanent arcing, no flash-over between poles, no blowing of the fusible element in the earth circuit (see 9.3.3.5.2) and no welding of the contacts.

The contacts shall operate when the contactor or starter is switched by the applicable method of control.

9.3.3.6 Operational performance capability

Subclause 8.3.3.6 of part 1 applies with the following additions.

Tests concerning the verification of conventional operational performance are intended to verify that a contactor or starter is capable of fulfilling the requirements given in table 8.

Connections to the main circuit shall be similar to those intended to be used when the contactor or starter is in service.

The overload relay and the SCPD of the starter may be short-circuited for the purpose of carrying out the tests.

The test circuit given in 9.3.3.5.2 is applicable and the load is to be tuned according to 9.3.3.5.3.

The control voltage shall be 100 % of the rated control supply voltage.

If the contactor in a starter has separately satisfied the requirements of 9.3.3.6.1 for the utilization category of the starter, the starter need not be tested.

9.3.3.6.1 Conventional operational performance of contactors

The contactor shall make and break the current corresponding to its utilization category and for the number of operating cycles given in table 8. See also 9.3.3.6.4.

9.3.3.6.2 Conventional operational performance of direct-on-line and two direction starters (AC-3) and stator switching devices of rheostatic rotor starters (AC-2)

The starter shall make and break the current corresponding to its utilization category and for the number of operating cycles given in table 8.

9.3.3.6.3 Conventional operational performance of star-delta starters (AC-3) and two-step auto-transformer starters (AC-3)

The starter shall make and break the current corresponding to its utilization category for the number of operating cycles given in table 8.

The test procedure shall be as stated in 9.3.3.5.5, item c), except that the 50 making only operations are not done.

9.3.3.6.4 Conventional operational performance of direct-on-line and reversing starters (AC-4)

The starter shall make and break the current corresponding to its utilization category for the number of operating cycles given in table 8.

The test procedure shall be as stated in 9.3.3.5.5, item d), except that the 50 making only operations and the 10 additional sequences of simultaneous energizing are not done.

9.3.3.6.5 Conventional operational performance of the rotor switching devices of a rheostatic rotor starter

Verification of conventional operational performance of the rotor switching devices shall be performed as in 9.3.3.6.1 for the AC-2 category given in table 8.

The test procedure shall be as stated in 9.3.3.5.5, item e).

9.3.3.6.6 Behaviour of the contactor or starter during, and its condition after, the conventional operational performance tests

The requirements of 9.3.3.5.5, item f), shall be fulfilled and then the verification of power frequency withstand according to 8.3.3.4.1, item 4), of IEC 60947-1 shall be made.

For equipment suitable for isolation, the leakage current shall be measured through each pole, with the contacts in the open position, at a test voltage of $1,1 U_e$ and shall not exceed 2 mA.

9.3.4 Performance under short-circuit conditions

This subclause specifies test conditions for verification of compliance with the requirements of 8.2.5.1. Specific requirements regarding test procedure, test sequences, condition of equipment after the test and types of co-ordination are given in 9.3.4.1 and 9.3.4.2.

9.3.4.1 General conditions for short-circuit tests

9.3.4.1.1 General requirements for short-circuit tests

The general requirements of 8.3.4.1.1 of part 1 apply.

9.3.4.1.2 Test circuit for the verification of short-circuit ratings

Subclause 8.3.4.1.2 of part 1 applies except that, for type "1" co-ordination, the fusible element F and the resistor R_L are replaced by a solid 6 mm² wire of 1,2 m to 1,8 m in length, connected to the neutral, or with the agreement of the manufacturer, to one of the phases.

NOTE This larger size of wire is not used as a detector but to establish an "earth" condition allowing the damage to be evaluated.

9.3.4.1.3 Power-factor of the test circuit

Subclause 8.3.4.1.3 of part 1 applies.

9.3.4.1.4 Time-constant of the test circuit

Subclause 8.3.4.1.4 of part 1 applies.

9.3.4.1.5 Calibration of the test circuit

Subclause 8.3.4.1.5 of part 1 applies.

9.3.4.1.6 Test procedure

Subclause 8.3.4.1.6 of part 1 applies with the following additions.

The contactor or the starter and its associated SCPD, or the combination or protected starter, shall be mounted and connected as in normal use. They shall be connected in the test circuit using a maximum of 2,4 m of cable (corresponding to the operational current of the starter) for each main circuit.

If the SCPD is separate from the starter, it shall be connected to the starter using the cable specified above. (The total length of cable shall not exceed 2,4 m.)

Three-phase tests are considered to cover single-phase applications.

9.3.4.1.7 Vacant.

9.3.4.1.8 Interpretation of records

Subclause 8.3.4.1.8 of part 1 applies.

9.3.4.2 Conditional short-circuit current of contactors, starters, combination starters and protected starters

The contactor or starter and the associated SCPD, or the combination or the protected starter, shall be subjected to the tests given in 9.3.4.2.1 and 9.3.4.2.2. The tests shall be so conducted that conditions of maximum I_e and of maximum U_e for utilization category AC-3 are covered.

For a magnetically operated contactor or starter, the magnet shall be held closed by a separate electrical supply at the rated control supply voltage U_c . The SCPD used shall be as stated in 8.2.5.1. If the SCPD is a circuit-breaker with an adjustable current setting, the test shall be done with the circuit-breaker adjusted to the maximum setting for the declared type of co-ordination and discrimination.

During the test, all openings of the enclosure shall be closed as in normal service and the door or cover secured by the means provided.

A starter covering a range of motor ratings and equipped with interchangeable overload relays shall be tested with the overload relay with the highest impedance and the overload relay with the lowest impedance together with the corresponding SCPDs.

For type "1" co-ordination, a new test sample may be used for each operation stated in 9.3.4.2.1 and 9.3.4.2.2.

For type "2" co-ordination, one sample shall be used for the tests at the prospective current " I_p " (see 9.3.4.2.1) and one sample for the tests at current I_q (see 9.3.4.2.2).

By agreement of the manufacturer, the tests at r and I_q may be carried out on the same sample.

9.3.4.2.1 Test at the prospective current " r "

The circuit shall be adjusted to the prospective test current corresponding to the rated operational current I_o according to table 12.

The contactor or starter and the associated SCPD, or the combination or the protected starter, shall then be connected in the circuit. The following sequence of operations shall be performed:

- One breaking operation of the SCPD shall be performed with all the switching devices closed prior to the test.
- One breaking operation of the SCPD shall be performed by closing the contactor or starter on to the short-circuit.

Table 12 – Value of the prospective test current according to the rated operational current

Rated operational current I_o (AC-3) A	Prospective current " r " kA
$0 < I_o \leq 16$	1
$16 < I_o \leq 63$	3
$63 < I_o \leq 125$	5
$125 < I_o \leq 315$	10
$315 < I_o \leq 630$	18
$630 < I_o \leq 1\,000$	30
$1\,000 < I_o \leq 1\,600$	42
$1\,600 < I_o$	Subject to agreement between manufacturer and user

* If the contactor or starter is not specified according to utilization category AC-3, the prospective current " r " shall correspond to the highest rated operational current for any utilization category claimed by the manufacturer.

The power factor or the time-constant shall be according to table 16 of 8.3.4.1.4 of part 1.

9.3.4.2.2 Test at the rated conditional short-circuit current I_q

NOTE This test is done if the current I_q is higher than the current " r ".

The circuit shall be adjusted to the prospective short-circuit current I_q equal to the rated conditional short-circuit current.

If the SCPD is a fuse and the test current is within the current-limiting range of the fuse, then, if possible, the fuse shall be selected to permit the maximum peak let-through current (I_p) and the maximum let-through energy (I^2t).

The contactor or starter and the associated SCPD, or the combination or the protected starter, shall then be connected to the circuit.

The following sequence of operations shall be performed:

- a) One breaking operation of the SCPD shall be performed with all the switching devices closed prior to the test.
- b) One breaking operation of the SCPD shall be performed by closing the contactor or starter on to the short-circuit.

If, in the case of a combination starter or a protected starter, the switching device of the SCPD complies with IEC 60947-2 or IEC 60947-3 and has a short-circuit breaking capacity or rated conditional short-circuit current less than the rated conditional short-circuit current of the combination starter or protected starter the following additional test shall be made.

- c) One breaking operation of the SCPD shall be performed by closing the switching device (switch or circuit-breaker) on to the short-circuit. This operation may be performed either on a new sample (starter and SCPD) or on the first sample with the agreement of the manufacturer.

After this operation only conditions A to G of 9.3.4.2.3 shall be verified.

9.3.4.2.3 Results to be obtained

The contactor, starter, or the combination or protected starter, shall be considered to have passed the tests at the prospective current " I_r " and, where applicable, the prospective current I_q , if the following conditions are met for the claimed type of co-ordination.

Both types of co-ordination (all devices):

- A The fault current has been successfully interrupted by the SCPD or the combination starter and the fuse or fusible element or solid connection between the enclosure and supply shall not have melted.
- B The door or cover of the enclosure has not been blown open and it is possible to open the door or cover. Deformation of the enclosure is considered acceptable provided that the degree of protection by the enclosure is not less than IP2X.
- C There is no damage to the conductors or terminals and the conductors have not been separated from the terminals.
- D There is no cracking or breaking of an insulating base to the extent that the integrity of mounting of a live part is impaired.

Both types of co-ordination (combination starters and protected starters only):

- E The circuit-breaker or the switch is capable of being opened manually by its operating means.
- F Neither end of the SCPD is completely separated from its mounting means to an exposed conductive part.
- G If a circuit-breaker with rated ultimate short-circuit breaking capacity less than the rated conditional short-circuit current assigned to the combination or protected starter is employed, the circuit-breaker shall be tested to trip as follows:
 - a) Circuit-breakers with instantaneous trip relays or releases: at 120 % of the trip current.
 - b) Circuit-breakers with overload relays or releases: at 250 % of the rated current of the circuit-breaker.

Type "1" co-ordination (all devices):

- H There has been no discharge of parts beyond the enclosure. Damage to the contactor and the overload relay is acceptable. The starter may be inoperative after each operation. The starter shall therefore be inspected and the contactor and/or the overload relay and the release of the circuit-breaker shall be reset if necessary and, in the case of fuse protection, all fuse-links shall be replaced.

Type "1" co-ordination (combination and protected starters only):

- I The adequacy of insulation in accordance with 8.3.3.4.1, item 4), of IEC 60947-1 is verified after each operation (at currents " I " and " I_n ") by a dielectric test on the complete unit under test (SCPD plus contactor/starter but before replacement of parts) using a power frequency withstand voltage of twice the rated operational voltage U_e but not less than 1 000 V. The test voltage shall be applied to the incoming supply terminals, with the switch or the circuit-breaker in the open position, as follows:

- between each pole and all other poles connected to the frame of the starter;
- between all live parts of all poles connected together and the frame of the starter;
- between the terminals of the line side connected together and terminals of the other side connected together.

For equipment suitable for isolation, the leakage current shall be measured through each pole, with the contacts in the open position, at a test voltage of $1,1 U_e$ and shall not exceed 6 mA.

Type "2" co-ordination (all devices):

- J No damage to the overload relay or other parts has occurred, except that welding of contactor or starter contacts is permitted, if they are easily separated (e.g. by a screwdriver) without significant deformation, but no replacement of parts is permitted during the test, except that, in the case of fuse protection, all fuse-links shall be replaced.

In the case of welded contacts as described above, the functionality of the device shall be verified by carrying out 10 operating cycles under the conditions of table 8 for the applicable utilization category.

- K The tripping of the overload relay shall be verified at a multiple of the current setting and shall conform to the published tripping characteristics, according to 5.7.5, both before and after the short-circuit test.

- L The adequacy of the insulation in accordance with 8.3.3.4.1, item 4), of IEC 60947-1 shall be verified by a dielectric test on the contactor, starter, combination or protected starter using a power frequency withstand voltage of twice the rated operational voltage U_e but not less than 1 000 V.

In the case of combination and protected starters, additional tests according to 8.3.3.4.1, item 3), of IEC 60947-1 shall be made across the main poles of the device with the contacts of the switch or of the circuit-breaker open and the contacts of the starter closed.

For equipment suitable for isolation, the leakage current shall be measured through each pole, with the contacts in the open position, at a test voltage of $1,1 U_e$ and shall not exceed 2 mA.

Fuse-links, if any, are shorted.

9.3.5 Overload current withstand capability of contactors

For the test, the contactor shall be mounted, wired and operated as specified in 9.3.2.

All poles of the contactors are simultaneously subjected to one test with the overload current and duration values stated in 8.2.4.4. The test is performed at any convenient voltage and it starts with the contactor at room temperature.

After the test, the contactor shall be substantially in the same condition as before the test. This is verified by visual inspection.

NOTE The Pt value (Joule integral) calculated from this test cannot be used to estimate the performance of the contactor under short-circuit conditions.

9.3.6 Routine tests and sampling tests

9.3.6.1 General

The tests shall be carried out under the same conditions as those specified for type tests in the relevant parts of 9.1.2 or under equivalent conditions. However, the limits of operation in 9.3.3.2 may be verified at the prevailing ambient air temperature and on the overload relay alone, but a correction may be necessary to allow for normal ambient conditions.

9.3.6.2 Operation and operating limits

For electromagnetic, pneumatic and electro-pneumatic contactors or starters, tests are carried out to verify operation within the limits specified in 8.2.1.2.

For manual starters, tests are carried out to verify the proper operation of the starter (see 8.2.1.2, 8.2.1.3 and 8.2.1.4).

NOTE In these tests it is not necessary to reach thermal equilibrium. The lack of thermal equilibrium may be compensated by using a series resistor or by appropriately decreasing the voltage limit.

Tests shall be made to verify the calibration of overload relays. In the case of a thermal or a time-delay magnetic overload relay, this may be a single test with all poles equally energized at a multiple of the current setting, to check that the tripping time conforms (within tolerances) to the curves supplied by the manufacturer; in the case of an instantaneous magnetic overload relay, the test shall be carried out at 1,1 times the current setting.

NOTE In the case of a time-delay magnetic overload relay comprising a time-delay device working with a fluid dashpot, calibration may be carried out with the dashpot empty, at a percentage of the current setting indicated by the manufacturer and capable of being justified by a special test.

9.3.6.3 Dielectric tests

Subclause 8.3.3.4.2 of IEC 60947-1 applies with the following addition.

In the case of a rheostatic rotor starter, all the poles of the rotor switching devices will normally be connected through the starting resistors; the dielectric test is therefore confined to the application of the test voltage between the rotor circuit and the frame of the starter.

The use of the metal foil is not necessary.

NOTE The combined test of 8.3.3.4.2 of IEC 60947-1 is permitted.

9.4 EMC Tests

9.4.1 General

Subclauses 8.3.2.1, 8.3.2.3 and 8.3.2.4 of part 1 apply with the following additions.

With the agreement of the manufacturer, more than one EMC test or all EMC tests may be conducted on one and the same sample, which may initially be new or may have passed test sequences according to 9.3.1. The sequence of the EMC tests may be any convenient sequence.

The test report shall include any special measures that have been taken to achieve compliance, for example the use of shielded or special cables. If auxiliary equipment is used with the contactor or starter in order to comply with immunity or emission requirements, it shall be included in the report.

The test sample shall be in the open or closed position, whichever is the worse, and shall be operated with the rated control supply.

9.4.2 Immunity

The tests of table 13 are required. Special requirements are specified in 9.4.2.1 to 9.4.2.6.

If, during the EMC-tests, conductors are to be connected to the test sample, the cross-section and the type of the conductors are optional but shall be in accordance with the manufacturer's literature.

Table 13 – EMC Immunity tests

Type of test	Severity level required
1,2/50 μ s – 8/20 μ s surges IEC 61000-4-5	2 kV line to earth 1 kV line to line
Fast transient bursts IEC 61000-4-4	2 kV
Electromagnetic field IEC 61000-4-3	10 V/m
Electrostatic discharges IEC 61000-4-2	4 kV/contact discharge 8 kV/air discharge

9.4.2.1 Performance of the test sample during and after the test

Unless otherwise specified, performance criterion 2 applies, see 8.3.2.2.

No loss of performance shall be permitted during or after the tests. After the test, the operating limits of 9.3.3.2 shall be verified.

9.4.2.2 Electrostatic discharge

The test shall be conducted using the methods of IEC 61000-4-2.

Except for metallic parts for which contact discharge is made, only air discharge is required. Tests are not possible if the device is an open frame or of degree of protection IP00. In this case, the manufacturer shall attach a label to the unit advising of the possibility of damage due to static discharges.

Ten positive and ten negative pulses shall be applied to each selected point, the time interval after each successive single discharge being 1 s.

Tests are not required on power terminals. The application of conductors is not required, except for energizing the coil.

9.4.2.3 Electromagnetic field

The tests shall be conducted using the methods of IEC 61000-4-3. The test procedure of IEC 61000-4-3 shall apply.

The device shall comply with performance criterion 1.

Tests are not required if the equipment is to be fully enclosed in an EMC specific purpose metallic enclosure installed as specified by the manufacturer.

9.4.2.4 Fast transient bursts

The tests shall be conducted using the methods of IEC 61000-4-4.

The bursts shall be applied to all main, control or auxiliary terminals, whether they comprise electronic or conventional contacts.

The test voltage shall be applied for the duration of 1 min.

9.4.2.5 Surges (1,2/50 μ s – 8/20 μ s)

The test shall be conducted using the methods of IEC 61000-4-5. Capacitive coupling shall be preferred. The surges shall be applied to all main, control or auxiliary terminals, whether they comprise electronic or conventional contacts.

The test voltage values are those of table 13 but shall not exceed the corresponding U_{imp} value(s) given by the manufacturer following 7.2.3 of IEC 60947-1.

The repetition rate shall be one surge per minute, with the number of pulses being five positive and five negative.

9.4.2.6 Harmonics

Under consideration.

9.4.3 Emission

For equipment designed for environment A, a suitable warning shall be given to the user (for example in the instruction manual) stipulating that the use of this equipment in environment B may cause radio interference in which case the user may be required to employ additional mitigation methods.

9.4.3.1 Conducted radio-frequency emission tests

A description of the test, the test method and the test set-up are given in CISPR 11.

To pass, the equipment shall not exceed the levels given in table 14.

Table 14 – Conducted radio-frequency emission test limits

Frequency band MHz	Environment A	Environment B
0,15 – 0,5	79 dB(μ V) quasi-peak 66 dB(μ V) average	66 dB(μ V) – 56 dB(μ V) quasi-peak 56 dB(μ V) – 46 dB(μ V) average (decrease with log of frequency)
0,5 – 5,0	73 dB(μ V) quasi-peak 60 dB(μ V) average	56 dB(μ V) quasi-peak 46 dB(μ V) average
5 – 30	73 dB(μ V) quasi-peak 60 dB(μ V) average	60 dB(μ V) quasi-peak 50 dB(μ V) average

9.4.3.2 Radiated radio-frequency emission tests

A description of the test, the test method and the test set-up are given in CISPR 11.

Tests are required where the control and auxiliary circuits contain components with fundamental switching frequencies greater than 9 kHz, for example switch-mode power supplies, etc.

To pass, the equipment shall not emit at higher levels than those given in table 15.

Tests are not required if the equipment is to be fully enclosed in an EMC specific purpose metallic enclosure installed as specified by the manufacturer.

Table 15 – Radiated emission test limits

Frequency band MHz	Environment A*	Environment B
30 – 230	30 dB(μV/m) quasi-peak at 30 m	30 dB(μV/m) quasi-peak at 10 m
230 – 1 000	37 dB(μV/m) quasi-peak at 30 m	37 dB(μV/m) quasi-peak at 10 m
* These tests may be carried at 10 m distance with the limits raised by 10 dB.		




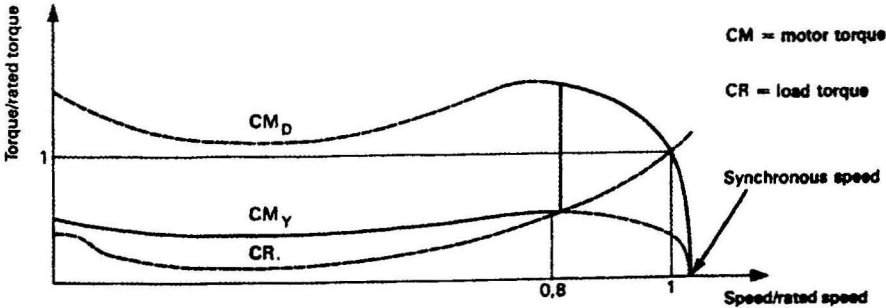


Figure 1 – Typical curves of currents and torques during a star-delta start (see 1.2.2.1)

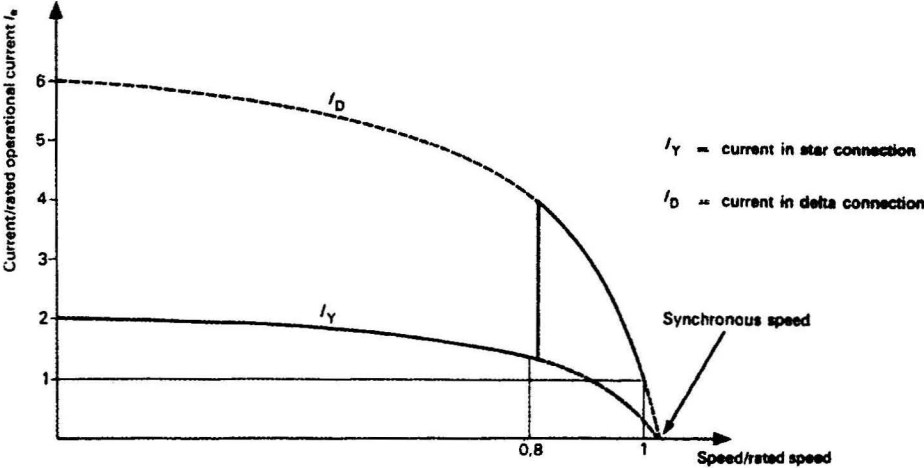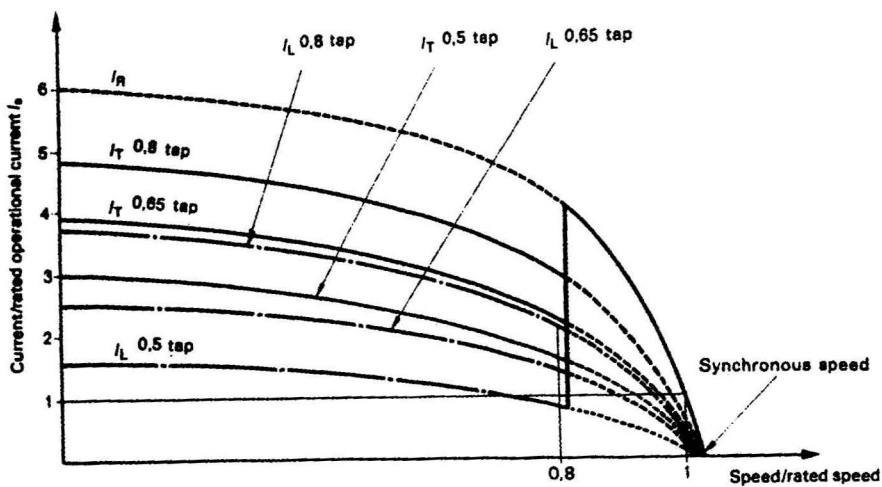


I_R = motor current at rated voltage
 I_T = motor current at reduced voltage
 I_L = line current at reduced voltage

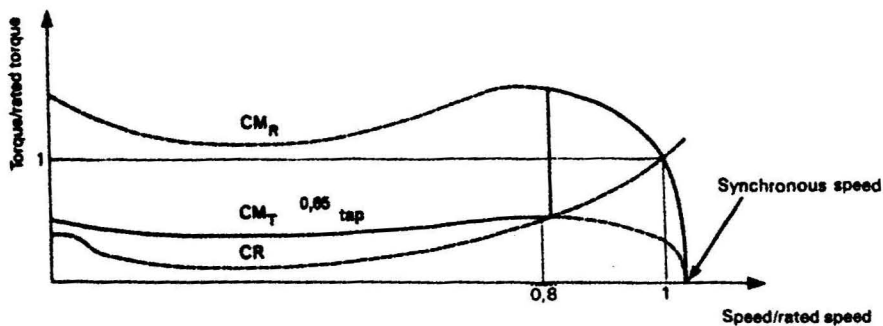

CR = load torque
 CM = motor torque


{	CM_R = at rated voltage
	CM_T = at reduced voltage

Figure 2 – Typical curves of currents and torques during an auto-transformer start (see 1.2.2.2)

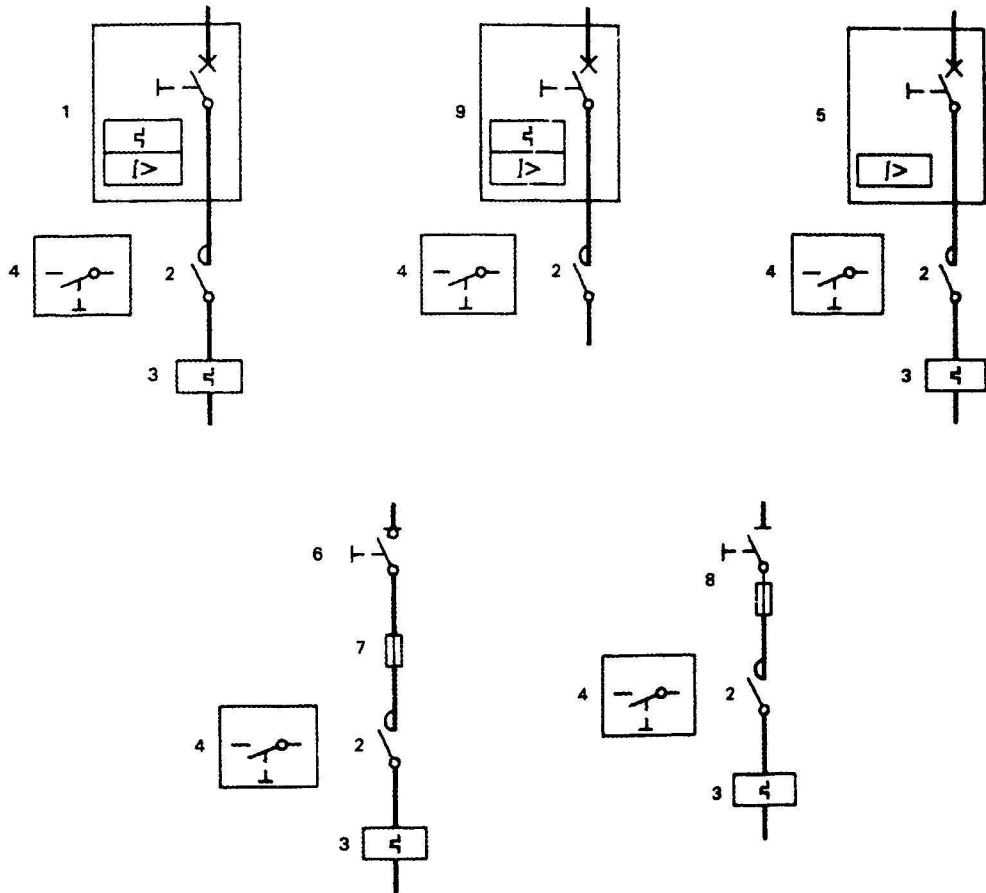

- 1 Circuit-breaker
- 2 Contactor
- 3 Overload relay
- 4 Control switch
- 5 Circuit-breaker magnetic trip only
- 6 Switch-disconnector
- 7 Fuse
- 8 Disconnector fuse
- 9 Circuit-breaker with overload release complying with this standard

**Figure 3 – Typical variants of combination starters (see 3.2.7)
and protected starters (see 3.2.8)**

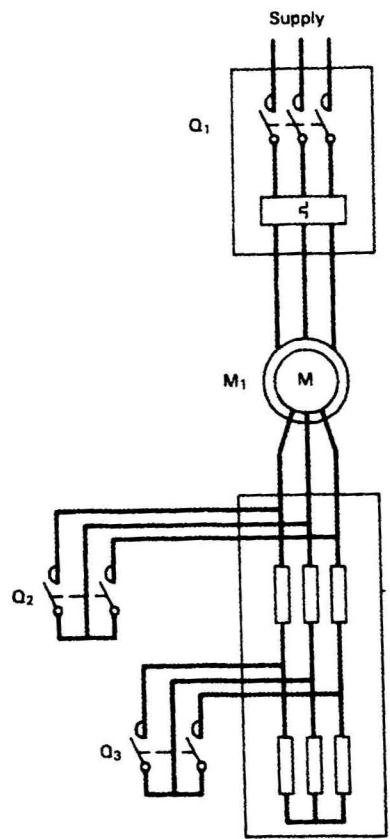

Position of the mechanical switching devices

Mechanical switching device \ Position of the starter	Starting				ON ↓
	Stop	1st step	2nd step	3rd step	
Q ₁	O	C	C	C	
Q ₂	O	O	O	C	
Q ₃	O	O	C	C	

O: mechanical switching device open

C: mechanical switching device closed

Figure 4 – Example of three-phase diagram of a rheostatic rotor starter with three starting steps (see 3.2.16) and one direction of rotation (in the case when all the mechanical switching devices are contactors)

SERIES
CLOSED TRANSITION

PARALLEL OPEN
OR CLOSED TRANSITION

PARALLEL
OPEN TRANSITION

Three-coil transformer

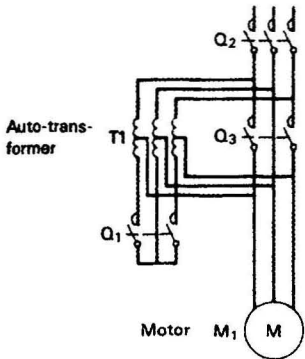


Diagram A₁

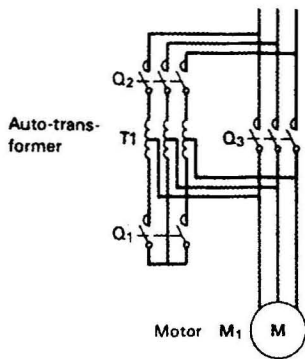


Diagram B₁

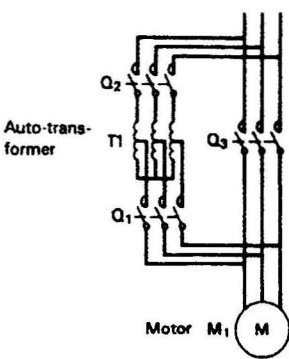


Diagram C₁

Two-coil transformer

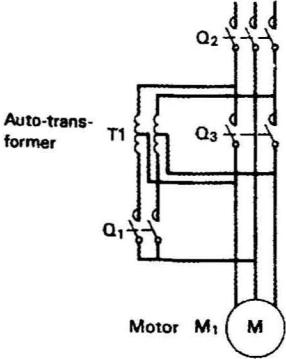


Diagram A₂

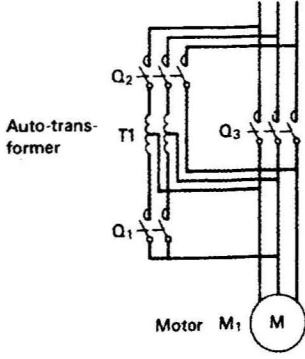


Diagram B₂

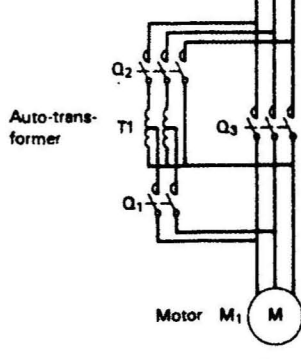


Diagram C₂

Contact sequence			
Contacts	Start	Transition	On
Q ₁	C	O	O
Q ₂	C	C	C
Q ₃	O	O	C

C = contact closed
O = contact open

Contact sequence					
Contacts	Start	Transition		1	2
		Open	Closed		
Q ₁	C	O	O	O	O
Q ₂	C	O	C	C	O
Q ₃	O	O	O	C	C

For open transition, Q₁ and Q₂ may be contacts of the same mechanical switching device

Contact sequence			
Contacts	Start	Transition	On
Q ₁	C	O	O
Q ₂	C	O	O
Q ₃	C	O	C

Q₁ and Q₂ may be contacts of the same mechanical switching device.

NOTE The graphical symbols utilized above correspond to the case where all the mechanical switching devices are contactors.

Figure 5 – Typical methods and diagrams of starting alternating-current induction motors by means of auto-transformers

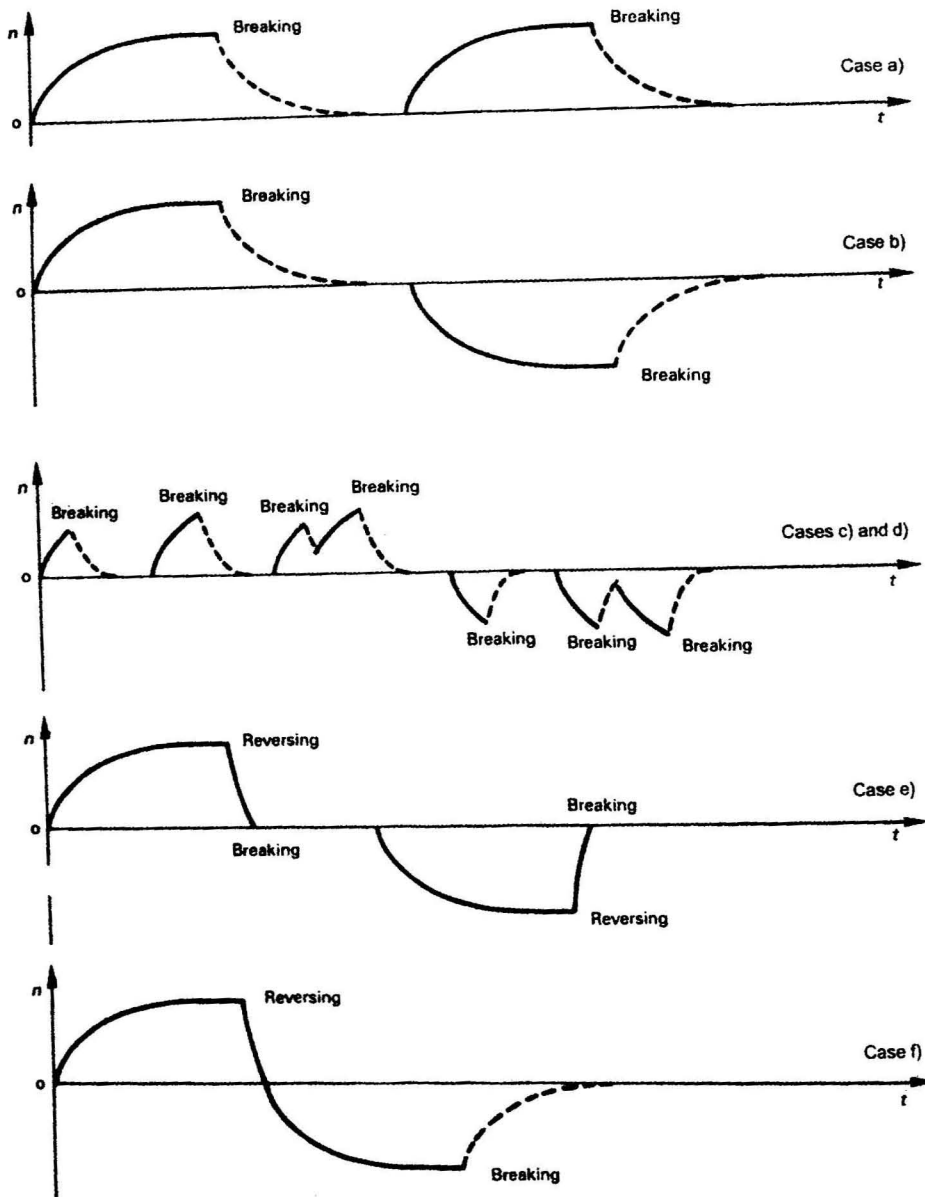


Figure 6 – Examples of speed/time curves corresponding to cases a), b), c), d), e) and f) of 5.3.5.5 (the dotted parts of the curves correspond to the periods when no current flows through the motor)

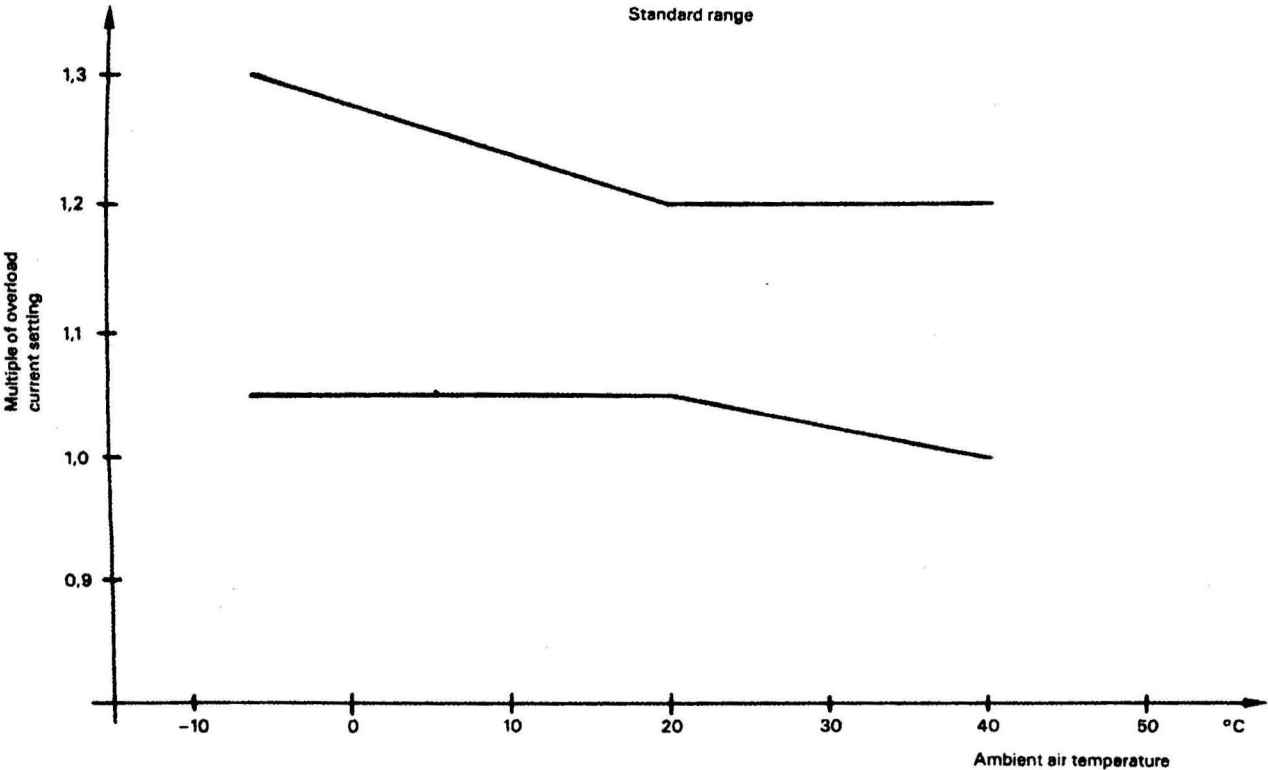


Figure 7 – Multiple of current setting limits for ambient air temperature compensated time-delay overload relays (see 8.2.1.5.1)

Annex A (normative)

Marking and identification of terminals of contactors and associated overload relays

A.1 General

The purpose of identifying terminals of contactors and associated overload relays is to provide information regarding the function of each terminal or its location with respect to other terminals or for other use.

A.2 Marking and identification of terminals of contactors


A.2.1 Marking and identification of terminals of coils

In the case of identification by alphanumeric markings, the terminals of a coil for an electromagnetic contactor shall be marked A1 and A2.




For a coil with tapplings, the terminals of the tapplings shall be marked in sequential order A3, A4, etc.

Examples:




NOTE As a consequence of this, both incoming and outgoing terminals may have even or odd numbers.

For a coil having two windings, the terminals of the first winding will be marked A1, A2 and those of the second winding B1, B2.



A.2.2 Marking and identification of terminals of main circuits

The terminals of the main circuits shall be marked by single figure numbers and an alphanumeric system.



NOTE The present alternative methods of marking, i.e. 1-2 and L1-T1, will be progressively superseded by the new method above.


Alternatively, terminals may be identified on the wiring diagram supplied with the device.

A.2.3 Marking and identification of terminals of auxiliary circuits

The terminals of auxiliary circuits shall be marked or identified on the diagrams by two figure numbers:

- the unit number is a function number;
- the figure of the tens is a sequence number.

The following examples illustrate such a marking system:


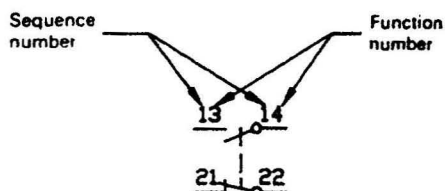


A.2.3.1 Function number

Function numbers 1, 2 are allocated to circuits with break contacts and function numbers 3, 4 to circuits with make contacts.


NOTE The definitions for make contacts and break contacts are given in 2.3.12 and 2.3.13 of part 1.

Examples:




NOTE The dots in the above examples take the place of the sequence numbers which should be added appropriately to the application.

The terminals of circuits with change-over contact elements shall be marked by the function numbers 1, 2 and 4.




Function numbers 5 and 6 (for break contacts) and 7 and 8 (for make contacts) are allocated to terminals of auxiliary circuits containing auxiliary contacts with special functions.

Examples:



The terminals of circuits with change-over contact elements with special functions shall be marked by function numbers 5, 6 and 8.

Example:



A.2.3.2 Sequence number


Terminals belonging to the same contact element shall be marked by the same sequence number.

All contact elements having the same function shall have different sequence numbers.

Examples:



The sequence number may be omitted from the terminals only if additional information provided by the manufacturer or the user clearly gives such a number.

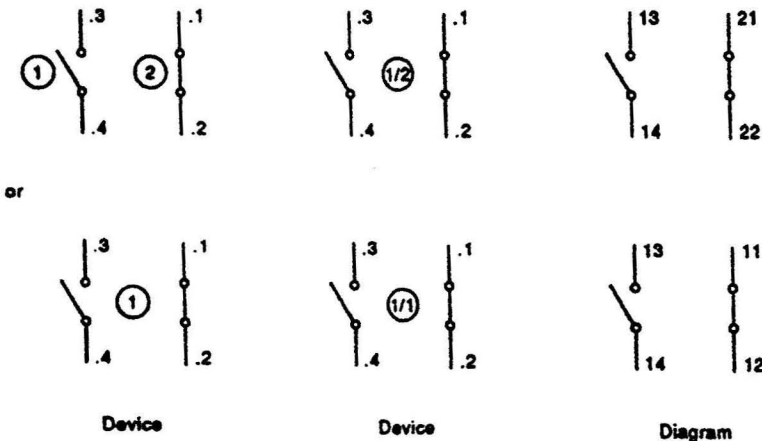

NOTE The dots shown in the above examples are merely used to show the relationship and do not need to be used in practice.





A.3 Marking and identification of terminals of overload relays

The terminals of the main circuits of overload relays shall be marked in the same manner as the terminals of the main circuits of contactors (see A.2.2).

The terminals of the auxiliary circuits of overload relays shall be marked in the same manner as the terminals of the auxiliary circuits of contactors with specified functions (see A.2.3).

The sequence number shall be 9; if a second sequence number is required, it shall be 0.

Examples:



Alternatively, terminals may be identified on the wiring diagram supplied with the device.

Annex B
(normative)

Special tests

B.1 General

Special tests are done at the discretion of the manufacturer.

B.2 Mechanical durability

B.2.1 General

By convention, the mechanical durability of a design of contactor or starter is defined as the number of no-load operating cycles which would be attained or exceeded by 90 % of all the apparatus of this design before it becomes necessary to service or replace any mechanical parts; however, normal maintenance including replacement of contacts as specified in B.2.2.1 and B.2.2.3 is permitted.

The preferred numbers of no-load operating cycles, expressed in millions, are:

0,001 – 0,003 – 0,01 – 0,03 – 0,1 – 0,3 – 1 – 3 and 10.

B.2.2 Verification of mechanical durability

B.2.2.1 Condition of the contactor or starter for tests

The contactor or starter shall be installed as for normal service; in particular, the conductors shall be connected in the same manner as for normal use.

During the test, there shall be no voltage or current in the main circuit. The contactor or starter may be lubricated before the test if lubrication is prescribed in normal service.

B.2.2.2 Operating conditions

The coils of the control electromagnets shall be supplied at their rated voltage and, if applicable, at their rated frequency.

If a resistance or an impedance is provided in series with the coils, whether short-circuited during the operation or not, the tests shall be carried out with these elements connected as in normal operation.

Pneumatic and electro-pneumatic contactors or starters shall be supplied with compressed air at the rated pressure.

Manual starters shall be operated as in normal service.

B.2.2.3 Test procedure

- a) The tests are carried out at the frequency of operations corresponding to the class of intermittent duty. However, if the manufacturer considers that the contactor or starter can satisfy the required conditions when using a higher frequency of operations, he may do so.

- b) In the case of electromagnetic and electro-pneumatic contactors or starters, the duration of energization of the control coil shall be greater than the time of operation of the contactor or starter and the time for which the coil is not energized shall be of such a duration that the contactor or starter can come to rest at both extreme positions.

The number of operating cycles to be carried out shall be not less than the number of no-load operating cycles stated by the manufacturer.

The verification of mechanical durability may be made separately on the various components of the starter which are not mechanically linked together, unless a mechanical interlock not previously tested with its contactor is involved.

- c) For contactors or starters fitted with releases with shunt coils or undervoltage releases, at least 10 % of the total number of opening operations shall be performed by these releases.
- d) After each tenth of the total number of operating cycles given in B.2.1 has been carried out, it is permissible before carrying on with the test:
- to clean the whole contactor or starter without dismantling;
 - to lubricate parts for which lubrication is prescribed by the manufacturer for normal service;
 - to adjust the travel and the pressure of the contacts if the design of the contactor or starter enables this to be done.
- e) This maintenance work shall not include any replacement of parts.
- f) In the case of star-delta starters, the built-in device causing time-delay between closing on star connection and closing on delta connection, if adjustable, may be set at its lowest value.
- g) In the case of rheostatic starters, the built-in device causing time-delay between closing of the rotor switching devices, if adjustable, may be set at its lowest value.
- h) In the case of auto-transformer starters, the built-in device causing time-delay between closing on the starting position and closing on the ON position, if adjustable, may be set at its lowest value.

B.2.2.4 Results to be obtained

Following the tests of mechanical durability, the contactor or starter shall still be capable of complying with the operating conditions specified in 8.2.1.2 and 9.3.3.2 at room temperature. There shall be no loosening of the parts used for connecting the conductors.

Any timing relays or other devices for the automatic control shall still be operating.

B.2.2.5 Statistical analysis of test results for contactors or starters

The mechanical durability of a design of a contactor or starter is assigned by the manufacturer and verified by a statistical analysis of the results of the tests.

For contactors or starters which are produced in small quantities, the tests described in B.2.2.6 and B.2.2.7 do not apply.

However, for contactors or starters which are produced in small quantities and which also differ from a basic design only by detailed variations (i.e. without any significant variation) without notable influence on characteristics, the manufacturer may assign mechanical durability on the basis of experience with similar designs, analysis, properties of materials, etc., and on the basis of the analysis of test results on large quantity production of the same basic design.

After this assignment, one of the two tests described below shall be performed. It should be selected by the manufacturer as being the most suitable in each case, for example according to the quantities of planned production or according to the conventional thermal current.

NOTE This test is not intended to be a lot-by-lot or production acceptance test for application by the user.

B.2.2.6 Single 8 test

Eight contactors or starters shall be tested to the assigned mechanical durability.

If the number of failures does not exceed two, the test is considered passed.

B.2.2.7 Double 3 test

Three contactors or starters shall be tested to the assigned mechanical durability.

The test is considered passed if there is no failure, and failed if there is more than one failure. Should there be one failure, then three additional contactors or starters are tested up to assigned mechanical durability and, providing there is no additional failure, the test is considered passed. The test is failed if at any time there is a total of two or more failures.

Explanatory note:

The single 8 test and the double 3 test are both given in IEC 60410 (see tables X-C-2 and X-D-2).

These two tests have been chosen with the objective of basing them on testing a limited number of contactors or starters on essentially the same statistical characteristics (acceptance quality level: 10 %).

B.3 Electrical durability

B.3.1 General

With respect to its resistance to electrical wear, a contactor or starter is by convention characterized by the number of on-load operating cycles corresponding to the different utilization categories given in table B.1 which can be made without repair or replacement.

Since, for star-delta, two-step auto-transformer and rheostatic rotor starters, the operation is subjected to large variations in the service conditions, it is deemed convenient not to give standard values for the test conditions. However, it is recommended that the manufacturer indicate the electrical durability of the starter for stated service conditions; this electrical durability may be estimated from the results of tests on the component parts of the starter.

For categories AC-3 and AC-4, the test circuit shall comprise inductors and resistors so arranged as to give the appropriate values of current, voltage and power factor given in table B.1; moreover, for AC-4, the test circuit testing the making and breaking capacity shall be used, see 9.3.3.5.2.

In all cases, the speed of operation shall be chosen by the manufacturer.

The tests shall be taken as valid if the values recorded in the test report differ from the values specified only within the following tolerances:

- current: $\pm 5\%$;
- voltage: $\pm 5\%$.

Tests shall be carried out with the contactor or the starter under the appropriate conditions of B.2.2.1 and B.2.2.2 using the test procedure, where applicable, of B.2.2.3, except that replacement of contacts is not permitted.

After the test, the contactor or the starter shall fulfil the operating conditions specified in 9.3.3.2 and withstand a dielectric test voltage given in 8.3.3.4.1, item 4) b), of IEC 60947-1, and applied as in 8.3.3.4.1, item 4), of IEC 60947-1, the test voltage being applied only:

- between all poles connected together and the frame of the contactor or starter, and
- between each pole and all the other poles connected to the frame of the contactor or starter.

In the case of starters, if the associated contactor has already satisfied an equivalent test, the test need not be repeated on the starter.

**Table B.1 – Verification of the number of on-load operating cycles –
Conditions for making and breaking corresponding to the several utilization categories**

Utilization category	Value of the rated operational current	Make			Break		
		I/I_e	U/U_e	$\cos \phi$ ¹⁾	I_c/I_e	U_r/U_e	$\cos \phi$ ¹⁾
AC-1	All values	1	1	0,95	1	1	0,95
AC-2	All values	2,5	1	0,65	2,5	1	0,65
AC-3	$I_e \leq 17A$	6	1	0,65	1	0,17	0,65
	$I_e > 17A$	6	1	0,35	1	0,17	0,35
AC-4	$I_e \leq 17A$	6	1	0,65	6	1	0,65
	$I_e > 17A$	6	1	0,35	6	1	0,35
		I/I_e	U/U_e	L/R ²⁾ ms	I_c/I_e	U_r/U_e	L/R ²⁾ ms
DC-1	All values	1	1	1	1	1	1
DC-3	All values	2,5	1	2	2,5	1	2
DC-5	All values	2,5	1	7,5	2,5	1	7,5
<p>I_e = rated operational current U_e = rated operational voltage I = current made In a.c. the conditions for making are expressed in r.m.s. values but it is understood that the peak value of symmetrical current corresponding to the power factor of the circuit may assume a higher value. U = applied voltage U_r = power-frequency or d.c. recovery voltage I_c = current broken</p>							
<p>¹⁾ Tolerance for $\cos \phi$: $\pm 0,05$ ²⁾ Tolerance for L/R: $\pm 15\%$</p>							

B.4 Co-ordination at the crossover current between the starter and associated SCPD

B.4.1 General and definitions

B.4.1.1 General

This annex states different methods of verifying the performance of starters and the associated SCPD(s) at currents below and above the intersection I_{co} of their respective time-current characteristics, provided by the starter and SCPD manufacturer(s), and the corresponding types of co-ordination described in 8.2.5.1.

Co-ordination at the crossover current between the starter and the SCPD can be verified either by the direct method with the special test of B.4.2 or, for type "2" co-ordination, by the indirect method as in B.4.5.

B.4.1.2 Definitions

B.4.1.2.1

crossover current I_{co}

current corresponding to the crossover point of the mean or published curves representing the time-current characteristics of the overload relay and the SCPD respectively

NOTE The mean curves are the curves corresponding to the average values calculated from the tolerances on the time-current characteristics given by the manufacturer.

B.4.1.2.2

test current I_{cd}

test current greater than I_{co} , tolerances included, designated by the manufacturer and verified by the requirements given in table B.2

B.4.1.2.3

time-current withstand characteristic capability of contactors/starters

locus of the currents a contactor/starter can withstand as a function of time

B.4.2 Condition for the test for the verification of co-ordination at the crossover current by a direct method

The starter and its associated SCPD shall be mounted and connected as in normal use. All the tests shall be performed starting from the cold state.

B.4.3 Test currents and test circuits

The test circuit shall be according to 8.3.3.5.2 of part 1 except that the oscillatory transient voltage need not be adjusted. The currents for the tests shall be:

- (i) $0,75 I_{co} \begin{smallmatrix} 0 \\ -5 \end{smallmatrix} \%$ and
- (ii) $1,25 I_{co} \begin{smallmatrix} +5 \\ 0 \end{smallmatrix} \%$

The power factor of the test circuit shall be in accordance with table 7. In the case of small relays having a high resistance, inductors should be mainly used in order to have a value of power factor as low as possible. The recovery voltage shall be 1,05 times the rated operational voltage.

The SCPD shall be as stated in 8.2.5.1 and of the same rating and characteristics as used in the tests of 9.3.4.2.

If the switching device is a contactor, its coil shall be energized from a separate source at the rated control supply voltage of the contactor coil and connected so that the contactor opens when the overload relay operates.

B.4.4 Test procedure and results to be obtained

B.4.4.1 Test procedure

With the starter and the SCPD closed, the test currents stated in B.4.3 shall be applied by a separate closing device. In each case the device tested shall be at room temperature.

After each test, it is necessary to inspect the SCPD, reset the overload relay and the release of the circuit-breaker, if necessary, or to replace all fuses if at least one of them has melted.

B.4.4.2 Results to be obtained

After the test at the lower current (i) in B.4.3, the SCPD shall not have operated and the overload relay or release shall have operated to open the starter. There shall be no damage to the starter.

After the test at the higher current (ii) in B.4.3, the SCPD shall have operated before the starter. The starter shall meet the conditions of 9.3.4.2.3 for the type of co-ordination stated by the manufacturer.

B.4.5 Verification of co-ordination at the crossover current by an indirect method

NOTE For type "1" co-ordination, the indirect method may be different from the method described in annex B and is under consideration. For this reason, the indirect method for the verification of co-ordination at the crossover point is only applicable for type "2" co-ordination.

The indirect method consists in verifying on a diagram (see figure B.1) that the following conditions for the verification of co-ordination at the crossover current are met:

- the time-current characteristic of the overload relay/release, starting from cold state, supplied by the manufacturer, shall indicate how the tripping time varies with the current up to a value of at least I_{co} ; this curve has to lie below the time-current characteristic of the SCPD up to I_{co} ;
- I_{cd} of the starter, tested as in B.4.5.1, shall be higher than I_{co} ;
- the time-current withstand characteristic of the contactor, tested as in B.4.5.2, shall be above the time-current characteristic (starting from cold state) of the overload relay up to I_{co} .

B.4.5.1 Test for I_{cd}

Subclause 9.3.4.1 applies with the following addition.

- **Test procedure:** the contactor or starter shall make and break the test current (I_{cd}) for the number of operating cycles given in table B.2 below. This is made without the SCPD in the circuit.

Table B.2 – Test conditions


	U_i/U_e	$\cos \phi$	On-time (see note 2) s	Off-time s	Number of operations
I_{cd}	1,05	See note 1	0,05	See note 3	3
NOTE 1 Power factor to be selected according to table 16 of IEC 60947-1.					
NOTE 2 Time may be less than 0,05 s provided that contacts are allowed to become properly seated before re-opening.					
NOTE 3 See table 7a.					

- Behaviour of contactors or starters during and after the I_{cd} test:
 - a) during the test, there shall be no permanent arcing, no flash-over between poles, no blowing of the fusible element in the earth circuit (see 9.3.4.1.2) and no welding of contacts;
 - b) after the test,
 - 1) the contacts shall operate correctly when the contactor or starter is switched by the applicable method of control;
 - 2) the dielectric properties of the contactors and starters shall be verified by a dielectric test on the contactor or starter using an essentially sinusoidal test voltage of twice the rated operational voltage U_e used for the I_{cd} test, with a minimum of 1 000 V. The test voltage shall be applied for 5 s, as specified in 9.3.3.4.2, item a)1).

B.4.5.2 Time-current characteristic withstand capability of contactors/starters


This characteristic is issued by the manufacturer and the values are obtained according to the test procedure specified in 9.3.5 but with combinations of overload currents and durations to establish the characteristic at least up to I_{co} , in addition to those stated in 8.2.4.4.

This characteristic is valid for overload currents, starting with the contactor at room temperature. The minimum cooling duration required by the contactor between two such overload tests should be stated by the manufacturer.

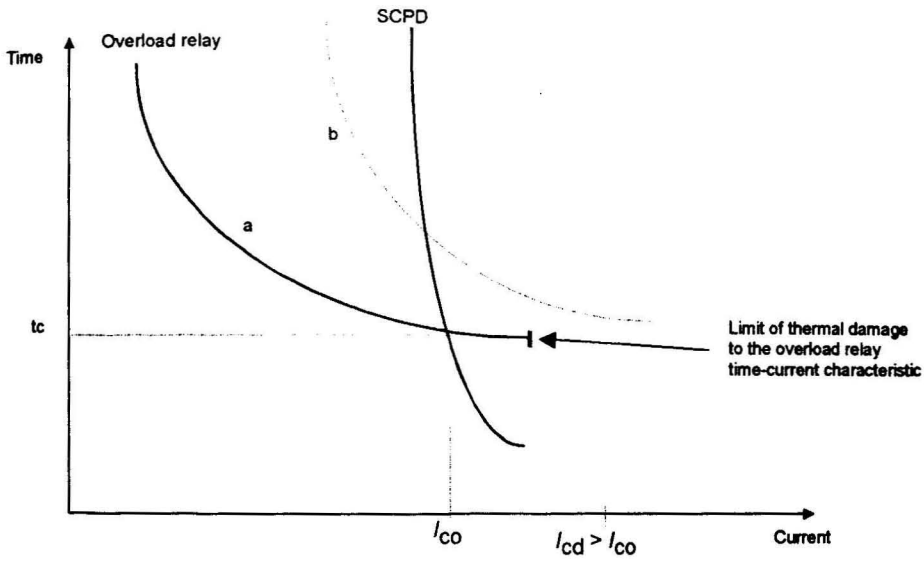

- a: mean overload relay time-current characteristic from cold state
 b: time-current characteristic withstand capability of contactor

Figure B.1a – Co-ordination with fuse

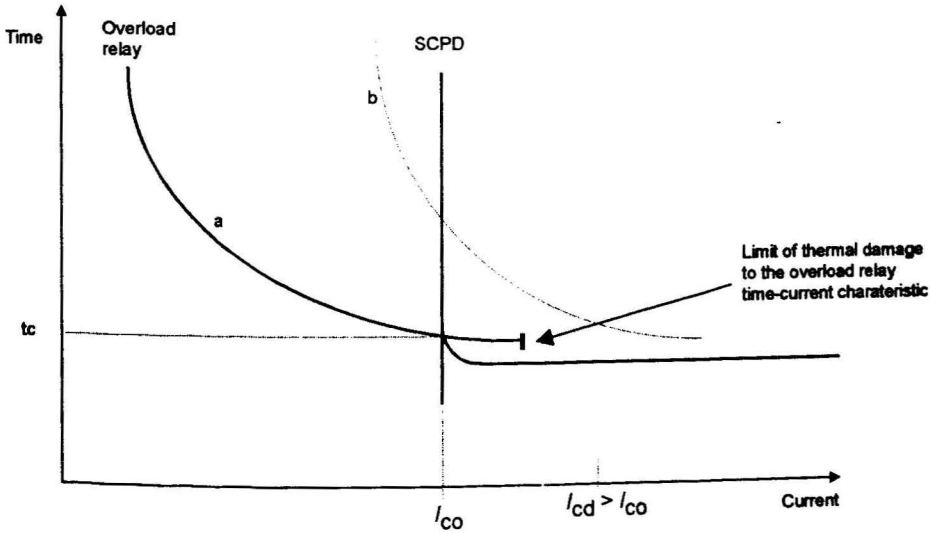

- a: mean overload relay time-current characteristic from cold state
 b: time-current characteristic withstand capability of contactor

Figure B.1b – Co-ordination with circuit-breaker

Figure B.1 – Examples of time-current withstand characteristic

Annex C

Void

8

Annex D (informative)

Items subject to agreement between manufacturer and user

NOTE For the purpose of this annex:

- *agreement* is used in a very wide sense;
- *user* includes testing stations.

Annex J of part 1 applies, as far as covered by clauses and subclauses of this standard, with the following additions.

Clause or subclause number of this standard	Item
1.2.3	Additional requirements concerning two-direction starters and inching and plugging
5.3.4.3 – Note	Overload protection of starters for intermittent duty
5.3.5.5.3	Time interval between two successive starts of auto-transformer starters having a starting time exceeding 15 s
5.4	Types of utilization other than the utilization categories defined in table 1
5.7.2	Specific applications of instantaneous over-current relays or releases and of relays or releases of a type other than those defined in 5.7.2
5.7.3	Protection of the rotor circuit for a rheostatic rotor starter
5.7.3	Protection of the auto-transformer for an auto-transformer starter
5.7.5	Tolerances on time-current characteristics of overload relays (to be indicated by the manufacturer)
5.10.2	Characteristics of devices for automatic acceleration control
5.11; 5.12	<p>Nature and dimensions of the connecting links:</p> <p>a) between an auto-transformer starter and the auto-transformer, if this is provided separately</p> <p>b) between a rheostatic rotor starter and the resistors, if these are provided separately</p> <p>Agreement for items a) and b) is to be concluded between the starter manufacturer and the manufacturer of the transformer, or of the resistors, as the case may be</p>
8.2.2.6.3	Ratings of specially rated windings (to be stated by the manufacturer)
Table 7	Verification of the make conditions when this verification is carried out during the make and break test (manufacturer's agreement)
Table 12	Value of the prospective current " I_s " for the conditional short-circuit current test of devices of $I_n > 1\,600\text{ A}$

Annex E
(informative)


Examples of control circuit configurations

E.1 External control device (ECD)

E.1.1 Definition of an ECD

Any external element which serves to effect the control of the contactor or starter.

E.1.2 Diagrammatic representation of an ECD

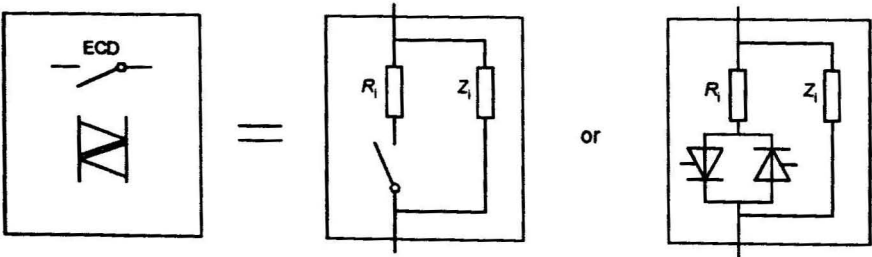

E.1.3 Parameters of an ECD


- R_i : internal resistance;
- Z_i : internal leakage impedance.

NOTE In the case where ECD is a mechanical push button, R_i is often neglected and Z_i is often taken as infinity (∞).


E.2 Control circuit configurations

E.2.1 Contactor or starter with external control supply


E.2.1.1 Single supply and control input

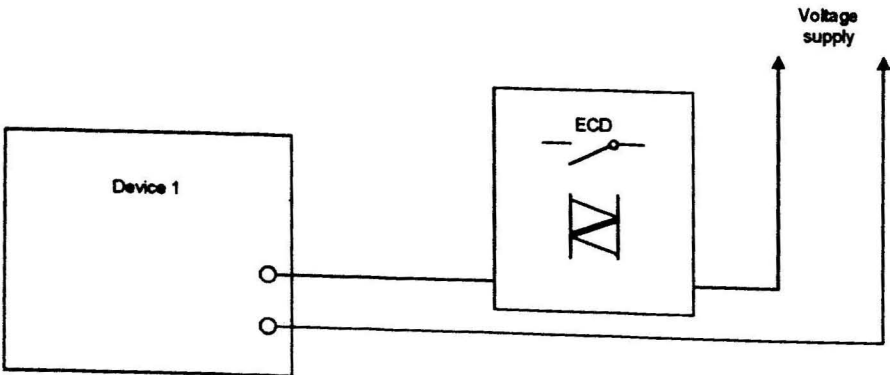


E.2.1.2 Separate supply and control inputs

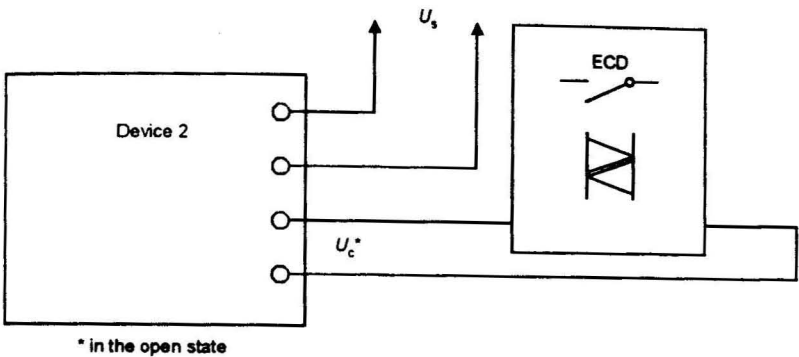


E.2.2 Contactor or starter with an internal control supply and control input only

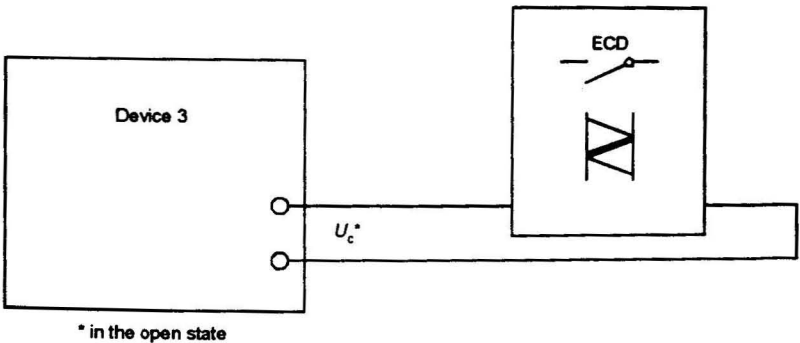

E.2.3 Contactor or starter with several external control supplies

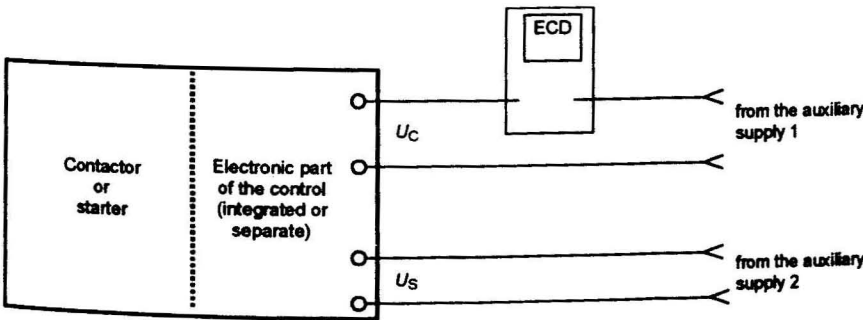

E.2.4 Contactor or starter with bus interface
(may be combined with other circuit configurations)

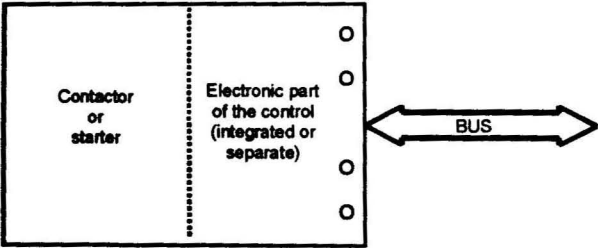

Annex F (normative)

Requirements for auxiliary contact linked with power contact (mirror contact)

F.1 Scope and object

F.1.1 Scope

This annex applies to auxiliary contacts mechanically linked with power contacts of a contactor and designated as mirror contacts in order to avoid any confusion with mechanically linked contact elements dealt within annex L of IEC 60947-5-1. However, that does not prevent a given auxiliary contact to comply with both requirements for mirror contact of this annex and for mechanically linked contact of annex L of IEC 60947-5-1.

NOTE 1 A typical application of mirror contacts is to have, in the machine control circuit, a highly reliable monitoring of the status of the contactor. However, mirror contact should not be relied upon exclusively as a means to ensure safety.

NOTE 2 Mirror contacts have previously been referred to as positively safety contacts, forced contacts, linked contacts or positively driven contacts.

F.1.2 Object

This annex provides additional specifications (definition, requirements and tests) which shall be used for stating the required design characteristics, marking and performance of mirror contact.

F.2 Definitions

The following additional definition applies.

F.2.1

mirror contact

normally closed auxiliary contact which cannot be in closed position simultaneously with the normally open main contact under conditions defined in clause F.7

NOTE One contactor may have more than one mirror contact.

F.3 Characteristics

All mirror contacts shall also comply with the relevant requirements given in this standard.

F.4 Product information

Clause 6 applies with the following addition.

Mirror contacts shall be clearly identified:

- on the contactor itself, or
- in the manufacturer documentation, or
- both.

Where a symbol is used to identify a mirror contact, it shall be as shown in figure F.1.



Figure F.1 – Mirror contact

F.5 Normal service, mounting and transport conditions

There are no supplementary requirements.

F.6 Constructional and performance requirements

Clause 8 applies with the following addition.

When any of the main contacts is closed, no mirror contact shall be closed.

NOTE Self-checking of the mirror contact circuit is recommended.

F.7 Tests

F.7.1 General

Clause 9 applies with the following addition.

Tests according to both F.7.2 and F.7.3 shall be carried out.

F.7.2 Tests on products in a new condition

For each mirror contact, the test shall be carried out on m products, where m is the number of main contacts.

A new product is used for testing each mirror contact with each of the main contacts.

The tests shall be carried out on products in a new and clean condition. The test procedure shall be as follows:

- a) To simulate the occurrence of welding on one main pole, one main contact shall be maintained in the closed position, e.g. by welding or gluing each point of contact (e.g. for double breaking contact, welding is carried out at the two contact points). The thickness of welding or gluing shall be such that the distance between contacts is not modified significantly and the method used shall be described in the test report.
- b1) With the operating coil de-energized, an impulse test voltage of 2,5 kV at sea level (correction should be made according to table F.1 given below, calculated from table 12 of IEC 60947-1) shall be applied across the mirror contact. There shall be no disruptive discharge.

Table F.1 – Test voltage according to altitude

Sea level	200 m	500 m	1 000 m	2 000 m
2,5 kV	2,37 kV	2,37 kV	2,29 kV	2,12 kV

NOTE This test ensures a minimum gap of 0,5 mm in accordance with figures A.1, A.2 and A.3 of IEC 60664-1 from which table 13 of IEC 60947-1 is issued.

- b2) As an alternative to b1), with the operating coil de-energized, the gap of the contact shall be measured with direct means; it shall be more than 0,5 mm. In case of two or more contact gaps in series, the sum of contact gaps shall be more than 0,5 mm.

The sequences a) and b) (b1) or b2)) are repeated on new samples for each main contact welded successively.

F.7.3 Test after conventional operational performance (defined under table 8)

At the end of the conventional operational performance tests according to 9.3.3.6, it shall be verified that, when the coil is energized, the mirror contact shall withstand its rated insulation voltage U_i .

Bibliography

IEC 60664-1:1992, *Insulation coordination for equipment within low-voltage systems – Part 1: Principles, requirements and tests*

AMENDMENT NO. 2

Change, throughout the standard, "solid state" by "electronic".

Page 3 and amendment 1, page 3

CONTENTS

Modify the title of Clause 3 to read:

3 Terms, definitions, symbols and abbreviations

Insert the following:

3.4 Symbols and abbreviations

Replace "5.9 Switching overvoltages" by "5.9 Vacant".

Add, on page 5, the title of the new Annexes G, H and I:

Annex G (informative) Rated operational currents and rated operational powers of switching devices for electrical machines

Annex H (normative) Extended functions within electronic overload relays

Annex I (informative) AC1 contactors for use with semiconductor controlled motor loads

Add, on page 5, the title of new Figures 8 and H.1:

Figure 8 – Thermal memory test

Figure H.1 – Test circuit for the verification of the operating characteristic of a residual current electronic overload relay

Modify, on page 5, the title of Table 2 to read:

Table 2 – Trip classes of overload relays

Modify, on page 5, the title of Table 4 to read:

Table 4 – Limits of operation of three-pole time-delay overload relays when energized on two poles only

Add, on page 7, the title of new Tables G.1 and H.1

Table G.1 – Rated operational power and currents

Table H.1 – Operating time of residual current electronic overload relays

Page 9

FOREWORD

Replace, on page 11, the two last paragraphs, by the following:

Annexes A, B, F and H form an integral part of this standard.

Annexes D, E, G and I are for information only.

2 Normative references

Replace the existing text of the first paragraph by the following:

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

Replace the reference to IEC 60034-1:1996 by the following:

IEC 60034-1:2004, *Rotating electrical machines – Part 1: Rating and performance*

Replace the reference to IEC 60034-11:1978 by the following:

IEC 60034-11:2004, *Rotating electrical machines – Part 11: Thermal protection*

Add, after IEC 60050(441), the following reference:

Amendment 1 (2000)

Replace the reference to IEC 60085:1984 by the following:

IEC 60085:2004, *Electrical insulation – Thermal classification*

Replace the reference to IEC 60112:1979 by the following:

IEC 60112:2003, *Method for the determination of the proof and the comparative tracking indices of solid insulating materials*

Replace the reference to IEC 60269-2-1:1998 by the following:

IEC 60269-2-1:2004, *Low-voltage fuses – Part 2-1: Supplementary requirements for fuses for use by authorized persons (fuses mainly for industrial application) – Sections I to VI: Examples of types of standardized fuses*

Replace the reference to IEC 60947-1:1999 by the following:

IEC 60947-1:2004, *Low-voltage switchgear and controlgear – Part 1: General rules*

Replace the reference to IEC 60947-2:1995 by the following:

IEC 60947-2:2003, *Low-voltage switchgear and controlgear – Part 2: Circuit-breakers*

Replace the reference to IEC 60947-5-1:1997 by the following:

IEC 60947-5-1:2003, Low-voltage switchgear and controlgear – Part 5-1: Control circuit devices and switching elements – Electromechanical control circuit devices

Replace the reference to IEC 61000-4-3:1995 by the following:

**IEC 61000-4-3:2002, Electromagnetic compatibility (EMC) – Part 4-3: Testing and measurement techniques – Radiated radio-frequency electromagnetic field immunity test
Amendment 1 (2002)**

Replace the reference to IEC 61810-1:1998 by the following:

IEC 61810-1:2003, Electromechanical elementary relays – Part 1: General and safety requirements

Replace the reference to CISPR 11:1997, by the following:

**CISPR 11:2003, Industrial, scientific and medical (ISM) radio-frequency equipment – Electromagnetic disturbance characteristics – Limits and methods of measurement
Amendment 1 (2004)**

Page 21

3 Definitions

Replace the existing title by the following:

3 Terms, definitions, symbols and abbreviations

Insert, after the first paragraph, the following alphabetical index of definitions:

	Reference
A	
Auto-transformer starter	3.2.5.2
C	
Close transition (with an auto-transformer starter or star-delta starter)	3.2.23
Combination starter	3.2.8
Combination switching device	3.2.27
Contactors (mechanical)	3.1.1
D	
Direct-on-line starter	3.2.2
E	
Electromagnetic contactor	3.1.2
Electromagnetic starter	3.2.10
Electronic overload relay with current or voltage asymmetry function	H.2.2
Electronic overload relay with phase reversal function	H.2.3
Electronic overload relay with residual current (earth fault) function	H.2.1
Electronically controlled coil for electromagnet	3.1.8
Electro-pneumatic contactor	3.1.4
Electro-pneumatic starter	3.2.13

Inching (jogging)	3.2.24
Inhibit current	H.2.5
Inhibit time	3.2.30
J	
Jam sensitive electronic overload relay	3.2.29
L	
Latched contactor	3.1.5
M	
Manual starter	3.2.9
Mirror contact	F.2.1
Motor-operated starter	3.2.11
N	
n-step starter	3.2.16
O	
Open transition (with an auto-transformer starter or star-delta starter)	3.2.22
Over-voltage sensitive electronic overload relay	H.2.4
P	
Phase loss sensitive thermal overload relay or release	3.2.17
Plugging	3.2.25
Pneumatic contactor	3.1.3
Pneumatic starter	3.2.12
Position of rest (of a contactor)	3.1.7
Protected starter	3.2.7
Protected switching device	3.2.26
R	
Reduced voltage starter	3.2.5
Reversing starter	3.2.3
Rheostatic rotor starter	3.2.6.2
Rheostatic starter	3.2.6
Rheostatic stator starter	3.2.6.1
S	
Single-step starter	3.2.14
Stall sensitive electronic overload relay	3.2.28
Star-delta starter	3.2.5.1
Starter	3.2.1
Starting time (of a rheostatic starter)	3.2.20
Starting time (of an auto-transformer starter)	3.2.21
T	
Two-direction starter	3.2.4
Two-step starter	3.2.15
U	
Under-current relay or release	3.2.18
Under-voltage relay or release	3.2.19
V	
Vacuum contactor (or starter)	3.1.6

3.2 Definitions concerning starters

Replace, on page 27, the existing definitions 3.2.7 and 3.2.8 by the following:

3.2.7

protected starter

equipment consisting of a starter, a manually-operated switching device and a short-circuit protective device, rated as a unit by the manufacturer

NOTE 1 The protected starter may or may not be enclosed.

NOTE 2 In the context of this standard, the term "manufacturer" means any person, company or organization with ultimate responsibility as follows:

- to verify compliance with the appropriate standard;
- to provide the product information according to Clause 6.

NOTE 3 The manually operated switching device and the short-circuit protective device may be just one device and may also incorporate the starter overload protection.

3.2.8

combination starter (see Figure 3)

equipment consisting of a protected starter, as defined in 3.2.7, incorporating an isolating function

Replace, on page 29, the existing definition 3.2.18 by the following:

3.2.18

under-current relay or release

measuring relay or release which operates automatically when the current through it is reduced below a predetermined value

Add to the definition 3.2.19 the following note:

NOTE The starting time of a starter is shorter than the total starting time of the motor which also takes into account the last period of acceleration following the switching operation to the ON position.

Replace, on definition 3.2.20, the existing note by the following:

NOTE The starting time of a starter is shorter than the total starting time of the motor which also takes into account the last period of acceleration following the switching operation to the ON position.

Renumber definitions 3.2.19 to 3.2.24 as 3.2.20 to 3.2.25.

Insert, on page 29, after definition 3.2.18, the following new definition 3.2.19:

3.2.19

under-voltage relay or release

measuring relay or release which operates automatically when the voltage applied to it is reduced below a predetermined value

Add, on page 29, after definition 3.2.25, the following new definitions 3.2.26 to 3.2.30:

3.2.26

protected switching device

equipment (for non motor loads) consisting of a contactor or a semiconductor controller, overload protection, a manually operated switching device and a short-circuit protective device, rated as a unit by the manufacturer

NOTE 1 The protected switching device may or may not be enclosed.

NOTE 2 In the context of this standard, the term "manufacturer" means any person, company or organization with ultimate responsibility as follows:

- to verify compliance with the appropriate standard;
- to provide the product information according to Clause 6.

NOTE 3 The manually operated switching device and the short-circuit protective device may be just one device and may incorporate the overload protection as well.

3.2.27

combination switching device

equipment consisting of a protected switching device, as defined in 3.2.26, incorporating an isolating function

3.2.28

stall sensitive electronic overload relay

electronic overload relay which operates when the current has not decreased below a predetermined value for a specific period of time during start-up or when the relay receives the input indicating there is no rotation of the motor after a predetermined time in accordance with specified requirements

NOTE Explanation of stall: rotor locked during start.

3.2.29

jam sensitive electronic overload relay

electronic overload relay which operates in the case of overload and also when the current has increased above a predetermined value for a specific period of time during operation, in accordance with specified requirements

NOTE Explanation of jam: high overload occurring after the completion of starting which causes the current to reach the locked rotor current value of the motor being controlled.

3.2.30

inhibit time

time-delay period during which the tripping function of the relay is inhibited (may be adjustable)

Page 31

Add, after definition 3.3.1, the following new subclause:

3.4 Symbols and abbreviations

AQL	Acceptable quality level
EMC	Electromagnetic compatibility
I_c	Current made and broken (Table 7)
I_e	Rated operational current (5.3.2.5)
I_{er}	Rated rotor operational current (5.3.2.7)

I_{es}	Rated stator operational current (5.3.2.6)
I_{ic}	Inhibit current (H.2.5)
I_{th}	Conventional free air thermal current (5.3.2.1)
I_{the}	Conventional enclosed thermal current (5.3.2.2)
I_{thr}	Conventional rotor thermal current (5.3.2.4)
I_{ths}	Conventional stator thermal current (5.3.2.3)
I_u	Rated uninterrupted current (5.3.2.8)
SCPD	Short-circuit protective device
T_p	Tripping time (Table 2)
U_c	Rated control circuit voltage (5.5)
U_e	Rated operational voltage (5.3.1.1)
U_{er}	Rated rotor operational voltage (5.3.1.1.2)
U_{es}	Rated stator operational voltage (5.3.1.1.1)
U_i	Rated insulation voltage (5.3.1.2)
U_{imp}	Rated impulse withstand voltage (5.3.1.3)
U_{ir}	Rated rotor insulation voltage (5.3.1.2.2)
U_{is}	Rated stator insulation voltage (5.3.1.2.1)
U_r	Power frequency or d.c. recovery voltage (Table 7)
U_s	Rated control supply voltage (5.5)

5.1 Summary of characteristics

Delete the eighth dashed item: "– switching overvoltages (5.9);"

Page 37

5.3.2.6 Rated operational currents (I_e) or rated operational powers

Insert, after the second paragraph, the following note:

NOTE Annex G gives values concerning the relationship between rated operational currents and rated operational powers.

Page 45

5.3.5.5.1 Starting characteristics of rheostatic rotor starters

Replace, for t_s , "(see 3.2.19)" by "(see 3.2.20)".

Page 47

5.3.5.5.3 Starting characteristics for two-step auto-transformer starters

Replace, in the first sentence, "(see 3.2.20)" by "(see 3.2.21)".

5.7.2 Types of relay or release

Replace under item c), items 2) and 3) by the following new items 2) and 3):

- 2) dependent on previous load (e.g. thermal or electronic overload relay);
- 3) dependent on previous load (e.g. thermal or electronic overload relay) and also sensitive to phase loss (see 3.2.17).

Replace items d) and e) by the following new items d) and e):

- d) Instantaneous over-current relay or release (e.g. jam sensitive, see 3.2.29).
- e) Other relays or releases (e.g. control relay associated with devices for the thermal protection of the motor).

Delete the existing note.

Add, after item e), the following new item f):

- f) Stall relay or release.

5.7.3 Characteristic values

Replace the existing item a) by the following new item a):

- a) Release with shunt coil, under-voltage (under-current), over-voltage (instantaneous over current), current or voltage asymmetry and phase reversal opening relay or release:
 - rated voltage (current);
 - rated frequency;
 - operating voltage (current);
 - operating time (when applicable);
 - inhibit time (when applicable).

Replace, in item b), fourth dashed item, "30 s" by "40 s".

Modify, in item b), the text of the sixth dashed item to read:

"nature of the relay: thermal, magnetic, electronic or electronic without thermal memory."

Add, after item b), the following new item c):

- c) Release with residual current sensing relay:
 - rated current;
 - operating current;
 - operating time or time-current characteristic according to Table H.1 ;
 - inhibit time (when applicable);
 - type designation (see Annex H).

Table 2 – Trip classes of thermal, time-delay magnetic or electronic overload relays

Replace the existing table, including the title, by the following:

Table 2 – Trip classes of overload relays

Trip class	Tripping time T_p under the conditions specified in 8.2.1.5.1, Table 3, column D ^a	Tripping time T_p under the conditions specified in 8.2.1.5.1, Table 3, column D for tighter tolerances (tolerance band E) ^a
	s	s
2	–	$T_p \leq 2$
3	–	$2 < T_p \leq 3$
5	$0,5 < T_p \leq 5$	$3 < T_p \leq 5$
10A	$2 < T_p \leq 10$	–
10	$4 < T_p \leq 10$	$5 < T_p \leq 10$
20	$6 < T_p \leq 20$	$10 < T_p \leq 20$
30	$9 < T_p \leq 30$	$20 < T_p \leq 30$
40	–	$30 < T_p \leq 40$

^a The manufacturer shall add the letter E to trip classes to indicate compliance with the band E.

NOTE 1 Depending on the nature of the relay, the tripping conditions are given in 8.2.1.5.

NOTE 2 In the case of a rheostatic rotor starter, the overload relay is commonly inserted in the stator circuit. As a result, it cannot efficiently protect the rotor circuit and more particularly the resistors (generally more easily damageable than the rotor itself or the switching devices in case of a faulty start); protection of the rotor circuit should be the subject of a specific agreement between manufacturer and user (see, inter alia, 8.2.1.1.3).

NOTE 3 In the case of a two-step auto-transformer starter, the starting auto-transformer is normally designed for use during the starting period only; as a result, it cannot be efficiently protected by the overload relay in the event of faulty starting. Protection of the auto-transformer should be the subject of specific agreement between manufacturer and user (see 8.2.1.1.4).

NOTE 4 The lower limiting values of T_p are selected to allow for differing heater characteristics and manufacturing tolerances.

5.9 Switching overvoltages

Replace the existing title and text by the following:

5.9 Vacant

Page 61

6.1.2 Characteristics, basic rated values and utilization

Modify the text of item m), second paragraph, to read:

"rated conditional short-circuit current (see 5.3.6) of the combination starter, the combination switching device, the protected starter or the protected switching device and type of co-ordination (see 8.2.5.1);"

Modify the text of item n) to read:

"Vacant".

Modify the text of item s) to read:

"characteristics according to 5.7, specifying if the electronic overload relay does not contain thermal memory."

Page 63 and amendment 1, page 11

6.2 Marking

Add, at the end of this subclause, the following new paragraph:

If the manufacturer declares an electronic overload relay without thermal memory, this shall be marked on the device.

Page 65

8.1 Constructional requirements

Delete the note.

8.1.1 Materials

Replace the existing text of this subclause by the following:

Subclause 7.1.1 of IEC 60947-1 applies with the following additions.

The manufacturer shall specify which test method is to be used.

When tests on the equipment or on sections taken from the equipment are used, parts of insulating materials necessary to retain current-carrying parts in position shall conform to the glow-wire tests of 8.2.1.1.1 at a test temperature of 850 °C.

Parts of insulating materials other than those specified in the previous paragraph shall conform to the requirements of the glow-wire test of 8.2.1.1.1 at a temperature of 650 °C.

When tests on materials are used, they shall be made according to the tests for flammability category, hot wire ignition and, where applicable, arc ignition, as specified in 8.2.1.1.2. of IEC 60947-1. The material used shall comply with the values given in Table M.1 of IEC 60947-1 according to the manufacturer's chosen flammability category (see IEC 60695-11-10).

8.1.2 Current-carrying parts and their connections

Delete the text between brackets.

Page 69

8.2.1.5 Limits of operation of current operated relays and releases

Replace the existing title of this subclause by the following:

8.2.1.5 Limits of operation of current sensing relays and releases

Page 71 and amendment 1, page 15

8.2.1.5.1 Limits of operation of time-delay overload relays when all poles are energized

Insert, before the first paragraph, the following title and note:

8.2.1.5.1.1 General tripping requirements of overload relays

NOTE 1 The thermal protection of motors in the presence of harmonics in the supply voltage is under consideration.

Replace the existing item c) by the following:

- c) for class 2, 3, 5 and 10A overload relays energized at C times the current setting, tripping shall occur in less than 2 min starting from thermal equilibrium, at the current setting, in accordance with 9.3.3 of IEC 60034-1;

NOTE 2 Subclause 9.3.3 of IEC 60034-1 states: "Polyphase motors having rated outputs not exceeding 315 kW and rated voltages not exceeding 1 kV shall be capable of withstanding a current equal to 1,5 times the rated current for not less than 2 min."

Replace the existing item e) by the following:

- e) at D times the current setting, tripping shall occur within the limits given in Table 2 for the appropriate trip class and tolerance band, starting from the cold state.

Renumber the last note of this subclause as "NOTE 3".

Replace, in the last paragraph, "figure 7" by "Table 3".

Table 3 – Limits of operation of time-delay overload relays when energized on all poles

Replace the existing table by the following new table:

Type of overload relay	Multiples of current setting				Ambient air temperature values
	A	B	C	D	
Thermal type not compensated for ambient air temperature variations	1,0	1,2	1,5	7,2	-5 °C, +20 °C and +40 °C
Thermal type compensated for ambient air temperature variations	1,05	1,3	1,5	–	-5 °C
	1,05	1,2	1,5	7,2	+20 °C
	1,0	1,2	1,5	–	+40 °C
Electronic type	1,05	1,2	1,5	7,2	-5 °C, +20 °C and +40 °C

Add the following new subclause:

8.2.1.5.1.2 Thermal memory test verification

Unless the manufacturer has specified that the device does not contain thermal memory, electronic overload relays shall fulfil the following requirements (see Figure 8):

- apply a current equal to I_e until the device has reached the thermal equilibrium;
- interrupt the current for a duration of $2 \times T_p$ (see Table 2) with a relative tolerance of $\pm 10\%$ (where T_p is the time measured at the D current according to Table 3);
- apply a current equal to $7,2 \times I_e$;
- the relay shall trip within 50 % of the time T_p .

Page 73

8.2.1.5.2 Limits of operation of three-pole thermal overload relays energized on two poles

Replace the existing title of this subclause by the following:

8.2.1.5.2 Limits of operation of three-pole time-delay overload relays energized on two poles

Replace the existing text of the last paragraph by the following:

In the case of overload relays having an adjustable current setting, the characteristics shall apply both when the relay is carrying the current associated with the maximum setting and when the relay is carrying the current associated with the minimum setting.

Table 4 – Limits of operation of three-pole thermal overload relays when energized on two poles only

Replace the existing table, including the title, by the following:

Table 4 – Limits of operation of three-pole time-delay overload relays when energized on two poles only

Type of overload relay	Multiples of current setting		Reference ambient air temperature
	A	B	
Thermal, compensated for ambient air temperature variations or electronic Not phase loss sensitive	3 poles 1,0	2 poles 1,32 1 pole 0	+20 °C
Thermal, not compensated for ambient air temperature variations Not phase loss sensitive	3 poles 1,0	2 poles 1,25 1 pole 0	+40 °C
Thermal, compensated for ambient air temperature variations or electronic Phase loss sensitive	2 poles 1,0 1 pole 0,9	2 poles 1,15 1 pole 0	+20 °C

8.2.1.5.4 Limits of operation of automatic change over by under-current relays

Replace the existing title and text of this subclause by the following:

8.2.1.5.4 Limits of operation of under-current relays and releases for automatic change over**8.2.1.5.4.1 Limits of operation of under-current relays**

An under-current relay or release, when associated with a switching device, shall operate to open the switching device within 90 % to 110 % of the set time when the current during operation is below 0,9 times the under-current setting in all poles.

8.2.1.5.4.2 Limits of operation of automatic change over by under-current relays

- for star-delta starters from star to delta, and
- for auto-transformer starters from the starting to the ON position.

The lowest drop-out current of an under-current relay shall be not greater than 1,5 times the actual current setting of the overload relay which is active in the starting or star connection. The under-current relay shall be able to carry any value of current, from its lowest current setting to the stalled current in the starting position or the star connection, for the tripping times determined by the overload relay at its highest current setting.

Page 75

Add, after 8.2.1.5.4, the following new subclauses 8.2.1.5.5 and 8.2.1.5.6:

8.2.1.5.5 Limits of operation of stall relays

A stall relay, when associated with a switching device, shall operate to open the switching device within 80 % to 120 % of the set time (stall inhibit time) or within the accuracy specified by the manufacturer, when:

- a) current sensing relays: the current is 20 % higher than the set stall current value;

EXAMPLE: Set current of the stall relay: 100 A; set time: 6 s; accuracy: $\pm 10\%$, the relay shall trip within 5,4 s and 6,6 s when the current is equal to or greater than $100\text{ A} \times 1,2 = 120\text{ A}$.

- b) rotation sensing relays: an input signal indicating no motor rotation exists.

8.2.1.5.6 Limits of operation of jam relays and releases

A jam relay or release, when associated with a switching device, shall operate to open the switching device within 80 % to 120 % of the set time (jam inhibit time) or within the accuracy specified by the manufacturer, when the current is above 1,2 times the set current value of the jam relay, during running after completion of the starting.

8.2.2 Temperature rise

Replace the existing text of the first paragraph by the following:

The requirements of 7.2.2 of IEC 60947-1 apply to contactors and starters in a clean, new condition.

Add, after the note, the following new subclauses 8.2.2.1, 8.2.2.2 and 8.2.2.3:

8.2.2.1 Terminals

Subclause 7.2.2.1 of IEC 60947-1 applies.

8.2.2.2 Accessible parts

Subclause 7.2.2.2 of IEC 60947-1 applies.

8.2.2.3 Ambient air temperature

Subclause 7.2.2.3 of IEC 60947-1 applies.

Table 5 – Temperature rise limits for insulated coils in air and in oil

Modify the heading of the first column to read:

"Class of insulating material (according to IEC 60085)"

Delete the existing note.

Page 87

8.2.5.1 Performance under short-circuit conditions (rated conditional short-circuit current)

Modify the first paragraph to read:

" ... by short-circuit protective device(s) (SCPD(s)), combination starters, combination switching devices, protected starters and protected switching devices shall be verified by ..."

Page 89

8.2.6 Switching overvoltages

Replace the existing title and text by the following:

8.2.6 Vacant

8.2.7 Additional requirements for combination starters and protected starters suitable for isolation

Modify the title to read:

8.2.7 Additional requirements for combination starters, combination switching devices, protected starters and protected switching devices suitable for isolation

Page 93

9.1.3 Routine tests

Correction in French only.

Page 99 and amendment 1, page 19

9.3.3.2.2 Relays and releases

Replace, in item a), the reference to subclause "8.2.1.3" by "8.2.1.3.1".

Replace the existing title and text of item c) by the following:

c) Thermal, electronic and time-delay magnetic overload relays

Overload relays and starters shall be connected using conductors in accordance with Tables 9, 10 and 11 of IEC 60947-1 for test currents corresponding to:

- 100 % of the current setting of the overload relay for overload relays of trip classes 2, 3, 5 and 10 A for all overload relay types (see Table 2) and 10, 20, 30 and 40 for electronic overload relay types;

- 125 % of the current setting of the overload relay for thermal overload relays of trip classes 10, 20, 30 and 40 (see Table 2) and for overload relays for which a maximum tripping time greater than 40 s is specified (see 5.7.3).

It shall be verified that relays and releases operate according to the requirements of 8.2.1.5.1 with all poles energized.

Moreover, the characteristics defined in 8.2.1.5.1 shall be verified by tests at -5°C , $+20^{\circ}\text{C}$, $+40^{\circ}\text{C}$ and may be verified at minimum and maximum temperatures given by the manufacturer if larger. However, for relays or releases declared compensated for ambient temperature, in case of temperature range declared by the manufacturer larger than those given in Figure 7, the characteristics at -5°C and/or $+40^{\circ}\text{C}$ need not be verified if, when tested at the declared minimum and maximum temperatures, the corresponding tripping current values are in compliance with the limits specified for -5°C and/or $+40^{\circ}\text{C}$ in that figure.

For electronic overload relays, the thermal memory test verification of 8.2.1.5.1.2 shall be carried out at $+20^{\circ}\text{C}$.

Three-pole thermal or electronic overload relays energized on two poles only shall be tested as stated in 8.2.1.5.2 on all combinations of poles and at the maximum and minimum current settings for relays with adjustable settings.

Replace the existing title and text of item e) by the following:

e) Under-current relays

The limits of operation shall be verified in accordance with 8.2.1.5.4.1.

Add, after item e), the following new items f) to h):

f) Under-current relays in automatic change-over

The limits of operation shall be verified in accordance with 8.2.1.5.4.2.

g) Stall relays

The limits of operation shall be verified in accordance with 8.2.1.5.5.

For current sensing stall relays, the verification shall be made for the minimum and for the maximum set current values and for the minimum and maximum stall inhibit time (four settings).

For stall relays operating in conjunction with a rotation sensing mean, the verification shall be made for the minimum and maximum stall inhibit time. The sensor can be simulated by an appropriate signal on the sensor input of the stall relay.

h) Jam relays

The limits of operation shall be verified in accordance with 8.2.1.5.6.

The verification shall be made for the minimum and for the maximum set current values and for the minimum and maximum jam inhibit time (four settings).

For each of the four settings, the test shall be made under the following conditions:

- apply a test current of 95 % of the set current value. The jam relay shall not trip;
- increase the test current to 120 % of the set current value. The jam relay shall trip according to the requirements given in 8.2.1.5.6.

Page 109

9.3.3.5.4 Switching overvoltages

Replace the existing title and text by the following:

9.3.3.5.4 Vacant

Page 115 and amendment 1, page 21

9.3.3.6.6 Behaviour of the contactor or starter during, and its condition after, the conventional operational performance tests

Add, at the end of this subclause, the following:

For equipment provided with mirror contacts, the additional test of F.7.3 shall be carried out.

Page 117

9.3.4.1.6 Test procedure

Modify the existing text of the second paragraph to read:

"The contactor or the starter and its associated SCPD, or the combination starter, the combination switching device, the protected starter or the protected switching device, shall be mounted and connected ..."

9.3.4.2 Conditional short-circuit current of contactors, starters, combination starters and protected starters

Modify the title to read:

9.3.4.2 Conditional short-circuit current of contactors, starters, combination starters, combination switching devices, protected starters and protected switching devices

Modify the existing text of the first paragraph to read:

"The contactor or starter and the associated SCPD, or the combination starter, the combination switching device, the protected starter or the protected switching device, shall be subjected to the tests given ..."

Page 119

9.3.4.2.1 Test at the prospective current " I_r "

Modify the existing text of the second paragraph to read:

"The contactor or starter and the associated SCPD, or the combination starter, the combination switching device, the protected starter or the protected switching device, shall then be connected ..."

9.3.4.2.2 Test at the rated conditional short-circuit current I_q

Replace the existing text of the third paragraph as follows:

The contactor or starter and the associated SCPD, or the combination starter, the combination switching device, the protected starter or the protected switching device, shall then be connected to the circuit.

Replace, on page 121, item b), the existing text of the second paragraph, as follows:

If, in the case of a combination starter, a combination switching device, a protected starter or a protected switching device, the switching device of the SCPD complies with IEC 60947-2 or IEC 60947-3 and has a short-circuit breaking capacity or rated conditional short-circuit current less than the rated conditional short-circuit current of the combination starter, the combination switching device, the protected starter or the protected switching device, the following additional test shall be made.

Page 121

9.3.4.2.3 Results to be obtained

Modify the existing text of the first paragraph to read:

"The contactor, starter, or the combination starter, the combination switching device, the protected starter or the protected switching device, shall be considered to have passed the tests at ..."

Modify the existing text of paragraph "A" to read:

"A The fault current has been successfully interrupted by the SCPD, the combination starter or the combination switching device and the fuse or fusible element ..."

Replace the sentence between paragraph "D" and paragraph "E" by the following:

Both types of co-ordination (combination starters, combination switching devices, protected starters and protected switching devices only):

Modify the existing text of paragraph "G" to read:

"G If a circuit-breaker with rated ultimate short-circuit breaking capacity less than the rated conditional short-circuit current assigned to the combination starter, the combination switching device, the protected starter or the protected switching device is employed, the circuit-breaker ..."

Modify, on page 123 and amendment 1, page 23, the existing text of paragraph "L" to read:

"L The adequacy of the insulation in accordance with 8.3.3.4.1, item 4), of IEC 60947-1 shall be verified by a dielectric test on the contactor, the starter, the combination starter, the combination switching device, the protected starter or the protected switching device, using a power frequency withstand voltage of twice the rated operational voltage U_e but not less than 1 000 V.

In the case of combination starters, combination switching devices, protected starters and protected switching devices, additional tests according to 8.3.3.4.1, item 3), of IEC 60947-1 shall be made ..."

Page 125

9.3.6.2 Operation and operating limits

Replace the existing text of the third paragraph by the following:

Tests shall be made to verify the calibration of relays. In the case of a time delay overload relay, this may be a single test with all poles equally energized at a multiple of the current setting, to check that the tripping time conforms (within tolerances) to the curves supplied by the manufacturer; in the case of an instantaneous magnetic overload relay, the test shall be carried out at 1,1 times the current setting. For under-current relays, stall relays and jam relays, tests shall be carried out to verify the proper operation of these relays (see 8.2.1.5.4, 8.2.1.5.5 and 8.2.1.5.6).

Page 127

Table 13 – EMC immunity tests

Replace, in the first column, "IEC 61000-4-5" by "IEC 61000-4-5 ^a"

Introduce, in the table, the following new footnote ^a:

^a Not applicable for ports with a rated voltage of 24 V d.c. or less.

Page 137

Figure 3 – Typical variants of combination starters (see 3.2.7) and protected starters (see 3.2.8)

Replace the title by the following:

Figure 3 – Typical variants of protected starters (see 3.2.7), combination starters (see 3.2.8), protected switching devices (see 3.2.26) and combination switching devices (see 3.2.27)

Add, after Figure 7, the following new Figure 8:

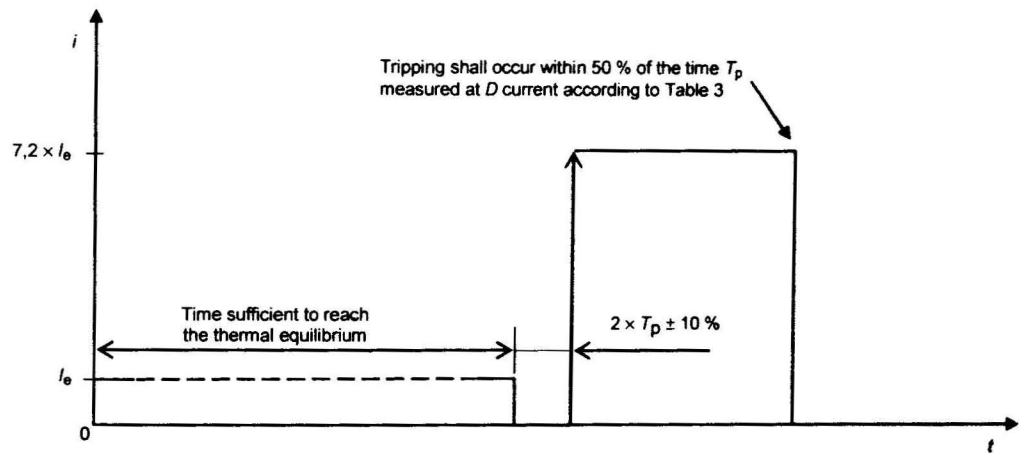


Figure 8 – Thermal memory test

Add, after Annex F, the following new Annexes G, H and I:

Annex G
(informative)

**Rated operational currents and rated operational powers
of switching devices for electrical machines**

G.1 General

The given values in Table G.1 are guide values for the relationship between rated operational currents and rated operational powers. They should be considered for use when information concerning products has to be given to the customers.

The statements of this annex are applicable to all kind of switching devices for electrical machines.

The figures are harmonized within the IEC and therefore state the basis for all the product information given by the manufacturer.

The values given in the Table G.1 are typical rated operational currents of motors for the corresponding rated operational powers.

If the devices are in compliance with these values, they are able to switch on and off most of the existing electrical machines.

These values state a harmonized guideline for design of switching devices.

G.2 Rated operational powers and rated operational currents

Rated operational power is linked with individual rated operational currents at different voltages according to Table G.1.

The guide values for rated operational currents are determined on the basis of a four-pole squirrel-cage motor at 400 V, 1 500 min⁻¹ and 50 Hz. The rated operational currents for the other voltages are calculated on the basis of values at 400 V.

Table G.1 – Rated operational powers and rated operational currents

Rated operational power		Guide values of rated operational currents at										
		110-120 V	200 V	208 V	230 V	220-240 V	380-415 V	400 V	440-480 V	500 V	550-600 V	690 V
kW ^a	hp ^b	A	A	A	A	A	A	A	A	A	A	A
0,06 0,09 0,12	– – –	– – –	– – –	– – –	0,35 0,52 0,70	– – –	– – –	0,20 0,30 0,44	– – –	0,16 0,24 0,32	– – –	0,12 0,17 0,23
0,18 0,25 0,37	– – –	– – –	– – –	– – –	1,0 1,5 1,9	– – –	– – –	0,60 0,85 1,10	– – –	0,48 0,68 0,88	– – –	0,35 0,49 0,64
– 0,55 –	1/2 – 3/4	4,4 – 6,4	2,5 – 3,7	2,4 – 3,5	– 2,6 –	2,2 – 3,2	1,3 – 1,8	– 1,5 –	1,1 – 1,6	– 1,2 –	0,9 – 1,3	– 0,87 –
– 0,75 1,1	1 – –	8,4 – –	4,8 – –	4,6 – –	– 3,3 4,7	4,2 – –	2,3 – –	– 1,9 2,7	2,1 – –	– 1,5 2,2	1,7 – –	– 1,1 1,6
– – 1,5	1-1/2 2 –	12,0 13,6 –	6,9 7,8 –	6,6 7,5 –	– – 6,3	6,0 6,8 –	3,3 4,3 –	– – 3,6	3,0 3,4 –	– – 2,9	2,4 2,7 –	– – 2,1
2,2 – 3,0	– 3 –	– 19,2 –	– 11,0 –	– 10,6 –	8,5 – 11,3	– 9,6 –	– 6,1 –	4,9 – 6,5	– 4,8 –	3,9 – 5,2	– 3,9 –	2,8 – 3,8
4 – 5,5	– 5 –	– 30,4 –	– 17,5 –	– 16,7 –	15 – 20	– 15,2 –	– 9,7 –	8,5 – 11,5	– 7,6 –	6,8 – 9,2	– 6,1 –	4,9 – 6,7
– – 7,5	7-1/2 10 –	44,0 56,0 –	25,3 32,2 –	24,2 30,8 –	– – 27	22,0 28,0 –	14,0 18,0 –	– – 15,5	11,0 14,0 –	– – 12,4	9,0 11,0 –	– – 8,9
11 – –	– 15 20	– 84 108	– 48,3 62,1	– 46,2 59,4	38,0 – –	– 42,0 54,0	– 27,0 34,0	22,0 – –	– 21,0 27,0	17,6 – –	– 17,0 22,0	12,8 – –
15 18,5 –	– – 25	– – 136	– – 78,2	– – 74,8	51 61 –	– – 68	– – 44	29 35 –	– – 34	23 28 –	– – 27	17 21 –

Table G.1 (continued)

Rated operational power		Guide values of rated operational currents at										
		110-120 V	200 V	208 V	230 V	220-240 V	380-415 V	400 V	440-480 V	500 V	550-600 V	690 V
kW ^a	hp ^b	A	A	A	A	A	A	A	A	A	A	A
22	—	—	—	—	72	—	—	41	—	33	—	24
—	30	160	92	88	—	80	51	—	40	—	32	—
—	40	208	120	114	—	104	66	—	52	—	41	—
30	—	—	—	—	96	—	—	55	—	44	—	32
37	—	—	—	—	115	—	—	66	—	53	—	39
—	50	260	150	143	—	130	83	—	65	—	52	—
—	60	—	177	169	—	154	103	—	77	—	62	—
45	—	—	—	—	140	—	—	80	—	64	—	47
55	—	—	—	—	169	—	—	97	—	78	—	57
—	75	—	221	211	—	192	128	—	96	—	77	—
—	100	—	285	273	—	248	165	—	124	—	99	—
75	—	—	—	—	230	—	—	132	—	106	—	77
90	—	—	—	—	278	—	—	160	—	128	—	93
—	125	—	359	343	—	312	208	—	156	—	125	—
110	—	—	—	—	340	—	—	195	—	156	—	113
—	150	—	414	396	—	360	240	—	180	—	144	—
132	—	—	—	—	400	—	—	230	—	184	—	134
—	200	—	552	528	—	480	320	—	240	—	192	—
150	—	—	—	—	—	—	—	—	—	—	—	—
160	—	—	—	—	487	—	—	280	—	224	—	162
185	—	—	—	—	—	—	—	—	—	—	—	—
—	250	—	—	—	—	604	403	—	302	—	242	—
200	—	—	—	—	609	—	—	350	—	280	—	203
220	—	—	—	—	—	—	—	—	—	—	—	—
—	300	—	—	—	—	722	482	—	361	—	289	—
250	—	—	—	—	748	—	—	430	—	344	—	250
280	—	—	—	—	—	—	—	—	—	—	—	—
—	350	—	—	—	—	828	560	—	414	—	336	—
—	400	—	—	—	—	954	636	—	477	—	382	—
300	—	—	—	—	—	—	—	—	—	—	—	—

Table G.1 (continued)

Rated operational power		Guide values of rated operational currents at										
kW ^a	hp ^b	110-120 V A	200 V A	208 V A	230 V A	220-240 V A	380-415 V A	400 V A	440-480 V A	500 V A	550-600 V A	690 V A
315 — 335	— 450 —	— — —	— — —	— — —	940 — —	— 1 030 —	— — —	540 — —	— 515 —	432 — —	— 412 —	313 — —
355 — 375	— 500 —	— — —	— — —	— — —	1 061 — —	— 1 180 —	— 786 —	610 — —	— 590 —	488 — —	— 472 —	354 — —
400 425 450	— — —	— — —	— — —	— — —	1 200 — —	— — —	— — —	690 — —	— — —	552 — —	— — —	400 — —
475 500 530	— — —	— — —	— — —	— — —	— 1 478 —	— — —	— — —	— 850 —	— — —	— 680 —	— — —	— 493 —
560 600 630	— — —	— — —	— — —	— — —	1 652 — 1 844	— — —	— — —	950 — 1 060	— — —	760 — 848	— — —	551 — 615
670 710 750	— — —	— — —	— — —	— — —	— 2 070 —	— — —	— — —	— 1 190 —	— — —	— 952 —	— — —	— 690 —
800 850 900	— — —	— — —	— — —	— — —	2 340 — 2 640	— — —	— — —	1 346 — 1 518	— — —	1 076 — 1 214	— — —	780 — 880
950 1 000	— —	— —	— —	— —	— 2 910	— —	— —	— 1 673	— —	— 1 339	— —	— 970
^a Preferred rated values according to IEC 60072-1 (primary series). ^b Horsepower and currents values according to UL 508 (60 Hz).												

Annex H (normative)

Extended functions within electronic overload relays

H.1 Scope

H.1.1 General

This annex is intended to cover extended functions included in electronic overload relays not directly related to the overload protection.

All functions included in these overload relays not covered by this standard, should comply with the requirements of relevant standards specifically covering these functions (e.g. IEC 60255, IEC 60947-5 series).

This annex applies only to electronic relays intended for use in a.c. circuits.

H.1.2 Residual current function

Devices reacting to residual differential currents are used as protective systems. Such devices are frequently used in conjunction with or as an integral part of electronic overload relays to detect residual current in the installation or the motor in order to provide additional protection against fire and other hazards which may develop as a result of an earth fault of a lasting nature which cannot be detected by the over-current protective function. The behaviour due to the presence of a d.c. component is not considered.

H.2 Definitions

For the purposes of this annex, the following definitions apply.

H.2.1

electronic overload relay with residual current (earth fault) function

multipole electronic relay which operates when the vectorial sum of the currents flowing in the main circuit has increased above a predetermined value in accordance with specified requirements

H.2.2

electronic overload relay with current or voltage asymmetry function

electronic overload relay which operates in the case of current or voltage magnitude unbalance in accordance with specified requirements

H.2.3

electronic overload relay with phase reversal function

multipole electronic overload relay which operates in the case of improper phase sequence at the line side of the starter in accordance with specified requirements

H.2.4

over-voltage sensitive electronic overload relay

electronic overload relay which operates in the case of overload and when the voltage has increased above a predetermined value in accordance with specified requirements

H.2.5**inhibit current (I_{ic})**

fault current above which a switching device is not initiated to open

H.3 Classification of electronic overload relays

- a) Current and voltage asymmetry relay or release.
- b) Over-voltage relay or release.
- c) Residual current (earth fault) sensing relay or release.
- d) Phase reversal relay or release.

H.4 Type of relays

Type A: a Type A electronic overload relay is one that will initiate opening of the switching device at all levels of fault current.

Type B: a Type B electronic overload relay is one that will not initiate opening of the switching device above a set current level I_{ic} (inhibit current).

H.5 Performance requirements**H.5.1 Limits of operation of residual current electronic overload relays**

A residual current overload relay, when associated with a switching device, shall operate to open the switching device according to the requirements given in Table H.1. For relays or releases with a residual current setting range, the limit of operation of the relay shall be verified at the lowest and highest settings

Table H.1 – Operating time of residual current electronic overload relays

Multiples of residual current setting	Tripping time T_p ms
$\leq 0,9$	No trip
1,1	$10 < T_p \leq 1\,000$

H.5.2 Limits of operation of residual current sensing electronic relays Type B

Subclause H.5.1 applies with the following addition.

A residual current sensing electronic relay Type B, when associated with a switching device, shall not initiate operation of the switching device, in the presence of a residual fault current, when the fault current in any phase reaches or exceeds 95 % the set current level I_{ic} (see H.4) and shall operate to open the equipment when the fault current in any phase is 75 % or less of I_{ic} .

H.5.3 Limits of operation of voltage asymmetry relays

A voltage asymmetry relay, when associated with a switching device, shall operate to open the switching device within 120 % of the time setting and shall operate to prevent the closing of the switching device when the voltage asymmetry is above 1,2 times the voltage asymmetry setting.

H.5.4 Limits of operation of phase reversal relays

A phase reversal relay, when associated with a switching device, shall permit the closing of the equipment when the voltage sequence of phases on the line side of the starter is the same as the voltage sequence setting. After interchanging two phases, the phase reversal relay shall prevent the closing of the equipment.

H.5.5 Limits of operation of current asymmetry relays

A current asymmetry relay, when associated with a switching device, shall operate to open the equipment within 120 % of the time setting when the current asymmetry is above 1,2 times the current asymmetry setting.

H.5.6 Limits of operation of over-voltage relays and releases

a) Operating voltage

An over-voltage relay or release, when associated with a switching device, shall operate to open the equipment and shall operate to prevent the closing of the equipment when the supply voltage is above the set value, if any, or above 110 % of the rated voltage of the relay or release for a defined duration.

b) Operating time

For a time-delay over-voltage relay or release, the time-lag shall be measured from the instant when the voltage reaches the operating value until the instant when the relay or release actuates the tripping device of the equipment.

H.6 Tests

H.6.1 Limits of operation of residual current sensing electronic relays Type A

The limits of operation shall be in accordance with H.5.1 and verified as follows.

For overload relays with an adjustable residual current setting, the test shall be made at the minimum and at the maximum current settings.

The test circuit shall be in accordance with Figure H.1. The test shall be made at a power factor $\geq 0,8$, at any convenient voltage and any convenient current.

The test circuit being calibrated at each of the values of the residual operating current specified in the Table H.1, as applicable, and the switch S1 being in the closed position, the residual current is suddenly established by closing switch S2.

H.6.2 Limits of operation of residual current sensing electronic relays Type B

Subclause H.6.1 applies with the following addition.

The limits of operation under over-current condition shall be in accordance with H.5.2 and verified as follows.

The test shall be made with a three-phase load, the connections being made according to Figure H.1. The test shall be made at a power factor $\geq 0,8$, at any convenient voltage and any convenient current in the main poles.

For overload relays with an adjustable residual current setting, the test shall be made at the lowest setting.

For overload relays with an adjustable inhibit current setting I_{IC} , the test shall be made at the minimum and at the maximum I_{IC} settings.

The impedance Z_1 is adjusted so as to let a current flow in the circuit equal to:

- a) 95 % the inhibit current I_{IC}

The switch S1 being in the closed position, the residual current is established by closing switch S2.

The overload relay shall not trip.

- b) 75 % the inhibit current I_{IC}

The switch S1 being in the closed position, the residual current is established by closing switch S2.

The overload relay shall trip.

H.6.3 Current asymmetry relays

The limits of operation shall be verified in accordance with H.5.5.

H.6.4 Voltage asymmetry relays

The limits of operation shall be verified in accordance with H.5.3.

H.6.5 Phase reversal relays

The limits of operation shall be verified in accordance with H.5.4.

H.6.6 Over-voltage relays

The limits of operation shall be verified in accordance with H.5.6.

H.7 Routine and sampling tests

Electronic overload relays with extended functions shall, in addition to tests of 9.3.6, be submitted to additional tests to verify the proper operation of their relevant additional functions, according to H.5

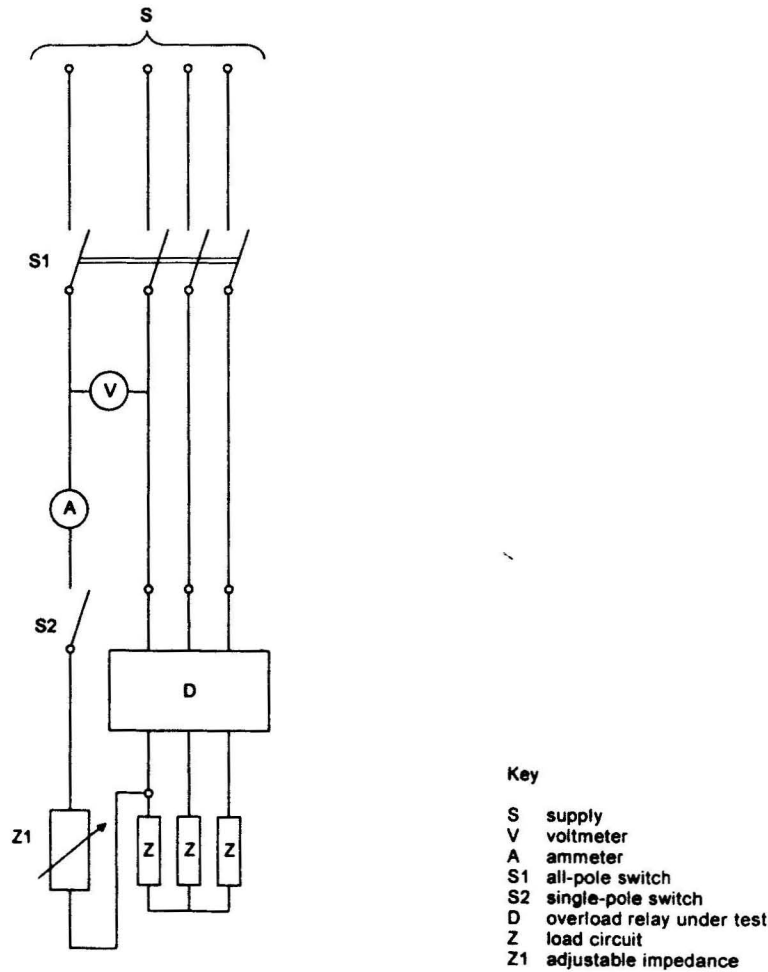


Figure H.1 – Test circuit for the verification of the operating characteristic of a residual current electronic overload relay

Annex I (informative)

AC1 contactors for use with semiconductor controlled motor loads

Contactors are often used with semiconductor controllers, starters or drives. Contactors for such applications are not intended to make or break motor load currents at the stated system voltage.

The intended use is to carry motor currents either on the line or load side of such controllers, and allow the controller to be removed from the line and/or load in the off condition. A further use is to by-pass controllers, usually for the purpose of reducing thermal losses, in the up-to speed condition. In such applications the contactors should be so controlled and interlocked so as to prevent them being opened or closed when the load current is present.

When the above conditions are met, the contactors may be chosen according to category AC1.

Amendment 1, page 37

Bibliography

Replace the reference to IEC 60664-1:1992 by the following:

IEC 60664-1, *Insulation coordination for equipment within low-voltage systems – Part 1: Principles, requirements and tests*

Add the following references:

IEC 60072-1, *Dimensions and output series for rotating electrical machines – Part 1: Frame numbers 56 to 400 and flange numbers 55 to 1080*

UL 508, *Industrial Control Equipment*

Bureau of Indian Standards

BIS is a statutory institution established under the *Bureau of Indian Standards Act*, 1986 to promote harmonious development of the activities of standardization, marking and quality certification of goods and attending to connected matters in the country.

Copyright

BIS has the copyright of all its publications. No part of these publications may be reproduced in any form without the prior permission in writing of BIS. This does not preclude the free use, in course of implementing the standard, of necessary details, such as symbols and sizes, type or grade designations. Enquiries relating to copyright be addressed to the Director (Publications), BIS.

Review of Indian Standards

Amendments are issued to standards as the need arises on the basis of comments. Standards are also reviewed periodically; a standard along with amendments is reaffirmed when such review indicates that no changes are needed; if the review indicates that changes are needed, it is taken up for revision. Users of Indian Standards should ascertain that they are in possession of the latest amendments or edition by referring to the latest issue of 'BIS Catalogue' and 'Standards: Monthly Additions'.

This Indian Standard has been developed from Doc: No. ETD 07 (5637).

Amendments Issued Since Publication

Amendment No.	Date of Issue	Text Affected

BUREAU OF INDIAN STANDARDS

Headquarters:

Manak Bhavan, 9 Bahadur Shah Zafar Marg, New Delhi 110 002

Telephones: 2323 0131, 2323 3375, 2323 9402

Website: www.bis.org.in

Regional Offices:

	Telephones
Central : Manak Bhavan, 9 Bahadur Shah Zafar Marg NEW DELHI 110 002	{ 2323 7617 2323 3841
Eastern : 1/14, C.I.T. Scheme VII M, V.I.P. Road, Kankurgachi KOLKATA 700 054	{ 2337 8499, 2337 8561 2337 8626, 2337 9120
Northern : SCO 335-336, Sector 34-A, CHANDIGARH 160 022	{ 260 3843 260 9285
Southern : C.I.T. Campus, IV Cross Road, CHENNAI 600 113	{ 2254 1216, 2254 1442 2254 2519, 2254 2315
Western : Manakalaya, E9 MIDC, Marol, Andheri (East) MUMBAI 400 093	{ 2832 9295, 2832 7858 2832 7891, 2832 7892

Branches: AHMEDABAD. BANGALORE. BHOPAL. BHUBANESHWAR. COIMBATORE. FARIDABAD. GHAZIABAD. GUWAHATI. HYDERABAD. JAIPUR. KANPUR. LUCKNOW. NAGPUR. PARWANOO. PATNA. PUNE. RAJKOT. THIRUVANANTHAPURAM. VISAKHAPATNAM.