

# CERTIFICATE

## By Authority Of THE UNITED STATES OF AMERICA Legally Binding Document

By the Authority Vested By Part 5 of the United States Code § 552(a) and Part 1 of the Code of Regulations § 51 the attached document has been duly **INCORPORATED BY REFERENCE** and shall be considered legally binding upon all citizens and residents of the United States of America. ***HEED THIS NOTICE:*** Criminal penalties may apply for noncompliance.



**Document Name:** AGA 3.1: Orifice Metering of Natural Gas and Other Related Hydrocarbon Fluids: Part 1

**CFR Section(s):** 40 CFR 75, Appendix D

**Standards Body:** American Gas Association



*Official Incorporator:*

THE EXECUTIVE DIRECTOR  
OFFICE OF THE FEDERAL REGISTER  
WASHINGTON, D.C.



---

---

# ORIFICE METERING OF NATURAL GAS

---

## AND OTHER RELATED HYDROCARBON FLUIDS

---

---

PART 1  
General Equations and  
Uncertainty Guidelines

THIRD EDITION, OCTOBER 1990

**AGA** American Gas Association

Report No. 3



American Petroleum Institute

API 14.3



Gas Processors Association

GPA 8185-90

Nothing contained in any A.G.A./GPA publication is to be construed as granting any right, by implication or otherwise, for the manufacture, sale, or use in connection with any method, apparatus, or product covered by letters patent, nor as insuring anyone against liability for infringement of letters patent.

This A.G.A./GPA publication may be used by anyone desiring to do so. Efforts have been made to assure the accuracy and reliability of the data contained in this publication; however, A.G.A./GPA makes no representation, warranty, or guarantee in connection with A.G.A./GPA publications and hereby expressly disclaims any liability or responsibility for loss or damage resulting from their use; for any violation of any federal, state, or municipal regulation with which an A.G.A./GPA publication may conflict; or for the infringement of any patent resulting from the use of an A.G.A./GPA publication.

## FOREWORD

This standard applies to fluids that, for all practical purposes, are considered to be clean, single phase, homogeneous, and Newtonian, measured using concentric, square-edged, flange-tapped orifice meters. Specifications for the construction and installation of orifice plates, meter tubes, and associated orifice plate holding devices are provided, along with equations for computing the flow through orifice meters.

This standard has been developed through the cooperative efforts of many individuals from industry under the sponsorship of the American Petroleum Institute, the American Gas Association, and the Gas Processors Association, with contributions from the Chemical Manufacturers Association, the Canadian Gas Association, the European Community, Norway, Japan, and others.

This publication may be used by anyone desiring to do so. Efforts have been made to assure the accuracy and reliability of the data contained in them; however, A.G.A. makes no representation, warranty, or guarantee in connection with this publication and hereby expressly disclaims any liability or responsibility for loss or damage resulting from its use or for the violation of any federal, state, or municipal regulation with which this publication may conflict.

Suggested revisions are invited and should be submitted to the Manager, Engineering Services, American Gas Association, 1515 Wilson Boulevard, Arlington, VA 22209-2402.



# CONTENTS

	Page
1.1 Introduction .....	1
1.1.1 Scope .....	1
1.1.2 Organization of Standard .....	1
1.1.3 Referenced Publications .....	2
1.2 Field of Application .....	2
1.2.1 Applicable Fluids .....	2
1.2.2 Types of Meters .....	2
1.2.3 Uncertainty of Measurement .....	3
1.3 Method of Calculation .....	3
1.4 Symbols .....	4
1.5 Definitions .....	5
1.5.1 Primary Element .....	5
1.5.2 Pressure Measurement .....	6
1.5.3 Temperature Measurement .....	8
1.5.4 Flow Rate Determination .....	8
1.5.5 Fluid Physical Properties .....	8
1.5.6 Base Conditions .....	9
1.5.7 Sensitivity Coefficient .....	9
1.5.8 Meter Factor .....	9
1.6 Orifice Flow Equation .....	9
1.6.1 Velocity of Approach Factor .....	11
1.6.2 Orifice Plate Bore Diameter .....	11
1.6.3 Meter Tube Internal Diameter .....	11
1.7 Empirical Coefficient of Discharge .....	12
1.7.1 Regression Data Base .....	12
1.7.2 Empirical Coefficient of Discharge Equation for Flange-Tapped Orifice Meters .....	13
1.7.3 Reynolds Number .....	14
1.7.4 Flow Conditions .....	15
1.7.5 Pulsating Flow .....	15
1.8 Empirical Expansion Factor for Flange-Tapped Orifice Meters .....	16
1.8.1 Upstream Expansion Factor .....	17
1.8.2 Downstream Expansion Factor .....	18
1.9 In-Situ Calibration .....	19
1.9.1 General .....	19
1.9.2 Meter Correction Factor .....	19
1.10 Fluid Physical Properties .....	20
1.10.1 Viscosity .....	20
1.10.2 Density .....	20
1.10.3 Isentropic Exponent .....	21
1.11 Unit Conversion Factors .....	21
1.11.1 Orifice Flow Equation .....	21
1.11.2 Reynolds Number Equation .....	21
1.11.3 Expansion Factor Equation .....	22
1.11.4 Flow Rate per Unit of Time Conversion .....	22
1.12 Practical Uncertainty Guidelines .....	23
1.12.1 General .....	24
1.12.2 Uncertainty Over a Flow Range .....	24

	Page
1.12.3 Uncertainty of Flow Rate .....	24
1.12.4 Typical Uncertainties .....	26
1.12.5 Example Uncertainty Calculations .....	31
APPENDIX 1-A—REFERENCES .....	35
APPENDIX 1-B—DISCHARGE COEFFICIENTS FOR FLANGE-TAPPED ORIFICE METERS .....	37
APPENDIX 1-C—ADJUSTMENTS FOR INSTRUMENT CALIBRATION AND USE .....	51
 Figures	
1-1—Orifice Meter .....	3
1-2—Orifice Tapping Location .....	7
1-3—Contribution to Flow Error due to Differential Pressure Instrumentation .	25
1-4—Empirical Coefficient of Discharge: Uncertainty at Infinite Reynolds Number .....	27
1-5—Relative Change in Uncertainty: Dependence on Reynolds Number .....	27
1-6—Practical Uncertainty Levels .....	29
 Tables	
1-1—Linear Coefficient of Thermal Expansion .....	11
1-2—Orifice Flow Rate Equation: Unit Conversion Factor .....	22
1-3—Reynolds Number Equation: Unit Conversion Factor .....	23
1-4—Empirical Expansion Factor Equation: Unit Conversion Factor .....	23
1-5—Uncertainty Statement for Empirical Expansion Factor .....	28
1-6—Example Uncertainty Estimate for Liquid Flow Calculation .....	32
1-7—Example Uncertainty Estimate for Natural Gas Flow Calculation .....	33
1-B-1—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 2-Inch (50-Millimeter) Meter .....	39
1-B-2—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 3-Inch (75-Millimeter) Meter .....	40
1-B-3—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 4-Inch (100-Millimeter) Meter .....	41
1-B-4—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 6-Inch (150-Millimeter) Meter .....	42
1-B-5—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 8-Inch (200-Millimeter) Meter .....	43
1-B-6—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 10-Inch (250-Millimeter) Meter .....	44
1-B-7—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 12-Inch (300-Millimeter) Meter .....	45
1-B-8—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 16-Inch (400-Millimeter) Meter .....	46
1-B-9—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 20-Inch (500-Millimeter) Meter .....	47
1-B-10—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 24-Inch (600-Millimeter) Meter .....	48
1-B-11—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 30-Inch (750-Millimeter) Meter .....	49

# ORIFICE METERING OF NATURAL GAS AND OTHER RELATED HYDROCARBON FLUIDS

## PART 1—GENERAL EQUATIONS AND UNCERTAINTY GUIDELINES

### 1.1 Introduction

#### 1.1.1 SCOPE

This standard provides a single reference for engineering equations, uncertainty estimations, construction and installation requirements, and standardized implementation recommendations for the calculation of flow rate through concentric, square-edged, flange-tapped orifice meters. Both U.S. customary (IP) and International System of Units (SI) units are included.

#### 1.1.2 ORGANIZATION OF STANDARD

The standard is organized into four parts. Parts 1, 2, and 4 apply to the measurement of any Newtonian fluid in the petroleum and chemical industries. Part 3 focuses on the application of Parts 1, 2, and 4 to the measurement of natural gas.

##### 1.1.2.1 Part 1—General Equations and Uncertainty Guidelines

The mass flow rate and base (or standard) volumetric flow rate equations are discussed, along with the terms required for solution of the flow equation.

The empirical equations for the coefficient of discharge and expansion factor are presented. However, the bases for the empirical equations are contained in other sections of this standard or the appropriate reference document.

For the proper use of this standard, a discussion is presented on the prediction (or determination) of the fluid's properties at flowing conditions. The fluid's physical properties shall be determined by direct measurements, appropriate technical standards, or equations of state.

Uncertainty guidelines are presented for determining the possible error associated with the use of this standard for any fluid application. User-defined uncertainties for the fluid's physical properties and auxiliary (secondary) devices are required to solve the practical working formula for the estimated uncertainty.

##### 1.1.2.2 Part 2—Specifications and Installation Requirements

Specifications are presented for orifice meters, in particular, orifice plates, orifice plate holders, sensing taps, meter tubes, and flow conditioners.

Installation requirements for orifice plates, meter tubes, thermometer wells, flow conditioners, and upstream/downstream meter tube lengths are presented.

##### 1.1.2.3 Part 3—Natural Gas Applications

The application of this standard to natural gas is presented, along with practical guidelines. Mass flow rate and base (or standard) volumetric flow rate methods are presented in conformance with North American industry practices.

#### 1.1.2.4 Part 4—Background, Development, and Implementation Procedure and Subroutine Documentation for Empirical Flange-Tapped Discharge Coefficient Equation

The coefficient of discharge data base for flange-tapped orifice meters and its background, development, and limitations are presented.

Implementation procedures for flange-tapped orifice meters are presented, along with a set of example calculations. The examples are designed to aid in checkout procedures for any routines that are developed using the implementation procedures.

#### 1.1.3 REFERENCED PUBLICATIONS

Several documents served as references for the revision of this standard. In particular, previous editions of A.G.A. Report No. 3 (ANSI<sup>1</sup>/API<sup>2</sup> 2530) provided a wealth of information. The laboratory reports for the experimental data bases also provided valuable information concerning the control of independent variables, both qualitatively and quantitatively. Other publications, symposium proceedings, trade journals, textbooks, and society papers were consulted for the revision of this standard.

A complete bibliography is available upon request from the American Gas Association. A reduced list, referencing the major experimental research, is contained in Appendix 1-A.

### 1.2 Field of Application

#### 1.2.1 APPLICABLE FLUIDS

This standard applies to steady-state mass flow conditions for fluids that, for all practical purposes, are considered to be clean, single phase, homogeneous, and Newtonian and have pipe Reynolds numbers of 4000 or greater. All gases, most liquids, and most dense phase fluids associated with the petroleum, petrochemical, and natural gas industries are usually considered Newtonian fluids.

#### 1.2.2 TYPES OF METERS

This standard provides design, construction, and installation specifications for flange-tapped, concentric, square-edged orifice meters of nominal 2-inch Schedule 160 and larger pipe diameters.

An orifice meter is a fluid flow measuring device that produces a differential pressure to infer flow rate. The meter consists of the following elements (see Figure 1-1):

- a. A thin, concentric, square-edged orifice plate.
- b. An orifice plate holder consisting of a set of orifice flanges (or an orifice fitting) equipped with the appropriate differential pressure sensing taps.
- c. A meter tube consisting of the adjacent piping sections (with or without flow conditioners).

The auxiliary (secondary) devices necessary for the precise determination of flow rate are not included in the scope of this standard. These devices are usually instruments that sense the differential and static pressure, fluid temperature, and fluid density and/or relative density (specific gravity), and either mechanical recording devices or electronic calculators. Publications of the A.G.A., API, GPA,<sup>3</sup> and others should be used to specify and install these auxiliary (secondary) devices.

<sup>1</sup>American National Standards Institute, 1430 Broadway, New York, NY 10018

<sup>2</sup>American Petroleum Institute, 1220 L Street, N.W., Washington, D.C. 20005.

<sup>3</sup>Gas Processors Association, 6526 East 60th Street, Tulsa, Oklahoma 74145.

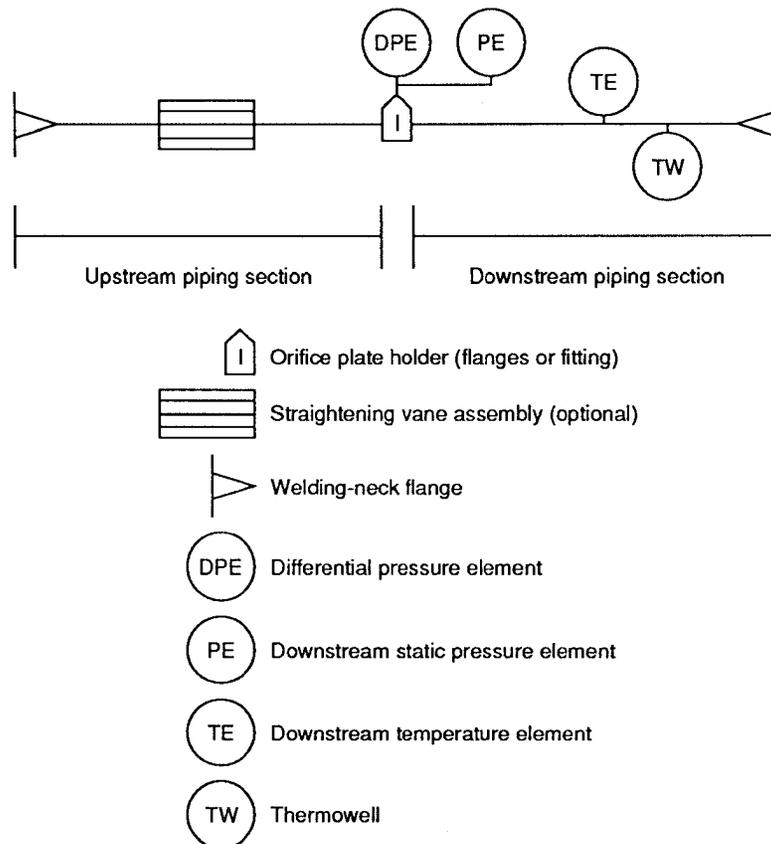


Figure 1-1—Orifice Meter

### 1.2.3 UNCERTAINTY OF MEASUREMENT

Many factors influence the overall measurement uncertainty associated with a metering application. Major contributors include construction tolerances in the meter components, tolerances of empirical coefficient of discharge data bases or in-situ flow calibrations, predictability of and variations in the fluid's physical properties, and uncertainties associated with the auxiliary (secondary) devices.

Using the guidelines contained in this standard in combination with the associated uncertainty tolerances for the fluid's physical properties, in-situ calibrations, or coefficient of discharge data bases, and the appropriate auxiliary (secondary) devices, the user can estimate the overall measurement uncertainty associated with a properly designed, installed, and maintained thin plate, concentric, square-edged orifice metering application.

### 1.3 Method of Calculation

This standard provides recommended standardized calculation implementation methods for the quantification of fluid flow under defined conditions, regardless of the point of origin or destination or the units of measure required by governmental customs or statute. The recommended implementation procedures provided in Report No. 3, Part 4, allow different entities using various computer languages on different computing hardware to arrive at nearly identical results using the same standardized input data.

The following two recommended implementation procedures have been prepared to illustrate the standardized set of mathematical expressions and sequencing, including iteration/rounding techniques:

- a. Mass flow rate.
- b. Standard volumetric flow rate.

The procedures presented address only the solution of the flow rate equation and require specific inputs (fixed and variable). Typical fixed inputs include meter tube internal diameter, orifice plate bore diameter, and linear coefficient of expansion for steels (pipe and orifice plate). Typical variable inputs may include differential and static pressure, temperature, fluid density, isentropic exponent for compressible fluids, and fluid viscosity.

The fluid's physical properties shall be determined by direct measurements, appropriate technical standards, or equations of state. If multiple parties are involved in the measurement, the appropriate technical method selected for determining the fluid's physical properties shall be mutually agreed upon.

## 1.4 Symbols

This standard reflects orifice meter application to fluid flow measurement with symbols in general technical use.

Symbol	Represented Quantity
$C_d$	Orifice plate coefficient of discharge.
$C_d(FT)$	Coefficient of discharge at a specified pipe Reynolds number for flange-tapped orifice meter.
$C_i$	Coefficient of discharge at infinite pipe Reynolds number.
$C_i(CT)$	Coefficient of discharge at infinite pipe Reynolds number for corner-tapped orifice meter.
$C_i(FT)$	Coefficient of discharge at infinite pipe Reynolds number for flange-tapped orifice meter.
$c_p$	Specific heat at constant pressure.
$c_v$	Specific heat at constant volume.
$d$	Orifice plate bore diameter calculated at flowing temperature, $T_f$ .
$d_m$	Orifice plate bore diameter measured at $T_m$ .
$d_r$	Orifice plate bore diameter at reference temperature, $T_r$ .
$D$	Meter tube internal diameter calculated at flowing temperature, $T_f$ .
$D_m$	Meter tube internal diameter measured at $T_m$ .
$D_r$	Meter tube internal diameter at reference temperature, $T_r$ .
$\Delta P$	Orifice differential pressure.
$^{\circ}C$	Temperature, in degrees Celsius.
$^{\circ}F$	Temperature, in degrees Fahrenheit.
K	Temperature, in kelvins.
$^{\circ}R$	Temperature, in degrees Rankine.
$E_v$	Velocity of approach factor.
$g_c$	Dimensional conversion constant.
$G_i$	Ideal gas relative density (specific gravity).
$k$	Isentropic exponent.
$k_i$	Ideal gas isentropic exponent.
$k_p$	Perfect gas isentropic exponent.
$k_r$	Real gas isentropic exponent.
MF	In-situ calibration meter factor.
$Mr_{air}$	Molar mass of air.
$Mr_{gas}$	Molar mass of gas.
$N_1$	Unit conversion factor (orifice flow).
$N_2$	Unit conversion factor (Reynolds number).
$N_3$	Unit conversion factor (expansion factor).
$N_4$	Unit conversion factor (discharge coefficient).
$P_b$	Base (reference or standard) pressure.

$P_f$	Static pressure of fluid at the pressure tap.
$P_{f_1}$	Absolute static pressure at the orifice upstream differential pressure tap.
$P_{f_2}$	Absolute static pressure at the orifice downstream differential pressure tap.
$q_m$	Mass flow rate.
$q_{m_i}$	Mass flow rate indicated by the orifice meter being calibrated.
$q_{m_p}$	Mass flow rate determined by the primary mass flow system (or master meter).
$q_v$	Volume flow rate at flowing (actual) conditions.
$q_{v_i}$	Volume flow rate indicated by the orifice meter being calibrated.
$Q_v$	Volume flow rate at base (standard) conditions.
$R$	Universal gas constant.
$R_a$	Roughness average value from continuously averaging meter readings.
$Re_D$	Pipe Reynolds number.
$T$	Temperature.
$T_b$	Base (reference or standard) temperature.
$T_f$	Temperature of fluid at flowing conditions.
$T_m$	Temperature of the orifice plate or meter tube at time of diameter measurements.
$T_r$	Reference temperature of orifice plate bore diameter and/or meter tube inside diameter.
$x$	Ratio of differential pressure to absolute static pressure.
$x_1$	Ratio of differential pressure to absolute static pressure at the upstream pressure tap.
$S( )$	Sensitivity coefficient (influence coefficient).
$Y$	Expansion factor.
$Y_1$	Expansion factor based on upstream absolute static pressure.
$Y_2$	Expansion factor based on downstream absolute static pressure.
$Z$	Fluid compressibility.
$Z_f$	Fluid compressibility at flowing conditions.
$Z_{f_1}$	Compressibility of the fluid flowing at the upstream pressure tap location.
$Z_{f_2}$	Compressibility of the fluid flowing at the downstream pressure tap location.
$\alpha$	Linear coefficient of thermal expansion.
$\alpha_1$	Linear coefficient of thermal expansion of the orifice plate material.
$\alpha_2$	Linear coefficient of thermal expansion of the meter tube material.
$\beta$	Ratio of orifice diameter to meter tube diameter calculated at flowing conditions.
$\mu$	Absolute viscosity of fluid flowing.
$\pi$	Universal constant.
$\rho$	Density of the fluid.
$\rho_b$	Density of the fluid at base conditions ( $P_b, T_b$ ).
$\rho_{f,p}$	Density of the fluid at flowing conditions ( $P_f, T_f$ ).

## 1.5 Definitions

This standard reflects orifice meter application to fluid flow measurement. The definitions are given to emphasize the particular meaning of the terms as used in this standard.

### 1.5.1 PRIMARY ELEMENT

The primary element is defined as the orifice plate, the orifice plate holder with its associated differential pressure sensing taps, and the meter tube.

#### 1.5.1.1 Orifice Plate

The orifice plate is defined as a thin plate in which a circular concentric aperture (bore) has been machined. The orifice plate is described as a thin plate with sharp, square edge be-

cause the thickness of the plate material is small, compared with the internal diameter of the measuring aperture (bore), and because the upstream edge of the measuring aperture is sharp and square.

#### **1.5.1.2 Orifice Plate Bore Diameter ( $d$ , $d_m$ , $d_r$ )**

The calculated orifice plate bore diameter ( $d$ ) is the internal diameter of the orifice plate measuring aperture (bore) computed at flowing temperature ( $T_f$ ), as specified in 1.6.2. The calculated orifice plate bore diameter ( $d$ ) is used in the flow equation for the determination of flow rate.

The measured orifice plate bore diameter ( $d_m$ ) is the measured internal diameter of the orifice plate measuring aperture at the temperature of the orifice plate ( $T_m$ ) at the time of bore diameter measurements, determined as specified in Report No. 3, Part 2.

The reference orifice plate bore diameter ( $d_r$ ) is the internal diameter of the orifice plate measuring aperture at reference temperature ( $T_r$ ), calculated as specified in Report No. 3, Part 2. The reference orifice plate bore diameter is the certified or stamped orifice plate bore diameter.

#### **1.5.1.3 Orifice Plate Holder**

The orifice plate holder is defined as a pressure-containing piping element, such as a set of orifice flanges or an orifice fitting, used to contain and position the orifice plate in the piping system.

#### **1.5.1.4 Meter Tube**

The meter tube is defined as the straight sections of pipe, including all segments that are integral to the orifice plate holder, upstream and downstream of the orifice plate, as specified in Report No. 3, Part 2.

#### **1.5.1.5 Meter Tube Internal Diameter ( $D$ , $D_m$ , $D_r$ )**

The calculated meter tube internal diameter ( $D$ ) is the inside diameter of the upstream section of the meter tube computed at flowing temperature ( $T_f$ ), as specified in 1.6.3. The calculated meter tube internal diameter ( $D$ ) is used in the diameter ratio and Reynolds number equations.

The measured meter tube internal diameter ( $D_m$ ) is the inside diameter of the upstream section of the meter tube at the temperature of the meter tube ( $T_m$ ) at the time of internal diameter measurements, determined as specified in Report No. 3, Part 2.

The reference meter tube internal diameter ( $D_r$ ) is the inside diameter of the upstream section of the meter tube at the reference temperature ( $T_r$ ), calculated as specified in Report No. 3, Part 2. The reference meter tube internal diameter is the certified or stamped meter tube internal diameter.

#### **1.5.1.6 Diameter Ratio ( $\beta$ )**

The diameter ratio ( $\beta$ ) is defined as the calculated orifice plate bore diameter ( $d$ ) divided by the calculated meter tube internal diameter ( $D$ ).

### **1.5.2 PRESSURE MEASUREMENT**

#### **1.5.2.1 Tap Hole**

A tap hole is a hole drilled radially in the wall of the meter tube or orifice plate holder, the inside edge of which is flush and without any burrs.

### 1.5.2.2 Flange Taps

Flange taps are a pair of tap holes positioned as follows (see Figure 1-2):

- The upstream tap center is located 1 inch (25.4 millimeters) upstream of the nearest plate face.
- The downstream tap center is located 1 inch (25.4 millimeters) downstream of the nearest plate face.



### 1.5.2.3 Differential Pressure ( $\Delta P$ )

The differential pressure ( $\Delta P$ ) is the static pressure difference measured between the upstream and downstream flange taps.

### 1.5.2.4 Static Pressure ( $P_f$ )

The static pressure ( $P_f$ ) is the absolute flowing fluid pressure measured at one of the flange tap holes. The absolute pressure may be measured directly or can be obtained by adding local barometric pressure to measured gauge pressure:

$$\text{Absolute static pressure} = \text{Gauge static pressure} + \text{Local barometric pressure}$$

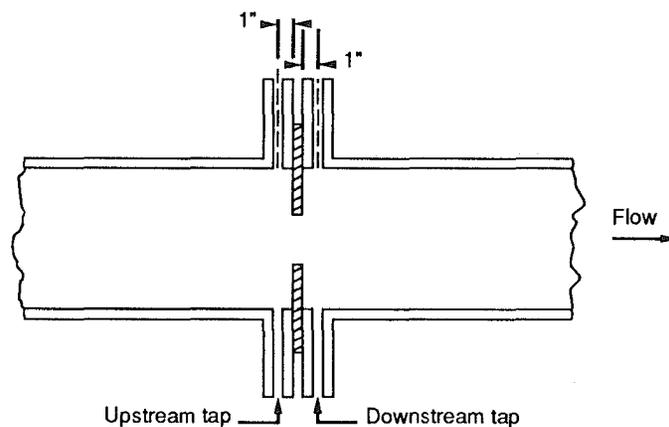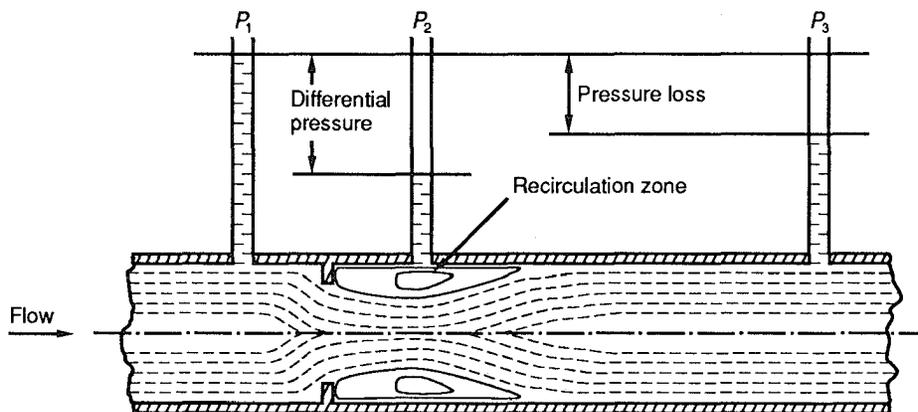

FLANGE-TAPPED ORIFICE METER

Figure 1-2—Orifice Tapping Location

### 1.5.3 TEMPERATURE MEASUREMENT ( $T_f$ )

The temperature is the flowing fluid temperature ( $T_f$ ) measured at the designated upstream or downstream location, as specified in Report No. 3, Part 2.

In flow measurement applications where the fluid velocity is well below sonic, it is common practice to insert a temperature sensing device in the middle of the flowing stream to obtain the flowing temperature. For practical applications, the sensed temperature is assumed to be the static temperature of the flowing fluid.

The use of flowing temperature in this part of the standard requires the temperature to be measured in degrees Fahrenheit or degrees Celsius. However, if the flowing temperature is used in an equation of state to determine the density of the flowing fluid, it may require that the Fahrenheit or Celsius values be converted to absolute temperature values of degrees Rankine or kelvins through the following relationships:

$$^{\circ}\text{R} = ^{\circ}\text{F} + 459.67$$

$$\text{K} = ^{\circ}\text{C} + 273.15$$

### 1.5.4 FLOW RATE DETERMINATION

#### 1.5.4.1 Orifice Flow Rate ( $q_m$ , $q_v$ , $Q_v$ )

The orifice flow rate is the mass or volume flow through an orifice meter per unit of time.

#### 1.5.4.2 Orifice Plate Coefficient of Discharge ( $C_d$ )

The orifice plate coefficient of discharge ( $C_d$ ) is the ratio of the true flow to the theoretical flow and is applied to the theoretical flow equation to obtain the actual (true) flow.

#### 1.5.4.3 Velocity of Approach ( $E_v$ )

The velocity of approach factor ( $E_v$ ) is a mathematical expression that relates the velocity of the flowing fluid in the orifice meter approach section (upstream meter tube) to the fluid velocity in the orifice plate bore.

#### 1.5.4.4 Expansion Factor ( $Y$ )

The expansion factor ( $Y$ ) is an empirical expression used to correct the flow rate for the reduction in fluid density that a compressible fluid experiences when it passes through the orifice plate bore.

#### 1.5.4.5 Pipe Reynolds Number ( $Re_D$ )

The pipe Reynolds number is a dimensionless ratio of forces used to correlate the variations in the orifice plate coefficient of discharge ( $C_d$ ) with changes in the fluid's properties, flow rate, and orifice meter geometry.

### 1.5.5 FLUID PHYSICAL PROPERTIES

#### 1.5.5.1 Density ( $\rho_{t,p}$ , $\rho_b$ )

The flowing fluid density ( $\rho_{t,p}$ ) is the mass per unit volume of the fluid being measured at flowing conditions ( $T_f$ ,  $P_f$ ).

The base fluid density ( $\rho_b$ ) is the mass per unit volume of the fluid being measured at base conditions ( $T_b$ ,  $P_b$ ).

#### 1.5.5.2 Absolute Viscosity ( $\mu$ )

The absolute viscosity ( $\mu$ ) is the measure of a fluid's intermolecular cohesive force's resistance to shear per unit of time.

### 1.5.5.3 Compressibility ( $Z$ )

The compressibility ( $Z$ ) is an adjustment factor used to account for the deviation from the ideal gas law.

### 1.5.5.4 Isentropic Exponent ( $k$ )

The isentropic exponent ( $k$ ) is a thermodynamic state property that establishes the relationship between an expanding fluid's pressure and density as the fluid flows through the orifice plate bore.

### 1.5.6 BASE CONDITIONS ( $P_b$ , $T_b$ )

Historically, the flow measurement of some fluids, such as custody transfer and process control, have been stated in volume units at base (reference or standard) conditions of pressure and temperature.

The base conditions for the flow measurement of fluids, such as crude petroleum and its liquid products, whose vapor pressure is equal to or less than atmospheric at base temperature are defined in the United States as a pressure of 14.696 pounds per square inch absolute (101.325 kilopascals) at a temperature of 60.0°F (15.56°C). According to the International Standards Organization, base conditions are defined as a pressure of 14.696 pounds per square inch absolute (101.325 kilopascals) at a temperature of 59.00°F (15.00°C).

For fluids, such as liquid hydrocarbons, whose vapor pressure is greater than atmospheric pressure at base temperature, the base pressure is customarily designated as the equilibrium vapor pressure at base temperature.

The base conditions for the flow measurement of natural gases are defined in the United States as a pressure of 14.73 pounds per square inch absolute (101.560 kilopascals) at a temperature of 60.0°F (15.56°C). According to the International Standards Organization, base conditions are defined as a pressure of 14.696 pounds per square inch absolute (101.325 kilopascals) at a temperature of 59.00°F (15.00°C).

For both liquid and gas applications, these base conditions can change from one country to the next, one state to the next, or one industry to the next. Therefore, it is necessary that the base conditions be identified for standard volumetric flow measurement.

### 1.5.7 SENSITIVITY COEFFICIENT ( $S$ )

In estimating the uncertainty associated with the metering facility, a number of variables must be combined. The mathematical relationships among the variables establish the sensitivity of the metered quantities to each of these variables. As such, each variable that may influence the flow equation has a specific sensitivity coefficient. The derivation of this coefficient is based on a mathematical relationship or estimated from calculations, tables, or curves.

### 1.5.8 METER FACTOR ( $MF$ )

The meter factor ( $MF$ ) is a number obtained by dividing the quantity of fluid measured by the primary mass flow system by the quantity indicated by the orifice meter during calibration.

## 1.6 Orifice Flow Equation

The accepted one-dimensional equation for mass flow through a concentric, square-edged orifice meter is stated in Equation 1-1 or 1-2. The derivation is based on conservation of mass and energy, one-dimensional fluid dynamics, and empirical functions such as equations of state and thermodynamic process statements. Any derivation is accurate when all the assumptions used to develop it are valid. As a result, an empirical orifice plate coeffi-

cient of discharge is applied to the theoretical equation to adjust for multidimensional viscous fluid dynamic effects. In addition, an empirical expansion factor is applied to the theoretical equation to adjust for the reduction in fluid density that a compressible fluid experiences when it passes through an orifice plate.

The fundamental orifice meter mass flow equation is as follows:

$$q_m = C_d E_v Y (\pi / 4) d^2 \sqrt{2 g_c \rho_{i,p} \Delta P} \quad (1-1)$$

Where:

- $C_d$  = orifice plate coefficient of discharge.
- $d$  = orifice plate bore diameter calculated at flowing temperature ( $T_f$ ).
- $\Delta P$  = orifice differential pressure.
- $E_v$  = velocity of approach factor.
- $g_c$  = dimensional conversion constant.
- $\pi$  = universal constant  
= 3.14159.
- $q_m$  = mass flow rate.
- $\rho_{i,p}$  = density of the fluid at flowing conditions ( $P_f, T_f$ ).
- $Y$  = expansion factor.

The practical orifice meter flow equation used in this standard is a simplified form that combines the numerical constants and unit conversion constants in a unit conversion factor ( $N_1$ ):

$$q_m = N_1 C_d E_v Y d^2 \sqrt{\rho_{i,p} \Delta P} \quad (1-2)$$

Where:

- $C_d$  = orifice plate coefficient of discharge.
- $d$  = orifice plate bore diameter calculated at flowing temperature ( $T_f$ ).
- $\Delta P$  = orifice differential pressure.
- $E_v$  = velocity of approach factor.
- $N_1$  = unit conversion factor.
- $q_m$  = mass flow rate.
- $\rho_{i,p}$  = density of the fluid at flowing conditions ( $P_f, T_f$ ).
- $Y$  = expansion factor.

The expansion factor,  $Y$ , is included in Equations 1-1 and 1-2 because it is applicable to all single-phase, homogeneous Newtonian fluids. For incompressible fluids, such as water at 60°F (15.56°C) and atmospheric pressure, the empirical expansion factor is defined as 1.0000.

The orifice plate coefficient of discharge,  $C_d$ , and the expansion factor,  $Y$ , are empirical functions derived from experimental data.

The orifice meter is a mass meter from which a differential pressure signal is developed as a function of the velocity of the fluid as it passes through the orifice plate bore. Manipulation of the density variable in the equation permits calculation of flow rate in either mass or volume units. The volumetric flow rate at flowing (actual) conditions can be calculated using the following equation:

$$q_v = q_m / \rho_{i,p} \quad (1-3)$$

The volumetric flow rate at base (standard) conditions can be calculated using the following equation:

$$Q_v = q_m / \rho_b \quad (1-4)$$

The mass flow rate ( $q_m$ ) can be converted to a volumetric flow rate at base (standard) conditions ( $Q_v$ ) if the fluid density at the base conditions ( $\rho_b$ ) can be determined or is specified.

The unit conversion factor,  $N_1$ , is defined and presented in 1.11.

### 1.6.1 VELOCITY OF APPROACH FACTOR ( $E_v$ )

The velocity of approach factor,  $E_v$ , is calculated as follows:

$$E_v = \frac{1}{\sqrt{1 - \beta^4}} \quad (1-5)$$

And,

$$\beta = d/D \quad (1-6)$$

Where:

$d$  = orifice plate bore diameter calculated at flowing temperature ( $T_f$ ).

$D$  = meter tube internal diameter calculated at flowing temperature ( $T_f$ ).

### 1.6.2 ORIFICE PLATE BORE DIAMETER ( $d$ )

The orifice plate bore diameter,  $d$ , is defined as the diameter at flowing conditions and can be calculated using the following equation:

$$d = d_r[1 + \alpha_1(T_f - T_r)] \quad (1-7)$$

Where:

$\alpha_1$  = linear coefficient of thermal expansion for the orifice plate material (see Table 1-1).

$d$  = orifice plate bore diameter calculated at flowing temperature ( $T_f$ ).

$d_r$  = reference orifice plate bore diameter at  $T_r$ .

$T_f$  = temperature of the fluid at flowing conditions.

$T_r$  = reference temperature of the orifice plate bore diameter.

Note:  $\alpha$ ,  $T_f$ , and  $T_r$  must be in consistent units. For the purpose of this standard,  $T_r$  is assumed to be 68°F (20°C).

The orifice plate bore diameter,  $d_r$ , calculated at  $T_r$  is the diameter determined in accordance with the requirements contained in Report No. 3, Part 2.

### 1.6.3 METER TUBE INTERNAL DIAMETER ( $D$ )

The meter tube internal diameter,  $D$ , is defined as the diameter at flowing conditions and can be calculated using the following equation:

$$D = D_r[1 + \alpha_2(T_f - T_r)] \quad (1-8)$$

Where:

$\alpha_2$  = linear coefficient of thermal expansion for the meter tube material (see Table 1-1).

$D$  = meter tube internal diameter calculated at flowing temperature ( $T_f$ ).

Table 1-1—Linear Coefficient of Thermal Expansion

Material	Linear Coefficient of Thermal Expansion ( $\alpha$ )	
	U.S. Units (in/in-°F)	Metric Units (mm/mm-°C)
Type 304 and 316 stainless steel <sup>a</sup>	0.00000925	0.0000167
Monel <sup>a</sup>	0.00000795	0.0000143
Carbon steel <sup>b</sup>	0.00000620	0.0000112

Note: For flowing temperature conditions outside those stated above and for other materials, refer to the American Society for Metals *Metals Handbook*.

<sup>a</sup>For flowing conditions between -100°F and +300°F, refer to ASME PTC 19.5.

<sup>b</sup>For flowing conditions between -7°F and +154°F, refer to API Manual of Petroleum Measurement Standards, Chapter 12, Section 2.

- $D_r$  = reference meter tube internal diameter at  $T_r$ ,  
 $T_f$  = temperature of the fluid at flowing conditions.  
 $T_r$  = reference temperature of the meter tube internal diameter.

Note:  $\alpha$ ,  $T_f$  and  $T_r$  must be in consistent units. For the purpose of this standard,  $T_r$  is assumed to be 68°F (20°C).

The meter tube internal diameter,  $D_r$ , calculated at  $T_r$  is the diameter determined in accordance with the requirements contained in Report No. 3, Part 2.

## 1.7 Empirical Coefficient of Discharge

Empirical coefficients of discharge for flange-tapped orifice meters have been determined from experimental data by comparing the measured and theoretical flow rates. A major factor in the definition of the experimental patterns for this orifice research was dynamic similarity. Using Reynolds' Law of Similarity, experimental correlations can be applied to dynamically similar meters.

To accurately predict the coefficient of discharge,  $C_d(FT)$ , for a flange-tapped orifice meter manufactured to the specifications of this standard, certain parameters concerning the orifice meter and the fluid must be known. The relationships between these functions can be simplified for application to commercial use. In fact, the coefficient of discharge can be shown to depend on a number of parameters, the major ones being the Reynolds number ( $Re_D$ ), sensing tap location, meter tube diameter ( $D$ ), and  $\beta$  ratio:

$$C_d = f(Re_D, \text{Sensing tap location}, D, \beta)$$

In 1978, Jean Stolz presented an equation form that correlates the near vicinity taps for orifice meters based on the near field static wall pressure gradient. A complete discussion of the bases of the equation is beyond the scope of this standard. However, the bibliography contained in Appendix 1-A will allow the reader to further explore this technical discussion.

### 1.7.1 REGRESSION DATA BASE

Working jointly, a group of technical experts from the United States, Europe, Canada, Norway, and Japan have developed an equation using the Stolz linkage form that fits the Regression Data Set more accurately than have previously published equations. The new equation was developed from a significantly larger data base than was previously used for discharge coefficient equation development.

The Regression Data Set consists of data taken on four fluids (oil, water, natural gas, and air) from different sources, 11 different laboratories, on 12 different meter tubes of differing origins and more than 100 orifice plates of differing origins. The data provided a pipe Reynolds number range from accepted turbulent flow of 4000 to 36,000,000 on which to select the best model. The orifice configurations included flange, corner, and radius taps. Nominal pipe sizes investigated were 2, 3, 4, 6, and 10 inches, in compliance with ANSI/API 2530, A.G.A. Report No. 3 specifications. Nominal  $\beta$  ratios used in the equation determination were 0.100, 0.200, 0.375, 0.500, 0.575, 0.660, and 0.750.

The bivariate data ( $C_d, Re_D$ ) were measured in a manner appropriate for the test fluid and laboratory. The method of determining mass flow rate, expansion factor, fluid density, and fluid viscosity varied with the laboratory apparatus and test fluid.

Rather than including possibly erroneous data in the equation regression, the API/GPA/A.G.A. technical experts envisioned two classes of data sets for orifice research—regression and comparison. At a meeting of interested international orifice metering experts in November 1988, it was mutually agreed that the Regression Data Set be defined as follows:

The Regression Data Set shall consist of those data points contained in the API/GPA and EC discharge coefficient experiments which were performed on orifice plates whose diameter was greater than 0.45 inch (11.4mm) and if the pipe Reynolds number was equal to or greater than 4000 (turbulent flow regime).

Data which does not satisfy these criteria shall be included in the Comparison Data Set.

Although it does not mean that other data are of inferior quality, it is known that insufficient information exists to determine whether the independent variables were controlled and quantified. Some examples of comparison quality data are the Oklahoma State University Data Base (303 flange-tapped points), the 1983 NBS Boulder Experiments, the Foxboro-Columbus-Daniel 1000-Point Data Base, and the Japanese Water Data Base.

The exclusion for orifice bore diameters less than 0.45 inch (11.4 millimeters) was due to the increased uncertainty associated with the relative sharpness of the orifice plate upstream edge.

The Regression Data Set, as defined above, consists of data generated on orifice meters equipped with corner, radius, and flange tappings. The number of regression data points are summarized as follows:

Tapping	No. of points
Flange	5,734
Corner	2,298
Radius	2,160
Total	10,192

The empirical data associated with the API/GPA Data Base and the EC Data Base are the highest quality and largest quantity available today.

Detailed information on the experiments, regression data, statistical fit, and other pertinent information may be found in Report No. 3, Part 4, or the references contained in Appendix 1-A.

### 1.7.2 EMPIRICAL COEFFICIENT OF DISCHARGE EQUATION FOR FLANGE-TAPPED ORIFICE METERS

The concentric, square-edged, flange-tapped orifice meter coefficient of discharge,  $C_d(\text{FT})$ , equation, developed by Reader-Harris/Gallagher (RG), is structured into distinct linkage terms and is considered to best represent the current regression data base. The equation is applicable to nominal pipe sizes of 2 inches (50 millimeters) and larger; diameter ratios ( $\beta$ ) of 0.1–0.75, provided the orifice plate bore diameter,  $d_o$ , is greater than 0.45 inch (11.4 millimeters); and pipe Reynolds numbers ( $Re_D$ ) greater than or equal to 4000. For diameter ratios and pipe Reynolds numbers below the limit stated, refer to 1.12.4.1. The RG coefficient of discharge equation for an orifice meter equipped with flange taps is defined as follows:

$$C_d(\text{FT}) = C_i(\text{FT}) + 0.000511 \left[ \frac{10^6 \beta}{Re_D} \right]^{0.7} + (0.0210 + 0.0049A)\beta^4 C \quad (1-9)$$

$$C_i(\text{FT}) = C_i(\text{CT}) + \text{Tap Term} \quad (1-10)$$

$$C_i(\text{CT}) = 0.5961 + 0.0291\beta^2 - 0.2290\beta^8 + 0.003(1 - \beta)M_1 \quad (1-11)$$

$$\text{Tap Term} = \text{Upstrm} + \text{Dnstrm} \quad (1-12)$$

$$\text{Upstrm} = [0.0433 + 0.0712e^{-8.5L_1} - 0.1145e^{-6.0L_1}](1 - 0.23A)B \quad (1-13)$$

$$\text{Dnstrm} = -0.0116[M_2 - 0.52M_2^{1.3}]\beta^{1.1}(1 - 0.14A) \quad (1-14)$$

Also,

$$B = \frac{\beta^4}{1 - \beta^4} \quad (1-15)$$

$$M_1 = \max \left( 2.8 - \frac{D}{N_4}, 0.0 \right) \quad (1-16)$$

$$M_2 = \frac{2L_2}{1 - \beta} \quad (1-17)$$

$$A = \left[ \frac{19,000\beta}{Re_D} \right]^{0.8} \quad (1-18)$$

$$C = \left[ \frac{10^6}{Re_D} \right]^{0.35} \quad (1-19)$$

Where:

$\beta$  = diameter ratio  
=  $d/D$ .

$C_d(\text{FT})$  = coefficient of discharge at a specified pipe Reynolds number for flange-tapped orifice meter.

$C_i(\text{FT})$  = coefficient of discharge at infinite pipe Reynolds number for flange-tapped orifice meter.

$C_i(\text{CT})$  = coefficient of discharge at infinite pipe Reynolds number for corner-tapped orifice meter.

$d$  = orifice plate bore diameter calculated at  $T_f$ .

$D$  = meter tube internal diameter calculated at  $T_f$ .

$e$  = Napierian constant  
= 2.71828.

$L_1$  = dimensionless correction for the tap location  
=  $L_2$

=  $N_4/D$  for flange taps.

$N_4$  = 1.0 when  $D$  is in inches

= 25.4 when  $D$  is in millimeters.

$Re_D$  = pipe Reynolds number.

### 1.7.3 REYNOLDS NUMBER ( $Re_D$ )

The RG equation uses pipe Reynolds number as the correlating parameter to represent the change in the orifice plate coefficient of discharge,  $C_d$ , with reference to the fluid's mass flow rate (its velocity through the orifice), the fluid density, and the fluid viscosity.

The pipe Reynolds number can be calculated using the following equation:

$$Re_D = \frac{4q_m}{\pi\mu D} \quad (1-20)$$

The pipe Reynolds number equation used in this standard is in a simplified form that combines the numerical constants and unit conversion constants:

$$Re_D = \frac{N_2 q_m}{\mu D} \quad (1-21)$$

For the Reynolds number equations presented above, the symbols are described as follows:

$D$  = meter tube internal diameter calculated at flowing temperature ( $T_f$ ).

$\mu$  = absolute viscosity of fluid.

$N_2$  = unit conversion factor.

$\pi$  = universal constant  
= 3.14159.

$q_m$  = mass flow rate.

$Re_D$  = pipe Reynolds number.

The unit conversion factor,  $N_2$ , for the Reynolds number equations is defined and presented in 1.11.

## 1.7.4 FLOW CONDITIONS

### 1.7.4.1 General

The condition of the meter tube, the mating of the piping sections, the  $\Delta P$  sensing tap holes, the straight lengths of pipe preceding and following the primary element, and so forth, are factors that influence the flowing conditions. Although some factors may be considered insignificant for commercial purposes, flowing conditions can influence field accuracy.

To assure accuracy within the uncertainty stated, certain flow condition limitations must be followed:

- a. The flow shall approach steady-state mass flow conditions on fluids that are considered clean, single phase, homogeneous, and Newtonian.
- b. The fluid shall not undergo any change of phase as it passes through the orifice.
- c. The flow shall be subsonic through the orifice and the meter tube.
- d. The Reynolds number shall be within the specified limitations of the empirical coefficients.
- e. No bypass of flow around the orifice shall occur at any time.

### 1.7.4.2 Law of Similarity

The empirical coefficients calculated from the equations in this standard are valid if dynamic similarity exists between the metering installation and the experimental data base. Technically, this approach is termed the Law of Similarity.

Dynamic similarity is the underlying principle for present-day theoretical and experimental fluid mechanics. The principle states that two geometrically similar meters with identical initial flow directions shall display geometrically similar streamlines.

The mechanical specifications for the meter tube, the orifice plate, the orifice flanges or fitting, the differential pressure sensing taps, the upstream and downstream piping requirements, the flow straightener (if applicable), and the thermowell must be adhered to, as stated in the standard, to assure geometric similarity.

Geometric similarity requires that the experimental flow system be a scale model of the field installations. The experimental pattern's design identifies sensitive dimensional regions to explore, measure, and empirically fit. A proper experimental pattern for orifice meters allows the user to extrapolate to larger meter tube diameters without increasing the uncertainty.

Dynamic similarity implies a correspondence of fluid forces between the two metering systems. The Reynolds number is a measure of the ratio of the inertial to viscous forces. For the orifice meter, the inertial to viscous forces are the forces considered significant within the application limitations of this standard. As a result, the Reynolds number is the term that correlates dynamic similarity in all empirical coefficient of discharge equations. In fact, the Reynolds number correlation provides a rational basis for extrapolation of the empirical equation, provided the physics of the fluid does not change. For instance, the physics associated with subsonic flow is not similar to that associated with sonic flow.

For the empirical data base, undisturbed flow conditions (flow pattern and fully developed velocity profile) were achieved through the use of straight lengths of meter tube both upstream and downstream from the orifice and the use of flow straighteners. For both the API/GPA and EC experiments, an undisturbed flow condition was defined as the equivalent of a symmetrical, approximately swirl-free velocity profile located approximately 45 pipe diameters downstream of a Sprenkle flow conditioner, in circular pipes with an average internal surface wall roughness,  $R_a$ , of approximately 150 microinches.

### 1.7.5 PULSATING FLOW

Reliable measurements of flow cannot be obtained with an orifice meter when appreciable pulsations are present at the point of measurement. Currently, no satisfactory theoretical

or empirical adjustment for orifice measurement in pulsating flow applications exists that, when applied to custody transfer measurement, will maintain the measurement accuracy predicted by this standard.

#### 1.7.5.1 Sources

Pulsations in a pipeline, originating from a reciprocating device, a rotary device, valve actions, piping configuration, or another similar source, consist of sudden changes in the velocity, pressure, and density of the fluid flowing. The most common sources of pulsation are the following:

- a. Reciprocating compressors, engines, or impeller-type boosters.
- b. Pumping or improperly sized pressure regulators and loose or worn valves.
- c. Irregular movement of quantities of water or oil condensates in the line.
- d. Intermitters on wells, automatic drips, or separator dumps.
- e. Dead-ended piping tee junctions and similar cavities.

#### 1.7.5.2 Pulsation Reduction

To obtain reliable measurements, it is necessary to suppress pulsation. In general, the following practices have been effective in diminishing pulsation and/or its effect on orifice flow measurement:

- a. Locating the meter tube in a more favorable location with regard to the source of the pulsation, such as the inlet side of regulators, or increasing the distance from the source of the pulsation.
- b. Inserting capacity tanks (volume), flow restrictions, or specially designed filters in the line between the source of pulsation and the meter tube to reduce the amplitude of the pulsation.
- c. Using short-coupled impulse tubing and/or manifolds of approximately the same size as the pressure taps to the differential pressure measurement instrument.
- d. Operating at differentials as high as is practicable by replacing the orifice plate in use with a smaller orifice bore plate or by concentrating flow in a multiple meter tube installation through a limited number of tubes.
- e. Using smaller sized meter tubes and keeping essentially the same orifice diameter while maintaining the highest practical limit of the differential pressure.

Considerable study and experimentation have been conducted to evaluate the requirements and methods necessary to achieve pulsation reduction. This material is outside the scope of this standard and may be found in many publications that are readily available.

#### 1.7.5.3 Pulsation Instruments

Instruments, both mechanical and electronic, have been developed that indicate the presence of pulsation. These devices are used to determine the effectiveness of pulsation suppression practices.

### 1.8 Empirical Expansion Factor ( $Y$ ) for Flange-Tapped Orifice Meters

Expansibility research on water, air, steam, and natural gas using orifice meters equipped with various sensing taps is the basis for the present expansion factor equation. The empirical research compared the flow for an incompressible fluid with that of several compressible fluids.

The expansion factor,  $Y$ , was defined as follows:

$$Y = \frac{C_{d_1}}{C_{d_2}} \quad (1-22)$$

Where:

$C_{d_1}$  = coefficient of discharge from compressible fluids tests.

$C_{d_2}$  = coefficient of discharge from incompressible fluids tests.

Buckingham derived the empirical expansion factor equations for orifice meters equipped with various sensing taps based on the following correlation:

$$Y = f(\beta, k, x) \quad (1-23)$$

Where:

$\beta$  = diameter ratio ( $d/D$ ).

$k$  = isentropic exponent.

$x$  = ratio of differential pressure to absolute static pressure.

Compressible fluids expand as they flow through a square-edged orifice. For practical applications, it is assumed that the expansion follows a polytropic, ideal, one-dimensional path.

This assumption defines the expansion as reversible and adiabatic (no heat gain or loss). Within practical operating ranges of differential pressure, flowing pressure, and temperature, the expansion factor equation is insensitive to the value of the isentropic exponent. As a result, the assumption of a perfect or ideal isentropic exponent is reasonable for field applications. This approach was adopted by Buckingham and Bean in their correlation. They empirically developed the upstream expansion factor ( $Y_1$ ) using the downstream temperature and upstream pressure.

Within the limits of this standard's application, it is assumed that the temperatures of the fluid at the upstream and downstream differential sensing taps are identical for the expansion factor calculation.

The application of the expansion factor is valid as long as the following dimensionless pressure ratio criteria are followed:

$$0 < \frac{\Delta P}{N_3 P_f} < 0.20$$

Or,

$$0.8 < \frac{P_d}{P_f} < 1.0$$

Where:

$\Delta P$  = orifice differential pressure.

$N_3$  = unit conversion factor.

$P_f$  = absolute static pressure at the pressure tap.

$P_f$  = absolute static pressure at the upstream pressure tap.

$P_d$  = absolute static pressure at the downstream pressure tap.

Although use of the upstream or downstream expansion factor equation is a matter of choice, the upstream expansion factor is recommended because of its simplicity. If the upstream expansion factor is chosen, then the determination of the flowing fluid compressibility should be based on the upstream absolute static pressure,  $P_f$ . Likewise, if the downstream expansion factor is selected, then the determination of the flowing fluid compressibility should be based on the downstream absolute static pressure,  $P_d$ .

The expansion factor equation for flange taps is applicable over a  $\beta$  range of 0.10–0.75.

### 1.8.1 UPSTREAM EXPANSION FACTOR ( $Y_1$ )

The upstream expansion factor requires determination of the upstream static pressure, the diameter ratio, and the isentropic exponent.

If the absolute static pressure is taken at the upstream differential pressure tap, then the value of the expansion factor,  $Y_1$ , shall be calculated as follows:

$$Y_1 = 1 - (0.41 + 0.35\beta^4) \frac{x_1}{k} \quad (1-24)$$

When the upstream static pressure is measured,

$$x_1 = \frac{\Delta P}{N_3 P_{f_1}} \quad (1-25)$$

When the downstream static pressure is measured,

$$x_1 = \frac{\Delta P}{N_3 P_{f_2} + \Delta P} \quad (1-26)$$

Where:

$\Delta P$  = orifice differential pressure.

$k$  = isentropic exponent.

$N_3$  = unit conversion factor.

$P_{f_1}$  = absolute static pressure at the upstream pressure tap.

$P_{f_2}$  = absolute static pressure at the downstream pressure tap.

$x_1$  = ratio of differential pressure to absolute static pressure at the upstream tap.

$x_1/k$  = upstream acoustic ratio.

$Y_1$  = expansion factor based on the absolute static pressure measured at the upstream tap.

### 1.8.2 DOWNSTREAM EXPANSION FACTOR ( $Y_2$ )

The downstream expansion factor requires determination of the downstream static pressure, the upstream static pressure, the downstream compressibility factor, the upstream compressibility factor, the diameter ratio, and the isentropic exponent. The value of the downstream expansion factor,  $Y_2$ , shall be calculated using the following equation:

$$Y_2 = Y_1 \sqrt{\frac{P_{f_1} Z_{f_2}}{P_{f_2} Z_{f_1}}} \quad (1-27)$$

Or,

$$Y_2 = \left[ 1 - (0.41 + 0.35\beta^4) \frac{x_1}{k} \right] \sqrt{\frac{P_{f_1} Z_{f_2}}{P_{f_2} Z_{f_1}}} \quad (1-28)$$

When the upstream static pressure is measured,

$$x_1 = \frac{\Delta P}{N_3 P_{f_1}} \quad (1-29)$$

When the downstream static pressure is measured,

$$x_1 = \frac{\Delta P}{N_3 P_{f_2} + \Delta P} \quad (1-30)$$

Where:

$\Delta P$  = orifice differential pressure.

$k$  = isentropic exponent.

$N_3$  = unit conversion factor.

$P_{f_1}$  = absolute static pressure at the upstream pressure tap.

$P_{f_2}$  = absolute static pressure at the downstream pressure tap.

- $x_1$  = ratio of differential pressure to absolute static pressure at the upstream tap.  
 $x_1/k$  = upstream acoustic ratio.  
 $Y_1$  = expansion factor based on the absolute static pressure measured at the upstream tap.  
 $Y_2$  = expansion factor based on the absolute static pressure measured at the downstream tap.  
 $Z_{f_1}$  = fluid compressibility at the upstream pressure tap.  
 $Z_{f_2}$  = fluid compressibility at the downstream pressure tap.

## 1.9 In-Situ Calibration

### 1.9.1 GENERAL

The statement of the uncertainty of the empirical coefficient of discharge for concentric, square-edged orifice meters,  $C_d$ , is predicated on compliance with the requirements of this standard.

For accurate measurement applications, the flowmeter and adjacent piping should meet the requirements of the relevant, preferably the most stringent, specification of the standard. Deviations from the standard's specifications (for example, eccentricity, steps between adjacent sections of pipe, prerun lengths with or without a flow conditioner, post-run lengths, and pipe wall roughness) will invalidate the uncertainty statement.

To assure the accuracy of such flow measurements, the user may wish to calibrate the meter in situ. This is particularly suggested for orifice meters under 2 inches (50 millimeters) nominal pipe size. *In situ* is defined as being under normal operating conditions, with the actual approach piping configuration, using the actual fluid with the actual orifice plate and recording system in place.

Calibration of an orifice meter in situ requires the use of a primary mass flow system. This primary mass flow system may be portable or permanently installed. A master meter that has been calibrated with a primary mass flow standard can also be used for in-situ calibration.

The in-situ calibration should be performed with a primary mass flow system (or master meter) with an overall uncertainty less than the overall uncertainty of  $q_m$  of the meter being calibrated. Refer to the working uncertainty equation given in 1.12.

To perform an in-situ calibration, the primary mass flow system (or master meter) should be installed either upstream or downstream of the pipe fitting nearest to the meter tube or meter tube manifold so that it provides a calibration of the meter in its normal flowing configuration (that is, velocity profile). In-situ calibration should be performed at the normal flow rate, temperature, and pressure of the meter station. Additionally, in-situ calibration may be performed over the range of flow rates, temperatures, and pressures to assure a higher confidence level over the complete range of flowing conditions.

### 1.9.2 METER CORRECTION FACTOR

The in-situ calibration can provide a meter factor (MF) that may be used to correct the calculated mass flow rate as determined by Equation 1-1, if agreed upon by the parties. The MF is defined as follows:

$$MF = \frac{q_{m_p}}{q_{m_i}} = \frac{q_{m_p}}{q_v \rho_{t,p}} \quad (1-31)$$

Where:

- $q_{m_p}$  = mass flow rate determined by the primary mass flow system (or master meter).  
 $q_{m_i}$  = mass flow rate indicated by the orifice meter being calibrated.  
 $q_v$  = volumetric flow rate indicated by the orifice meter being calibrated.  
 $\rho_{t,p}$  = density (mass) of fluid at the meter at flowing conditions.

Alternatively, the results may be used to identify installations that exceed the uncertainty estimated using 1.12. If the MF falls outside the  $0.9 \leq MF \leq 1.1$  limits, the system should be investigated until the physical cause for the deviation has been identified and corrected.

When the meter factors are determined over a range of operating conditions, several values of MF may result. A plot of MF versus pipe Reynolds number ( $Re_D$ ) should provide a single curve that may be used for determining MF corrections.

If the MF is applied to the metered quantities for custody transfer purposes, then in-situ calibration should be periodically repeated to ensure accurate measurement. Additional in-situ calibrations should be performed when physical changes to the metering system or significantly different operating conditions are encountered.

## 1.10 Fluid Physical Properties

Certain fluid physical properties are required to solve the orifice flow equation.

For the mass flow equation, the following fluid properties are required:

- a. The viscosity at flowing conditions,  $\mu$ .
- b. The fluid density at flowing conditions,  $\rho_{t,p}$ .
- c. The isentropic exponent,  $k$ , for compressible fluids.

For the standard volumetric flow equation, the density at base conditions,  $\rho_b$ , is required for solution.

### 1.10.1 VISCOSITY ( $\mu$ )

The absolute (or dynamic) viscosity of the fluid at flowing conditions is required to compute the pipe Reynolds number. Fluid viscosities may be measured experimentally or computed from empirical equations.

For high Reynolds number applications, viscosity variations are usually ignored, since a sensitivity analysis indicates negligible effect in the flow computation. For low Reynolds number applications, accurate viscosity values and their variation with composition, temperature, and pressure may have a significant affect on the flow computation.

### 1.10.2 DENSITY ( $\rho_{t,p}$ , $\rho_b$ )

Appropriate values for the density of the fluid,  $\rho_{t,p}$  and  $\rho_b$ , can be obtained using one of two methods:

- a. Empirical density correlation. The empirical density value may be calculated by an equation of state or another technically qualified expression.
- b. On-line density meters. An on-line density meter can measure the fluid density at operating conditions (or base conditions).

For on-line density meter applications where the density at flowing conditions (or base conditions) is greater than 0.30 gram per cubic centimeter, refer to API Manual of Petroleum Measurement Standards Chapter 14.6 for the installation, operation, and calibration of these devices.

For on-line density meter applications where the density at flowing conditions (or base conditions) is less than 0.30 gram per cubic centimeter, refer to the manufacturers' recommendations for the installation, operation, and calibration of these devices. The manufacturer should be able to demonstrate that operation of the on-line density measurement device will not interfere with the basic operation of the orifice meter.

From a practical standpoint, the fluid temperature differences between the upstream sensing tap, the downstream sensing tap, and the temperature sensing device are assumed to be insignificant when the temperature device is installed as required in Report No. 3, Part 2. For fluids whose density changes rapidly with changes in flowing temperature, for low fluid

velocities, and/or to minimize ambient temperature and heat transfer effects, the user may wish to thermally insulate the meter tube between the primary element and the temperature device.

### 1.10.3 ISENTROPIC EXPONENT ( $k$ )

The isentropic exponent,  $k$ , is required in the solution of the empirical expansion factor ( $Y$ ) equation.

As a compressible fluid flows through the reduced area of an orifice plate bore, it undergoes a contraction and then an expansion. The expansion, which results in a change in the static pressure, is assumed to follow a polytropic path expressed by the following relationship:

$$\frac{P_f}{[\rho_{i,p}]^n} = \text{Constant} \quad (1-32)$$

Where:

$P_f$  = absolute static pressure.

$\rho_{i,p}$  = density of the fluid at flowing conditions ( $P_f$ ,  $T_f$ ).

$n$  = polytropic exponent.

However, if the expansion is assumed to be relatively rapid (that is, short in length) and the pressure change relatively small in magnitude, the polytropic relationship can be replaced by an idealized (reversible and adiabatic) one-dimensional isentropic expansion relationship of the following form:

$$\frac{P_f}{[\rho_{i,p}]^k} = \text{Constant} \quad (1-33)$$

Where:

$P_f$  = absolute static pressure.

$\rho_{i,p}$  = density of the fluid at flowing conditions ( $P_f$ ,  $T_f$ ).

$k$  = isentropic exponent.

The real compressible fluid isentropic exponent,  $k_r$ , is a function of the fluid and the pressure and temperature. For an ideal gas, the isentropic exponent,  $k_i$ , is equal to the ratio of its specific heats ( $c_p/c_v$ ) and is independent of pressure. A perfect gas is an ideal gas that has constant specific heats. The perfect gas isentropic exponent,  $k_p$ , is equal to  $k_i$  evaluated at base conditions. It has been found that for many applications, the value of  $k_r$  is nearly identical to the value of  $k_i$ , which is nearly identical to  $k_p$ . From a practical standpoint, the flow equation is not particularly sensitive to small variations in the isentropic exponent. Therefore, the perfect gas isentropic exponent,  $k_p$ , is often used in the flow equations. This greatly simplifies the calculations. This approach was adopted by Buckingham in his correlation for the expansion factor.

## 1.11 Unit Conversion Factors

### 1.11.1 ORIFICE FLOW EQUATION

The values for the unit conversion factor,  $N_1$ , for the orifice flow rate equation are summarized in Table 1-2. The table contains common engineering units, along with their corresponding conversion factor value.

### 1.11.2 REYNOLDS NUMBER EQUATION

The values for the unit conversion factor,  $N_2$ , for the Reynolds number equation are summarized in Table 1-3. The table contains common engineering units, along with their corresponding conversion factor value.



Table 1-3—Reynolds Number Equation: Unit Conversion Factor ( $N_2$ )
$$Re_D = \frac{4q_m}{\pi\mu D} \text{ or } Re_D = \frac{N_2 q_m}{\mu D}$$

Where:

	IP Units		SI Units	
$q_m$	lbm/sec		kg/sec	
$\pi$	3.14159		3.14159	Universal constant
$\mu$	lbm/ft-sec		kg/m-sec	SI Unit equal to Pa-sec
$D$	Feet		Meters	
$N_2$	1.27324 E+00		1.27324 E+00	
	1.27324		1.27324	

	U.S. Units		Metric Units	
$q_m$	lbm/sec	lbm/sec	kg/sec	kg/sec
$\pi$	3.14159	3.14159	3.14159	3.14159
$\mu$	Centipoise	Poise	Centipoise	Poise
$D$	Inches	Inches	Millimeters	Millimeters
$N_2$	2.27375 E+04	22.7375 E+01	1.27324 E+06	1.27324 E+04
	22,737.5	227.375	127,324	12,732.4

## 1.12 Practical Uncertainty Guidelines

The most important assumption underlying the calculation of the orifice discharge coefficient equation is that laboratories' systematic equipment biases are randomized within the data base. This means that there is no bias in the equation's ability to represent reality due to equipment variety in the various laboratories. Such an assumption of randomization has precedent in ISO 5168, established in 1978, and a 1939 paper by Rossini and Deming. This allows the use of results from the world's finest laboratories without requiring that experimental equipment be identical.

Table 1-4—Empirical Expansion Factor Equation: Unit Conversion Factor ( $N_3$ )
$$x = \frac{\Delta P}{N_3 P}$$

	IP Units		SI Units	
$\Delta P$	lbf/ft <sup>2</sup>		Pascals	
$P$	lbf/ft <sup>2</sup>		Pascals	
$N_3$	1.00000 E+00		1.00000 E+00	
	1.00000		1.00000	

	U.S. Units		U.S. Units	
$\Delta P$	lbs/in <sup>2</sup>		in H <sub>2</sub> O <sub>60</sub>	in H <sub>2</sub> O <sub>68</sub>
$P$	lbs/in <sup>2</sup>		lbs/in <sup>2</sup>	lbs/in <sup>2</sup>
$N_3$	1.00000 E+00		2.77070 E+01	2.77300 E+01
	1.00000		27.7070	27.7300

	Metric Units		Metric Units	
$\Delta P$	Kilopascals		Millibar	Millibar
$P$	Megapascals		Bar	Megapascals
$N_3$	1.00000 E+03		1.00000 E+03	1.00000 E-02
	1000.00		1000.00	0.0100000

Every effort has been made to remove residual bias from the representation of the experimental data by the equation for mass flow. Consequently, the subsequent precision statements are valid for an individual orifice meter installation for which physical characteristics and measurements of these characteristics are maintained within the precision that is used to determine the contributions to imprecision in mass flow measurement caused by various factors.

In accordance with prudent statistical and engineering practice, the estimated orifice flow rate uncertainty shall be calculated at the 95-percent confidence level.

### 1.12.1 GENERAL

Many factors associated with an orifice installation influence the overall error in flow measurement. These errors are due to uncertainties about the following:

- a. Representation of reality by the mass flow equation.
- b. Uncertainty about actual physical properties of the fluid being measured.
- c. Imprecision in the measurement of important installation parameters (such as orifice diameter and  $\beta$  ratio)

Examples of the calculations of the overall uncertainty as it depends on these major categories are given below. For ease of understanding, graphical summaries are presented where feasible.

### 1.12.2 UNCERTAINTY OVER A FLOW RANGE

From a practical standpoint, the accuracy envelope for an orifice meter is usually estimated using the uncertainty assigned to the differential pressure sensing device. This technique realistically estimates the uncertainty associated with the designer's flow range.

An accuracy envelope incorporates the influence quantities associated with the  $\Delta P$  sensing device. The significant quantities include ambient temperature effects, static pressure effects, long-term drift, hysteresis, linearity, repeatability, and the calibration standard's uncertainty.

For some applications, parallel orifice meters are required to meet the user's desired uncertainty and rangeability. In addition, the designer may choose to install stacked  $\Delta P$  devices calibrated for different ranges to minimize uncertainty while maximizing rangeability for a given orifice plate, as shown in Figure 1-3.

### 1.12.3 UNCERTAINTY OF FLOW RATE

The overall uncertainty is the quadrature sum (square root of the sum of the squares) of the uncertainties associated with the pertinent variables:

$$q_m = f(C_d, Y, \Delta P, d, D, \rho_{t,p})$$

For practical considerations, the pertinent variables are assumed to be independent to provide a simpler uncertainty calculation. In fact, no significant change in the uncertainty estimate will occur if the user applies the simplified uncertainty equations presented below.


The total uncertainty of the flow rate through an orifice meter may be calculated by one of two methods:

- a. Empirical coefficient of discharge using flange-tapped orifice meters.
- b. In-situ calibration using orifice meters.

#### 1.12.3.1 Uncertainty Using Empirical Coefficient of Discharge for Flange-Tapped Orifice Meter

The basic flow equation used is as follows:

$$q_m = C_d E_v Y (\pi/4) d^2 \sqrt{2g_c \rho_{t,p} \Delta P}$$

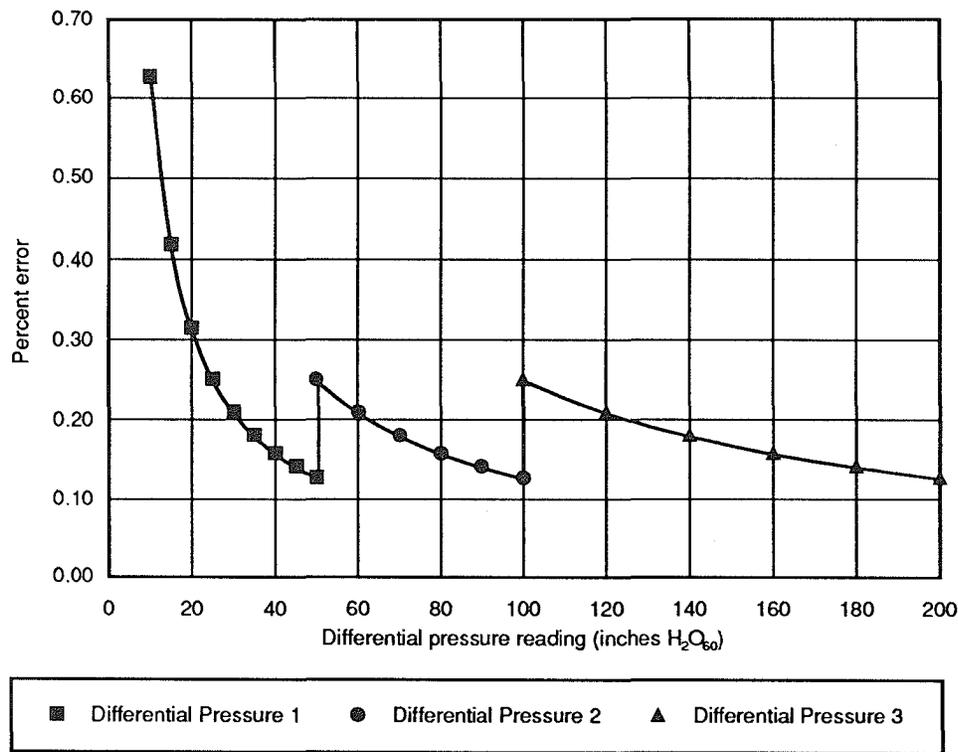

Note: The precision of the differential pressure device used in this example is  $\pm 0.25$  percent of full scale.

Figure 1-3—Contribution to Flow Error due to Differential Pressure Instrumentation

Where:

$E_v$  = velocity of approach factor

$$= \frac{1}{\sqrt{1 - \beta^4}}$$

$\beta$  = diameter ratio ( $d/D$ ).

Using differentiation, one can show that

$$(\delta q_m / q_m) = S_{C_d}(\delta C_d / C_d) + S_{E_v}(\delta E_v / E_v) + S_Y(\delta Y / Y) + S_d(\delta d / d) + S_{\rho_{t,p}}(\delta \rho_{t,p} / \rho_{t,p}) + S_{\Delta P}(\delta \Delta P / \Delta P) \quad (1-34)$$

Where:

$S$  = sensitivity coefficient of the particular variable.

Therefore,

$$S_{C_d} \text{ and } S_Y = 1.0$$

And,

$$\begin{aligned} S_d &= 2 \\ S_{\rho_{t,p}} &= \frac{1}{2} \\ S_{\Delta P} &= \frac{1}{2} \end{aligned}$$

By continuing this process to put  $\delta E_v / E_v$  in terms of  $\delta d / d$  and  $\delta D / D$ , it can be shown that

$$(\delta E_v / E_v) = \frac{2\beta^4}{1 - \beta^4} [(\delta d / d) - (\delta D / D)] \quad (1-35)$$

Assuming that independent estimates are available for  $\delta C_d / C_d$ ,  $\delta Y / Y$ ,  $\delta d / d$ , and  $\delta D / D$  and substituting for  $\delta E_v / E_v$  gives us the following working equation for the uncertainty of the mass flow rate:

$$(\delta q_m / q_m) = \left\{ (\delta C_d / C_d)^2 + (\delta Y / Y)^2 + \left[ \frac{2}{1 - \beta^4} \right]^2 (\delta d / d)^2 + \left[ \frac{-2\beta^4}{1 - \beta^4} \right]^2 (\delta D / D)^2 + \frac{1}{4} (\delta \rho_{t,p} / \rho_{t,p})^2 + \frac{1}{4} (\delta \Delta P / \Delta P)^2 \right\}^{0.5} \quad (1-36)$$

### 1.12.3.2 Uncertainty Using an In-Situ Calibration

When the orifice meter has been calibrated in situ, the practical working formula for the uncertainty of the mass flow rate can be expressed as follows:

$$(\delta q_m / q_m) = \left[ (\delta MF / MF)^2 + \frac{1}{4} (\delta \Delta P / \Delta P)^2 + \frac{1}{4} (\delta \rho_{t,p} / \rho_{t,p})^2 \right]^{0.5} \quad (1-37)$$

The meter factor (MF) term is estimated from the combination of the primary mass flow uncertainty, the master meter uncertainty, and the precision of the orifice meter calibration. Note that the meter factor (MF) determined for the orifice plate and tube is a combination of several possible errors. No additional uncertainty is necessary for installation conditions or expansion factor.

## 1.12.4 TYPICAL UNCERTAINTIES

For precise metering applications, such as custody transfer, the flowmeter and adjacent piping should meet the requirements of the relevant, preferably the most stringent, specification of the standard. In the following sections, the typical uncertainties expressed can be obtained only through compliance with the specifications of the standard.

### 1.12.4.1 Empirical Coefficient of Discharge

The estimated uncertainty of the empirical coefficient of discharge for concentric, square-edged, flange-tapped orifice meters that are in compliance with this standard is a function of the Reynolds number and the diameter ratio ( $\beta$ ). At very high Reynolds numbers the uncertainty is only a function of the diameter ratio ( $\beta$ ). This uncertainty estimate is shown graphically in Figure 1-4. As the Reynolds number decreases, the uncertainty of the orifice plate coefficient of discharge increases. The ratio of the uncertainty at a given Reynolds number to the uncertainty at infinite Reynolds number is shown graphically in Figure 1-5. The overall uncertainty of the empirical coefficient of discharge is the product of the value read from Figure 1-4 and the value read from Figure 1-5. The values for Figure 1-4 may be approximated by the following:

For  $\beta > 0.175$ ,

$$\delta C_i(\text{FT}) / C_d(\text{FT}) = 0.5600 - 0.2550\beta + 1.9316\beta^8 \quad (1-38)$$

For  $\beta \leq 0.175$ ,

$$\delta C_i(\text{FT}) / C_d(\text{FT}) = 0.7000 - 1.0550\beta \quad (1-39)$$

The values for Figure 1-5 may be approximated by the following:

$$\delta C_d(\text{FT}) / \delta C_i(\text{FT}) = 1 + 1.7895 \left( \frac{4000}{Re_D} \right)^{0.8} \quad (1-40)$$

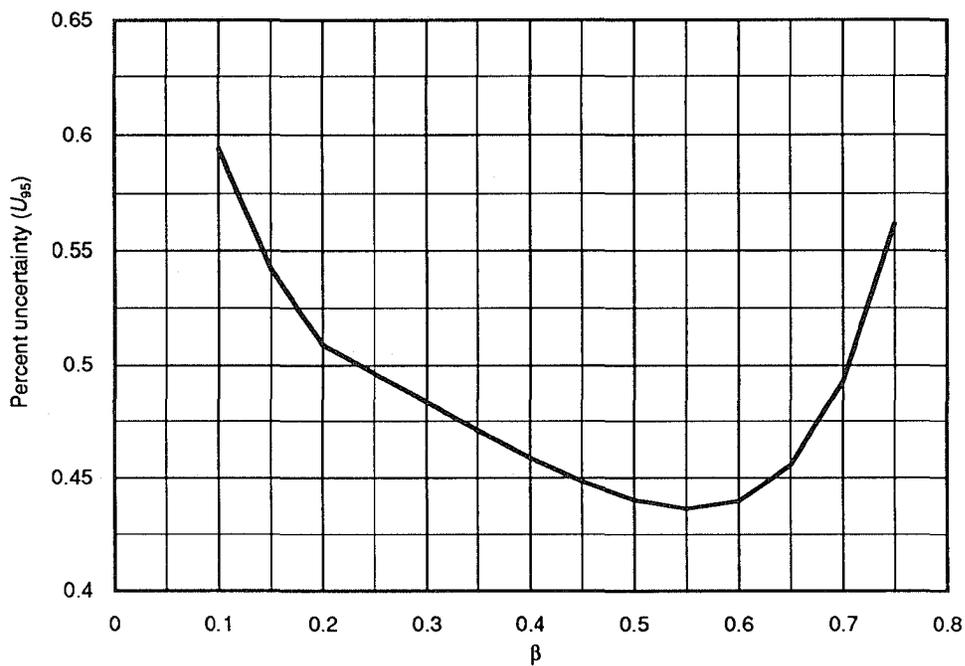


Figure 1-4—Empirical Coefficient of Discharge:  
Uncertainty at Infinite Reynolds Number

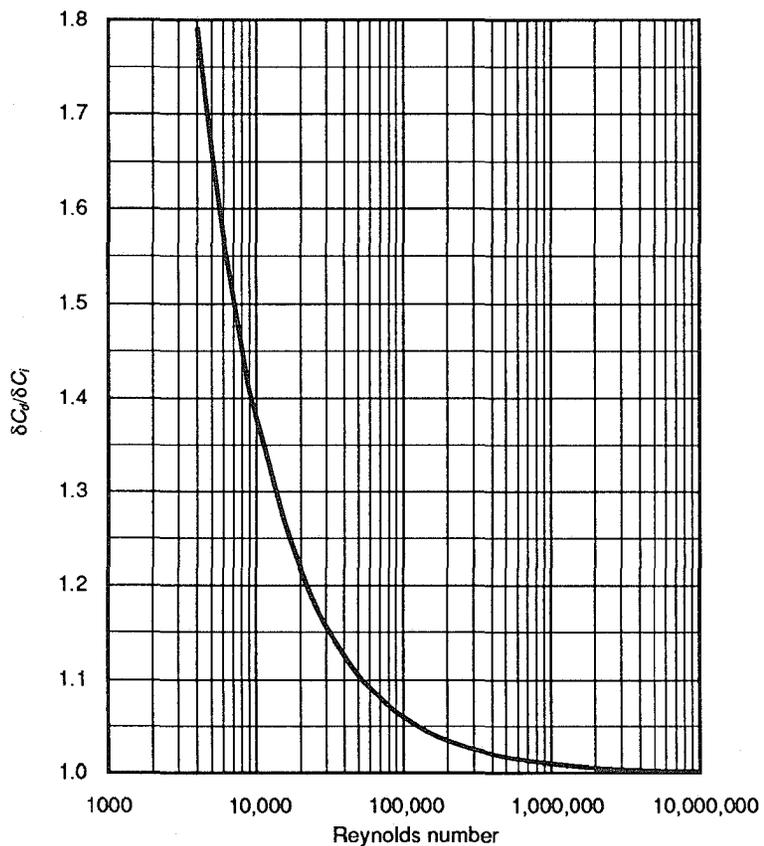


Figure 1-5—Relative Change in Uncertainty: Dependence on Reynolds Number

These estimates for the uncertainty were developed using the regression data base discussed in 1.7.1. Orifice plates with bore diameters less than 0.45 inch (11.4 millimeters), installed according to Report No. 3, Part 2, may have coefficient of discharge [ $C_d(FT)$ ] uncertainties as great as 3.0 percent. This large uncertainty is due to problems with edge sharpness. These types of problems are discussed further in Report No. 3, Part 2. Deviations from the installation specifications in Report No. 3, Part 2, will invalidate this uncertainty statement.

#### 1.12.4.2 Empirical Expansion Factor for Flange-Tapped Orifice Meters

The values of  $Y$  computed by the empirical equations are subject to a tolerance varying from 0, when  $x = 0$ , to  $\pm 0.5$  percent, when  $x = 0.2$ . For larger values of  $x$ , a somewhat larger uncertainty may be expected.

An alternative approach for determining the uncertainty for the expansion factor, which has been proposed in the international community, stipulates that when  $\beta$ ,  $\Delta P$ ,  $P_f$ , and  $k$  are assumed to be known without error, the percentage uncertainty of the value of  $Y$  is estimated by

$$\pm 4 \left[ \frac{\Delta P}{N_3 P_f} \right] \text{ when } \beta \leq 0.750$$

The expansion factor uncertainty is presented in Table 1-5. For fluids that are not compressible, the expansion factor equals 1.000 by definition, and the estimated uncertainty is zero.

Table 1-5—Uncertainty Statement for Empirical Expansion Factor

Common U.S. Units									
$\Delta P$ (inches $H_2O_{60}$ )	psid	Expansion Factor Uncertainty (%) When $P_f$ (psia) Equals							
		50	100	250	500	750	1000	1250	1500
10	0.36	0.03	0.01	0.01	0.00	0.00	0.00	0.00	0.00
50	1.80	0.14	0.07	0.03	0.01	0.01	0.01	0.01	0.00
100	3.61	0.29	0.14	0.06	0.03	0.02	0.01	0.01	0.01
150	5.41	0.43	0.22	0.09	0.04	0.03	0.02	0.02	0.01
200	7.22	0.58	0.29	0.12	0.06	0.04	0.03	0.02	0.02
250	9.02	0.72	0.36	0.14	0.07	0.05	0.04	0.03	0.02
300	10.83	0.87	0.43	0.17	0.09	0.06	0.04	0.03	0.03
Common SI Units									
$\Delta P$ (inches $H_2O_{60}$ )	kPa	Expansion Factor Uncertainty (%) When $P_f$ (MPa) Equals							
		0.3	0.7	1.7	3.4	5.2	6.9	8.6	10.3
10	2.49	0.03	0.01	0.01	0.00	0.00	0.00	0.00	0.00
50	12.44	0.14	0.07	0.03	0.01	0.01	0.01	0.01	0.00
100	24.88	0.29	0.14	0.06	0.03	0.02	0.01	0.01	0.01
150	37.33	0.43	0.22	0.09	0.04	0.03	0.02	0.02	0.01
200	49.77	0.58	0.29	0.12	0.06	0.04	0.03	0.02	0.02
250	62.21	0.72	0.36	0.14	0.07	0.05	0.04	0.03	0.02
300	74.65	0.87	0.43	0.17	0.09	0.06	0.04	0.03	0.03

Notes:

1. Orifice plates having bore diameters less than 0.45 inch (11.4 millimeters), installed according to Report No. 3, Part 2, may have coefficient of discharge ( $C_d$ ) uncertainties as great as 3.0 percent. This large uncertainty is due to problems with edge sharpness.
2. The relative uncertainty level depicted in Figure 1-6 assumes a swirl-free inlet velocity profile.

### 1.12.4.3 Installation Conditions

To assure accurate flow measurement, the fluid should enter the orifice plate with a fully developed flow profile, free from swirl or vortices. Such a condition is best achieved through the use of flow conditioners and adequate lengths of straight pipe preceding and following the orifice plate.

For various technical reasons, the uncertainty associated with installation conditions is difficult to quantify. Therefore, Figure 1-6 has been provided as a general guide. This figure represents a combined practical uncertainty level attributed to the following parameters:


- a. Empirical coefficient of discharge.
- b. Installation conditions, such as velocity profile and swirl.
- c. Mechanical specifications, such as pipe wall roughness, plate eccentricity, and orifice plate bore edge sharpness.

Figure 1-6 depicts the prospective combined uncertainty level as a function of diameter ratio ( $\beta$ ). It is apparent from the figure that the lowest relative combined uncertainty levels occur over a diameter ratio range of 0.10–0.60.

The approach length (upstream meter tube), piping configuration, and flow conditioning recommendations presented in Report No. 3, Part 2, are essentially unchanged from the second (1985) edition of the standard. Substantial research programs in these areas are currently under way by the API, the EC,<sup>4</sup> and the GRI.<sup>5</sup> A restatement of the orifice meter

<sup>4</sup>Commission of the European Communities, rue de la Loi 200, B-1049, Brussels, Belgium.

<sup>5</sup>Gas Research Institute, 8600 West Bryn Mawr Avenue, Chicago, Illinois 60631.

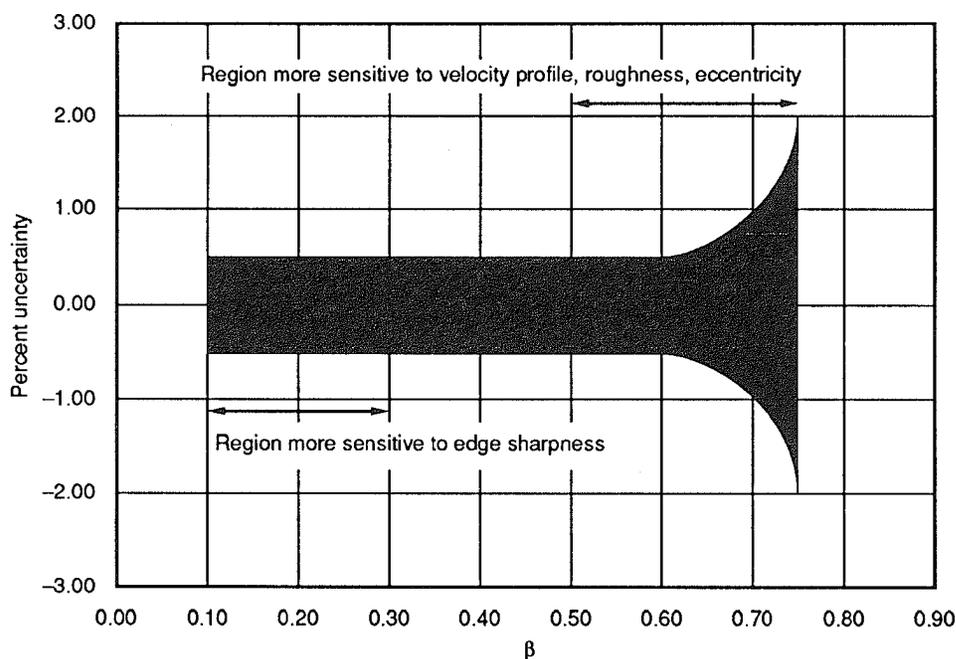

Notes:

1. Orifice plates whose bore diameters are less than 0.45 inch (11.4 millimeters), installed according to Report No. 3, Part 2, may have coefficient of discharge uncertainties as great as 3.0 percent. This large uncertainty is due to problems with edge sharpness.
2. The relative uncertainty level shown in the figure assumes a swirl-free inlet velocity profile.

Figure 1-6—Practical Uncertainty Levels

uncertainty will naturally follow the conclusion of the current research and may offer a basis for future changes in this standard.

#### 1.12.4.4 Orifice Plate Bore Diameter

The plate diameter uncertainty may be determined from dimensional measurements or, alternatively, from the roundness specifications presented in Report No. 3, Part 2.

If the dimensional measurements are available, the plate diameter uncertainty is equated to the root mean square (rms) of the differences between each reading and the mean value.

For example, if the four measurements for  $d_m$  are 20.005, 20.002, 19.995, and 19.9980, then the mean value is 20.000.

The deviations from the mean are +0.005, +0.002, -0.005, and -0.002, so

$$\begin{aligned}
 \delta d_m &= \left[ \frac{\sum_{i=1}^n (\delta d_m)^2}{n-1} \right]^{0.5} \\
 &= \pm \left[ \frac{(0.005)^2 + (0.002)^2 + (-0.005)^2 + (-0.002)^2}{3} \right]^{0.5} \\
 &= \pm 0.0044 \\
 \frac{\delta d_m}{d_m} &= \pm \frac{0.0044}{20.00} \\
 &= \pm 0.00022 \times 100 \\
 &= \pm 0.022 \text{ percent}
 \end{aligned} \tag{1-41}$$

#### 1.12.4.5 Meter Tube Internal Diameter

The meter tube diameter uncertainty may be determined from dimensional measurements or, alternatively, from the roundness specifications presented in Report No. 3, Part 2.

If the dimensional measurements are available, the meter tube diameter uncertainty is equated to the root mean square (rms) of the differences between each reading and the mean value.

For example, if the four measurements for  $D_m$  are 20.050, 20.020, 19.950, and 19.980, then the mean value is 20.000.

The deviations from the mean are +0.05, +0.02, -0.05, and -0.02, so

$$\begin{aligned}
 \delta D_m &= \left[ \frac{\sum_{i=1}^n (\delta D_m)^2}{n-1} \right]^{0.5} \\
 &= \pm \left[ \frac{(0.05)^2 + (0.02)^2 + (-0.05)^2 + (-0.02)^2}{3} \right]^{0.5} \\
 &= \pm 0.044 \\
 \frac{\delta D_m}{D_m} &= \pm \frac{0.044}{20.00} \\
 &= \pm 0.0022 \times 100 \\
 &= \pm 0.22 \text{ percent}
 \end{aligned} \tag{1-42}$$

#### 1.12.4.6 Differential Pressure Device

Performance specifications for the differential pressure device must be provided by the manufacturer. The user selects a device based on its performance specifications and the desired uncertainty associated with the application.

When considering the uncertainty, care should be taken to take into account the effects of ambient temperature, humidity, static pressure, driving mechanism, and response time on the user-selected device.

#### 1.12.4.7 Fluid Density

When an empirical correlation is used to predict a liquid density, the uncertainty should be estimated based on the stated uncertainty of the correlation and the estimated uncertainty of the variables required to calculate the density. The following example for propylene, calculated using the method of API Manual of Petroleum Measurement Standards, Chapter 11.3.3.2, demonstrates this procedure.

Propylene is being metered at 60°F and 800 pounds per square inch absolute. The stated uncertainty of the Chapter 11.3.3.2 method for calculating the density of propylene is  $\pm 0.24$  percent. The stated uncertainty of the temperature measurement is  $\pm 0.5^\circ\text{F}$ . The stated uncertainty of the pressure measurement is  $\pm 4$  pounds per square inch absolute. The uncertainty in the density is calculated according to the following formula:

$$(\delta \rho_{i,p} / \rho_{i,p}) = \left\{ (\delta \rho_{i,p} / \rho_{i,p})^2 + \left[ \frac{\partial \rho_{i,p}}{\partial T_f} \right]_{P_f}^2 (\delta T_f / \rho_{i,p})^2 + \left[ \frac{\partial \rho_{i,p}}{\partial P_f} \right]_{T_f}^2 (\delta P_f / \rho_{i,p})^2 \right\}^{0.5} \quad (1-43)$$

Using this method, the following calculated values can be used to estimate  $(\partial \rho_{i,p} / \partial T_f)_{P_f}$  and  $(\partial \rho_{i,p} / \partial P_f)_{T_f}$ :

$T_f$ (°F)	$P_f$ (psia)	Density (lb/ft <sup>3</sup> )
60	800	33.3413
60	780	33.3215
60	820	33.3611
58	800	33.4445
62	800	33.2376

$$\left[ \frac{\partial \rho_{i,p}}{\partial T_f} \right]_{P_f} \cong (33.2376 - 33.4445) / 4 = -0.052$$

$$\left[ \frac{\partial \rho_{i,p}}{\partial P_f} \right]_{T_f} \cong (33.3611 - 33.3215) / 40 = -0.00099$$

Then,

$$\begin{aligned} \delta \rho_{i,p} / \rho_{i,p} &\cong \pm \left[ (0.0024)^2 + (-0.052)^2 \left( \frac{0.5}{33.3413} \right)^2 + (0.00099)^2 \left( \frac{4}{33.3413} \right)^2 \right]^{0.5} \\ &= \pm [0.0024^2 + 0.0008^2 + 0.0001^2]^{0.5} \\ &= \pm 0.0025 \text{ or } \pm 0.25 \text{ percent} \end{aligned}$$

Therefore, the estimated overall uncertainty in the propylene density is  $\pm 0.25$  percent.

When on-line density meters are used, the uncertainty should be estimated based on the calibration technique, density differences between the orifice and density meter locations, and the density meter manufacturer's recommendations.

#### 1.12.5 EXAMPLE UNCERTAINTY CALCULATIONS

Example uncertainty calculations for liquid and gas flows are presented in 1.12.5.1 and 1.12.5.2.

##### 1.12.5.1 Example Uncertainty Estimate for Liquid Flow Calculation

An example of the effect of uncertainties is provided in Table 1-6, using the following flow equation:

Table 1-6—Example Uncertainty Estimate for Liquid Flow Calculation

		Uncertainty, $U_{95}(\%)$	Sensitivity Coefficient, S	$(U_{95}S)^2$
$C_d$	Basic discharge coefficient	0.45	1.0	0.2025
$d$	Orifice diameter (Table 2-1)	0.05	$2/(1 - \beta^4)$	0.0114
$D$	Pipe diameter (2.5.1.3)	0.25	$-2\beta^4/(1 - \beta^4)$	0.0011
$\Delta P$	Differential pressure	0.50	0.5	0.0625
$\rho$	Density	0.45	0.5	0.0506
	Sum of squares			0.3281
	Square root of sum of squares			0.5728

Note: As the table shows, the overall liquid flow measurement uncertainty at a 95-percent confidence level is  $\pm 0.57$  percent.

$$q_m = C_d E_v Y (\pi/4) d^2 \sqrt{2 g_c \rho_{i,p} \Delta P}$$

The following assumptions and conditions were selected for the calculation:

- The fluid flowing is propylene. The liquid density will be calculated using the API Manual of Petroleum Measurement Standards, Chapter 11.3.3.2 method. The viscosity will be estimated using Procedure 11A5.1 from the API *Technical Data Book—Petroleum Refining*. The expansion factor will be assumed to be 1.0.
- A 4-inch meter with a  $\beta$  ratio of 0.5, a static pressure of 800 pounds per square inch absolute, a flowing temperature of 60°F, and a differential pressure of 50 inches of water (60°F) is selected for the calculation.
- For each variable, the uncertainty listed represents random error only.

As a result of the first two assumptions, the estimated values of the required physical properties are as follows:

$$\begin{aligned} \rho_{i,p} &= 33.3413 \text{ lbm/ft}^3. \\ \delta\rho_{i,p}/\rho_{i,p} &= 0.25 \text{ percent (as shown in liquid density sensitivity section).} \\ \mu &= 0.0956 \text{ centipoise} = 0.0000643 \text{ lbm/ft-sec.} \end{aligned}$$

As a result of the calculations for the flow rate,

$$\begin{aligned} C_d(\text{FT}) &= 0.603659. \\ q_m &= 10.148 \text{ lbm/sec.} \\ Re_D &= 603,400. \\ \delta C_i(\text{FT})/C_d(\text{FT}) &= \pm 0.44 \text{ percent (from Figure 1-4).} \\ \delta C_d(\text{FT})/\delta C_i(\text{FT}) &= 1.02 \text{ (from Figure 1-5).} \end{aligned}$$

This gives

$$\delta C_d(\text{FT})/C_d(\text{FT}) = 1.02 \times \pm 0.44 = \pm 0.45 \text{ percent.}$$

### 1.12.5.2 Example Uncertainty Estimate for Natural Gas Flow Calculation

For natural gas flow, fluid density is defined as follows:

$$\rho_{i,p} = \frac{G_i M_{r_{air}} P_f}{Z_f R T_f} \quad (1-44)$$

Where:

- $G_i$  = ideal gas relative density (specific gravity) of the gas ( $M_{r_{gas}}/M_{r_{air}}$ ).
- $M_{r_{air}}$  = molar mass of air.
- $M_{r_{gas}}$  = molar mass of the gas.
- $P_f$  = static pressure of fluid.

$R$  = universal gas constant.

$T_f$  = temperature of the fluid at flowing conditions.

$Z_f$  = fluid compressibility at flowing conditions.

The fluid density uncertainty term,  $\frac{1}{4}(\delta\rho_{i,p}/\rho_{i,p})^2$  in 1.12.3.1 is replaced by the following terms for natural gas application:

$$\left[\frac{1}{2}(\delta G_i/G_i)\right]^2 + \left[\frac{1}{2}(\delta P_f/P_f)\right]^2 + \left[-\frac{1}{2}(\delta Z_f/Z_f)\right]^2 + \left[-\frac{1}{2}(\delta T_f/T_f)\right]^2$$

An example of the effect of uncertainties is provided in Table 1-7, using the following gas flow equation:

$$q_m = C_d E_v Y (\pi/4) d^2 \sqrt{2g_c \frac{G_i M_{r,air} P_f}{Z_f R T_f} \Delta P} \quad (1-45)$$

The following assumptions and conditions were selected for the calculation:

- For each variable, the uncertainty listed represents random error only.
- A 4-inch meter with a  $\beta$  ratio of 0.5 and static and differential pressures equal to 250 pounds per square inch absolute and 50 inches of water, respectively, was selected for the calculation.

Note: The precision of the  $\Delta P$  device used in this example was  $\pm 0.25$  percent of full scale.

Table 1-7—Example Uncertainty Estimate for Natural Gas Flow Calculation

		Uncertainty, $U_{95}(\%)$	Sensitivity Coefficient, S	$(U_{95}S)^2$
$C_d$	Basic discharge coefficient (Figure 1-4)	0.44	1	0.1936
$Y$	Expansion factor (Table 1-5)	0.03	1	0.0009
$d$	Orifice diameter (Table 2-1)	0.05	$2/(1 - \beta^4)$	0.0114
$D$	Pipe diameter (2.5.1.3)	0.25	$-2\beta^4/(1 - \beta^4)$	0.0110
$\Delta P$	Differential pressure	0.50	0.5	0.0625
$P$	Static pressure	0.50	0.5	0.0625
$Z$	Compressibility factor (A.G.A. 8)	0.1	-0.5	0.0025
$T$	Flowing temperature	0.25	-0.5	0.0156
$G$	Relative density	0.60	0.5	0.0900
	Sum of squares			0.4500
	Square root of sum of squares			0.6700

Note: As the table shows, the overall gas flow measurement uncertainty at a 95-percent confidence level is  $\pm 0.67$  percent.



## APPENDIX 1-A—REFERENCES

Note: This appendix is not a part of this standard but is included for informational purposes only.

The following references are pertinent to the discussions contained in Part 1.

### 1-A.1 Discharge Coefficient Studies

#### 1-A.1.1 API/GPA EXPERIMENTAL PROGRAM

Britton, C. L., Caldwell, S., and Seidl, W., "Measurements of Coefficients of Discharge for Concentric, Flange-Tapped, Square-Edged Orifice Meters in White Mineral Oil Over a Low Reynolds Number Range," American Petroleum Institute, Washington, D.C., 1988.

"Coefficients of Discharge for Concentric, Square-Edged, Flange-Tapped Orifice Meters: Equation Data Set—Supporting Documentation for Floppy Diskettes," American Petroleum Institute, Washington, D.C., 1988.

Whetstone, J. R., Cleveland, W. G., Baumgarten, G. P., and Woo, S., "Measurements of Coefficients of Discharge for Concentric, Flange-Tapped, Square-Edged Orifice Meters in Water Over a Reynolds Number Range of 600 to 2,700,000" (Technical Note 1264), National Institute of Standards and Technology, Washington, D.C., 1989.

#### 1-A.1.2 EC EXPERIMENTAL PROGRAM

Hobbs, J. M., "Experimental Data for the Determination of Basic 100mm Orifice Meter Discharge Coefficients" (Report EUR 10027), Commission of the European Communities, Brussels, 1985.

Hobbs, J. M., "The EEC Orifice Plate Project: Part I. Traceabilities of Facilities Used and Calculation Methods Employed" (Report PR5:EUEC/17), Commission of the European Communities, Brussels, 1987.

Hobbs, J. M., "The EEC Orifice Plate Project: Part II. Critical Evaluation of Data Obtained During EEC Orifice Plate Tests" (Report EUEC/17), Commission of the European Communities, Brussels, 1987.

Hobbs, J. M., "The EEC Orifice Plate Project: Tables of Valid Data for EEC Orifice Analysis" (Report EUEC/17), Commission of the European Communities, Brussels, 1987.

Hobbs, J. M., Sattary, J. A., and Maxwell, A. D., "Experimental Data for the Determination of Basic 250mm Orifice Meter Discharge Coefficients" (Report EUR 10979), Commission of the European Communities, Brussels, 1987.

#### 1-A.1.3 OSU EXPERIMENTAL PROGRAM

Beitler, S. R., "The Flow of Water Through Orifices" (Bulletin 89), Engineering Experiment Station, Ohio State University, Columbus, 1935.

Fling, W. A., "API Orifice Meter Program" (Paper 83-T-23), *Operating Section Proceedings*, American Gas Association, Arlington, Virginia, 1983, pp. 308–311.

#### 1-A.1.4 EMPIRICAL COEFFICIENT EQUATIONS

Beaty, R. E., Fling, W. A., Gallagher, J. E., Hoglund, P. A., Tessandier, R. G., and West, K. I., "The API/GPA Experimental Data Base," Paper presented at the American Gas Association Distribution/Transmission Conference, New Orleans, May 22–24, 1989.

Gallagher, J. E., "The A.G.A. Report No. 3 Orifice Plate Discharge Coefficient Equation," Paper presented at the Second International Symposium on Fluid Flow Measurement, Calgary, June 6–8, 1990.

Stolz, J., "A Universal Equation for the Calculation of Discharge Coefficient of Orifice Plates," *Flow Measurement of Fluids*, North-Holland, Amsterdam, 1978.

### 1-A.2 Expansion Factor Studies

Bean, H. S., "Values of Discharge Coefficients of Square-Edged Orifices: Comparison of Results Obtained by Tests Using Gases with Those Obtained by Tests Using Water," *American Gas Association Monthly*, July 1935, Volume 17, p. 259.

Buckingham, E., "Note on Contraction Coefficients for Jets of Gas," *National Bureau of Standards Journal of Research*, May 1931, Volume 6, RP 303, p. 765.

Buckingham, E., "Notes on the Orifice Meter: The Expansion Factor for Gases," *National Bureau of Standards Journal of Research*, July 1932, Volume 9, RP 459, p. 61.

Murdock, J. W., and Folts, C. J., "Experimental Evaluation of Expansion Factors for Steam," *Transactions of the ASME*, July 1953, Volume 75, No. 5, p. 953.

Smith, Jr., Edward S., "Quantity-Rate Fluid Meters" (Paper 719), Paper presented at the World Engineering Congress, Tokyo, 1929.

### 1-A.3 Conversion Constants

*Manual of Petroleum Measurement Standards*, Chapter 15, "Guidelines for the Use of the International System of Units (SI) in the Petroleum and Allied Industries" (2nd ed.), American Petroleum Institute, Washington, D.C., December 1980.

### 1-A.4 Uncertainty Estimation

ASME MFC-2M, *Measurement Uncertainty for Fluid Flow in Closed Conduits*, American Society of Mechanical Engineers, New York, 1988.

ISO 5168, *Measurement Uncertainty for Fluid Flow in Closed Conduits*, International Standards Organization, Geneva, 1978.

Rossini, F. D., and Deming, W. E., *Journal of the Washington Academy of Sciences*, 1939, Volume 29, p. 416.

### **1–A.5 Material Properties**

ASME B46.1, *Surface Texture (Surface Roughness, Waviness and Lay)*, American Society of Mechanical Engineers, New York, 1985.

ASME PTC 19.5, *Application, Part II of Fluid Meters: Interim Supplement on Instruments and Apparatus*, American Society of Mechanical Engineers, New York, 1972.

*Metals Handbook* (Desk Edition), American Society for Metals, Metals Park, Ohio, 1985.

### **1–A.6 Boundary–Layer Theory**

Schlichting, H., *Boundary-Layer Theory* (7th ed.), McGraw-Hill, New York, 1979.

## **APPENDIX 1-B—DISCHARGE COEFFICIENTS FOR FLANGE-TAPPED ORIFICE METERS**

Note: This appendix is not a part of this standard but is included for informational purposes only.



Table 1-B-1—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 2-Inch (50-Millimeter) Meter  
 [ $D = 1.939$  Inches (49.25 Millimeters)]

$\beta$	Pipe Reynolds Number ( $Re_D$ )									
	4000	10,000	50,000	100,000	500,000	$1 \times 10^6$	$5 \times 10^6$	$10 \times 10^6$	$50 \times 10^6$	$100 \times 10^6$
0.02	0.60014	0.59940	0.59883	0.59873	0.59862	0.59860	0.59858	0.59857	0.59857	0.59857
0.04	0.60102	0.59981	0.59890	0.59873	0.59854	0.59851	0.59847	0.59847	0.59846	0.59846
0.06	0.60178	0.60016	0.59895	0.59872	0.59848	0.59844	0.59839	0.59838	0.59837	0.59837
0.08	0.60248	0.60050	0.59901	0.59873	0.59843	0.59838	0.59832	0.59831	0.59830	0.59829
0.10	0.60315	0.60083	0.59908	0.59875	0.59840	0.59834	0.59827	0.59826	0.59824	0.59824
0.12	0.60381	0.60116	0.59916	0.59879	0.59839	0.59832	0.59824	0.59823	0.59821	0.59821
0.14	0.60448	0.60150	0.59927	0.59886	0.59841	0.59832	0.59823	0.59821	0.59820	0.59819
0.16	0.60515	0.60187	0.59940	0.59894	0.59844	0.59835	0.59825	0.59823	0.59820	0.59820
0.18	0.60586	0.60226	0.59955	0.59905	0.59850	0.59840	0.59828	0.59826	0.59824	0.59823
0.20	0.60660	0.60269	0.59974	0.59919	0.59859	0.59848	0.59835	0.59832	0.59829	0.59829
0.22	0.60738	0.60315	0.59996	0.59936	0.59871	0.59858	0.59844	0.59841	0.59838	0.59837
0.24	0.60823	0.60367	0.60022	0.59957	0.59886	0.59872	0.59856	0.59853	0.59849	0.59848
0.26	0.60914	0.60423	0.60052	0.59982	0.59904	0.59889	0.59871	0.59867	0.59863	0.59862
0.28	0.61014	0.60487	0.60087	0.60011	0.59926	0.59909	0.59889	0.59885	0.59880	0.59878
0.30	0.61123	0.60557	0.60127	0.60045	0.59952	0.59933	0.59911	0.59906	0.59900	0.59898
0.32	0.61243	0.60635	0.60173	0.60084	0.59982	0.59962	0.59936	0.59931	0.59923	0.59921
0.34	0.61375	0.60722	0.60224	0.60128	0.60017	0.59994	0.59965	0.59959	0.59950	0.59948
0.36	0.61522	0.60818	0.60282	0.60178	0.60056	0.60030	0.59998	0.59990	0.59980	0.59978
0.38	0.61683	0.60926	0.60347	0.60234	0.60100	0.60071	0.60034	0.60026	0.60014	0.60011
0.40	0.61862	0.61044	0.60419	0.60296	0.60149	0.60117	0.60075	0.60065	0.60051	0.60047
0.42	0.62059	0.61175	0.60499	0.60365	0.60202	0.60167	0.60119	0.60108	0.60091	0.60087
0.44	0.62276	0.61319	0.60586	0.60440	0.60261	0.60221	0.60167	0.60154	0.60134	0.60129
0.46	0.62515	0.61476	0.60682	0.60522	0.60324	0.60279	0.60218	0.60203	0.60180	0.60174
0.48	0.62777	0.61647	0.60784	0.60610	0.60391	0.60341	0.60271	0.60254	0.60228	0.60221
0.50	0.63063	0.61833	0.60895	0.60703	0.60462	0.60406	0.60327	0.60307	0.60278	0.60270
0.52	0.63374	0.62034	0.61012	0.60803	0.60536	0.60473	0.60384	0.60361	0.60327	0.60318
0.54	0.63712	0.62249	0.61136	0.60906	0.60612	0.60541	0.60441	0.60415	0.60376	0.60366
0.56	0.64077	0.62479	0.61265	0.61014	0.60688	0.60609	0.60497	0.60467	0.60423	0.60411
0.58	0.64470	0.62722	0.61399	0.61123	0.60763	0.60675	0.60549	0.60516	0.60465	0.60451
0.60	0.64890	0.62979	0.61535	0.61233	0.60836	0.60738	0.60596	0.60558	0.60501	0.60486
0.62	0.65337	0.63246	0.61671	0.61341	0.60903	0.60794	0.60636	0.60593	0.60529	0.60511
0.64	0.65811	0.63524	0.61806	0.61445	0.60963	0.60842	0.60665	0.60617	0.60545	0.60525
0.66	0.66309	0.63809	0.61937	0.61542	0.61012	0.60878	0.60681	0.60628	0.60546	0.60523
0.68	0.66829	0.64098	0.62061	0.61629	0.61047	0.60899	0.60680	0.60621	0.60529	0.60504
0.70	0.67369	0.64389	0.62174	0.61703	0.61066	0.60902	0.60660	0.60593	0.60491	0.60463
0.72	0.67925	0.64679	0.62274	0.61762	0.61064	0.60884	0.60615	0.60542	0.60428	0.60396
0.74	0.68494	0.64964	0.62358	0.61802	0.61040	0.60842	0.60546	0.60464	0.60338	0.60303
0.75	0.68781	0.65103	0.62394	0.61815	0.61019	0.60812	0.60501	0.60415	0.60282	0.60245

Table 1-B-2—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 3-Inch (75-Millimeter) Meter  
 $[D = 2.900 \text{ Inches (73.66 Millimeters)}]$

$\beta$	Pipe Reynolds Number ( $Re_D$ )									
	4000	10,000	50,000	100,000	500,000	$1 \times 10^6$	$5 \times 10^6$	$10 \times 10^6$	$50 \times 10^6$	$100 \times 10^6$
0.02	0.59763	0.59688	0.59632	0.59622	0.59611	0.59609	0.59606	0.59606	0.59606	0.59605
0.04	0.59859	0.59737	0.59646	0.59629	0.59611	0.59607	0.59604	0.59603	0.59602	0.59602
0.06	0.59942	0.59780	0.59659	0.59636	0.59612	0.59607	0.59603	0.59602	0.59601	0.59601
0.08	0.60019	0.59821	0.59672	0.59645	0.59615	0.59609	0.59603	0.59602	0.59601	0.59601
0.10	0.60094	0.59861	0.59687	0.59655	0.59620	0.59613	0.59606	0.59605	0.59603	0.59603
0.12	0.60167	0.59902	0.59703	0.59666	0.59626	0.59619	0.59611	0.59609	0.59608	0.59608
0.14	0.60241	0.59944	0.59721	0.59680	0.59635	0.59627	0.59618	0.59616	0.59614	0.59614
0.16	0.60316	0.59989	0.59742	0.59697	0.59647	0.59638	0.59627	0.59625	0.59623	0.59623
0.18	0.60394	0.60036	0.59766	0.59716	0.59661	0.59650	0.59639	0.59637	0.59634	0.59634
0.20	0.60475	0.60086	0.59792	0.59737	0.59677	0.59666	0.59653	0.59651	0.59648	0.59647
0.22	0.60561	0.60140	0.59822	0.59763	0.59697	0.59684	0.59670	0.59667	0.59664	0.59663
0.24	0.60652	0.60199	0.59855	0.59791	0.59720	0.59706	0.59690	0.59687	0.59683	0.59682
0.26	0.60751	0.60263	0.59893	0.59824	0.59746	0.59730	0.59713	0.59709	0.59704	0.59703
0.28	0.60857	0.60333	0.59935	0.59860	0.59775	0.59758	0.59738	0.59734	0.59729	0.59728
0.30	0.60973	0.60410	0.59983	0.59901	0.59808	0.59790	0.59767	0.59762	0.59756	0.59755
0.32	0.61099	0.60495	0.60035	0.59947	0.59846	0.59825	0.59800	0.59794	0.59787	0.59785
0.34	0.61238	0.60589	0.60093	0.59998	0.59887	0.59864	0.59835	0.59829	0.59820	0.59818
0.36	0.61391	0.60691	0.60158	0.60054	0.59933	0.59907	0.59874	0.59867	0.59857	0.59854
0.38	0.61558	0.60804	0.60229	0.60116	0.59982	0.59954	0.59917	0.59908	0.59896	0.59893
0.40	0.61742	0.60929	0.60306	0.60184	0.60037	0.60005	0.59963	0.59953	0.59939	0.59935
0.42	0.61945	0.61064	0.60391	0.60257	0.60095	0.60059	0.60012	0.60001	0.59984	0.59980
0.44	0.62167	0.61213	0.60483	0.60337	0.60158	0.60118	0.60064	0.60051	0.60032	0.60027
0.46	0.62410	0.61374	0.60581	0.60422	0.60224	0.60179	0.60118	0.60103	0.60081	0.60075
0.48	0.62676	0.61548	0.60687	0.60512	0.60294	0.60244	0.60175	0.60157	0.60131	0.60125
0.50	0.62966	0.61737	0.60799	0.60608	0.60366	0.60310	0.60232	0.60212	0.60182	0.60174
0.52	0.63280	0.61939	0.60917	0.60707	0.60440	0.60377	0.60289	0.60266	0.60232	0.60223
0.54	0.63620	0.62155	0.61040	0.60810	0.60515	0.60444	0.60344	0.60318	0.60279	0.60269
0.56	0.63987	0.62383	0.61166	0.60914	0.60588	0.60509	0.60397	0.60367	0.60323	0.60311
0.58	0.64380	0.62625	0.61295	0.61019	0.60658	0.60570	0.60444	0.60410	0.60360	0.60346
0.60	0.64800	0.62877	0.61425	0.61121	0.60723	0.60625	0.60483	0.60445	0.60388	0.60373
0.62	0.65246	0.63138	0.61552	0.61219	0.60780	0.60671	0.60512	0.60470	0.60405	0.60387
0.64	0.65716	0.63406	0.61674	0.61310	0.60826	0.60704	0.60527	0.60479	0.60407	0.60386
0.66	0.66209	0.63679	0.61788	0.61389	0.60856	0.60722	0.60524	0.60471	0.60389	0.60366
0.68	0.66723	0.63953	0.61889	0.61453	0.60868	0.60719	0.60499	0.60439	0.60348	0.60322
0.70	0.67253	0.64223	0.61974	0.61498	0.60855	0.60691	0.60447	0.60381	0.60279	0.60250
0.72	0.67797	0.64486	0.62038	0.61519	0.60814	0.60633	0.60363	0.60289	0.60176	0.60144
0.74	0.68348	0.64736	0.62075	0.61510	0.60740	0.60541	0.60243	0.60161	0.60035	0.59999
0.75	0.68624	0.64855	0.62083	0.61494	0.60689	0.60480	0.60167	0.60081	0.59948	0.59911

Table 1-B-3—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 4-Inch (100-Millimeter) Meter  
 [ $D = 3.826$  Inches (97.18 Millimeters)]

$\beta$	Pipe Reynolds Number ( $Re_D$ )									
	4000	10,000	50,000	100,000	500,000	$1 \times 10^6$	$5 \times 10^6$	$10 \times 10^6$	$50 \times 10^6$	$100 \times 10^6$
0.02	0.59764	0.59689	0.59633	0.59623	0.59612	0.59610	0.59607	0.59607	0.59607	0.59607
0.04	0.59861	0.59739	0.59648	0.59631	0.59613	0.59610	0.59606	0.59605	0.59605	0.59605
0.06	0.59945	0.59784	0.59662	0.59640	0.59616	0.59611	0.59606	0.59605	0.59605	0.59604
0.08	0.60024	0.59826	0.59677	0.59650	0.59620	0.59615	0.59609	0.59608	0.59606	0.59606
0.10	0.60100	0.59868	0.59693	0.59661	0.59626	0.59620	0.59613	0.59612	0.59610	0.59610
0.12	0.60175	0.59910	0.59711	0.59675	0.59635	0.59627	0.59619	0.59618	0.59616	0.59616
0.14	0.60250	0.59954	0.59731	0.59690	0.59645	0.59637	0.59628	0.59626	0.59624	0.59624
0.16	0.60326	0.60000	0.59754	0.59708	0.59658	0.59649	0.59639	0.59637	0.59635	0.59634
0.18	0.60405	0.60048	0.59779	0.59729	0.59674	0.59664	0.59652	0.59650	0.59647	0.59647
0.20	0.60488	0.60099	0.59807	0.59752	0.59692	0.59681	0.59668	0.59666	0.59663	0.59662
0.22	0.60575	0.60155	0.59838	0.59779	0.59713	0.59701	0.59686	0.59684	0.59680	0.59680
0.24	0.60667	0.60215	0.59873	0.59809	0.59737	0.59723	0.59708	0.59704	0.59701	0.59700
0.26	0.60767	0.60280	0.59912	0.59842	0.59765	0.59749	0.59732	0.59728	0.59723	0.59722
0.28	0.60874	0.60352	0.59955	0.59880	0.59795	0.59779	0.59759	0.59755	0.59749	0.59748
0.30	0.60991	0.60430	0.60004	0.59922	0.59830	0.59811	0.59789	0.59784	0.59778	0.59776
0.32	0.61118	0.60516	0.60057	0.59969	0.59868	0.59847	0.59822	0.59816	0.59809	0.59807
0.34	0.61258	0.60610	0.60116	0.60021	0.59910	0.59887	0.59858	0.59852	0.59843	0.59841
0.36	0.61410	0.60713	0.60181	0.60078	0.59956	0.59930	0.59898	0.59891	0.59880	0.59878
0.38	0.61578	0.60827	0.60252	0.60140	0.60006	0.59978	0.59941	0.59932	0.59920	0.59917
0.40	0.61763	0.60951	0.60330	0.60207	0.60060	0.60028	0.59987	0.59977	0.59963	0.59959
0.42	0.61965	0.61086	0.60414	0.60280	0.60118	0.60082	0.60035	0.60023	0.60007	0.60003
0.44	0.62187	0.61233	0.60504	0.60358	0.60180	0.60140	0.60086	0.60073	0.60054	0.60048
0.46	0.62429	0.61393	0.60601	0.60442	0.60245	0.60200	0.60139	0.60123	0.60101	0.60095
0.48	0.62694	0.61567	0.60705	0.60530	0.60312	0.60262	0.60192	0.60175	0.60149	0.60142
0.50	0.62983	0.61753	0.60814	0.60623	0.60381	0.60325	0.60246	0.60226	0.60197	0.60189
0.52	0.63296	0.61952	0.60928	0.60719	0.60451	0.60388	0.60300	0.60277	0.60243	0.60234
0.54	0.63634	0.62164	0.61047	0.60817	0.60521	0.60450	0.60350	0.60324	0.60285	0.60275
0.56	0.63999	0.62389	0.61168	0.60915	0.60588	0.60509	0.60396	0.60367	0.60323	0.60310
0.58	0.64389	0.62625	0.61290	0.61013	0.60651	0.60563	0.60436	0.60403	0.60352	0.60338
0.60	0.64806	0.62871	0.61411	0.61106	0.60707	0.60609	0.60467	0.60429	0.60372	0.60356
0.62	0.65247	0.63124	0.61528	0.61194	0.60753	0.60643	0.60484	0.60442	0.60377	0.60359
0.64	0.65713	0.63384	0.61638	0.61272	0.60785	0.60664	0.60486	0.60438	0.60365	0.60345
0.66	0.66201	0.63645	0.61737	0.61335	0.60800	0.60665	0.60467	0.60413	0.60332	0.60309
0.68	0.66708	0.63905	0.61820	0.61381	0.60792	0.60643	0.60422	0.60362	0.60271	0.60245
0.70	0.67230	0.64160	0.61884	0.61403	0.60756	0.60591	0.60347	0.60280	0.60178	0.60149
0.72	0.67764	0.64403	0.61921	0.61396	0.60686	0.60504	0.60234	0.60160	0.60046	0.60014
0.74	0.68303	0.64629	0.61926	0.61354	0.60577	0.60377	0.60078	0.59996	0.59869	0.59834
0.75	0.68573	0.64733	0.61915	0.61318	0.60505	0.60295	0.59981	0.59895	0.59762	0.59725

Table 1-B-4—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 6-Inch (150-Millimeter) Meter  
 $[D = 5.761 \text{ Inches (146.33 Millimeters)}]$

$\beta$	Pipe Reynolds Number ( $Re_D$ )									
	4000	10,000	50,000	100,000	500,000	$1 \times 10^6$	$5 \times 10^6$	$10 \times 10^6$	$50 \times 10^6$	$100 \times 10^6$
0.02	0.59765	0.59691	0.59635	0.59624	0.59613	0.59611	0.59609	0.59608	0.59608	0.59608
0.04	0.59864	0.59742	0.59651	0.59634	0.59616	0.59613	0.59609	0.59608	0.59608	0.59607
0.06	0.59950	0.59788	0.59667	0.59644	0.59620	0.59616	0.59611	0.59610	0.59609	0.59609
0.08	0.60030	0.59832	0.59683	0.59656	0.59626	0.59621	0.59615	0.59614	0.59613	0.59612
0.10	0.60107	0.59876	0.59701	0.59669	0.59635	0.59628	0.59621	0.59620	0.59618	0.59618
0.12	0.60184	0.59920	0.59721	0.59685	0.59645	0.59637	0.59629	0.59628	0.59626	0.59626
0.14	0.60260	0.59965	0.59743	0.59702	0.59657	0.59649	0.59640	0.59638	0.59636	0.59636
0.16	0.60339	0.60013	0.59767	0.59722	0.59672	0.59663	0.59653	0.59651	0.59649	0.59648
0.18	0.60419	0.60063	0.59794	0.59744	0.59690	0.59679	0.59668	0.59666	0.59663	0.59663
0.20	0.60503	0.60116	0.59824	0.59770	0.59710	0.59698	0.59686	0.59683	0.59680	0.59680
0.22	0.60592	0.60173	0.59857	0.59798	0.59733	0.59720	0.59706	0.59703	0.59700	0.59699
0.24	0.60686	0.60235	0.59894	0.59830	0.59758	0.59745	0.59729	0.59726	0.59722	0.59721
0.26	0.60786	0.60302	0.59934	0.59865	0.59787	0.59772	0.59755	0.59751	0.59746	0.59745
0.28	0.60895	0.60374	0.59979	0.59904	0.59820	0.59803	0.59783	0.59779	0.59773	0.59772
0.30	0.61013	0.60454	0.60029	0.59948	0.59855	0.59837	0.59814	0.59810	0.59803	0.59802
0.32	0.61141	0.60540	0.60083	0.59995	0.59894	0.59874	0.59849	0.59843	0.59836	0.59834
0.34	0.61281	0.60635	0.60143	0.60048	0.59937	0.59914	0.59886	0.59879	0.59871	0.59868
0.36	0.61434	0.60739	0.60208	0.60105	0.59984	0.59958	0.59926	0.59918	0.59908	0.59905
0.38	0.61602	0.60852	0.60279	0.60167	0.60034	0.60005	0.59968	0.59960	0.59948	0.59945
0.40	0.61786	0.60976	0.60356	0.60234	0.60087	0.60055	0.60014	0.60004	0.59990	0.59986
0.42	0.61988	0.61111	0.60439	0.60306	0.60144	0.60108	0.60061	0.60049	0.60033	0.60029
0.44	0.62210	0.61257	0.60528	0.60382	0.60204	0.60164	0.60110	0.60097	0.60078	0.60073
0.46	0.62452	0.61415	0.60623	0.60464	0.60266	0.60221	0.60160	0.60145	0.60123	0.60117
0.48	0.62715	0.61586	0.60723	0.60549	0.60330	0.60280	0.60211	0.60193	0.60167	0.60161
0.50	0.63002	0.61769	0.60829	0.60637	0.60395	0.60339	0.60260	0.60240	0.60211	0.60203
0.52	0.63313	0.61965	0.60938	0.60727	0.60460	0.60396	0.60308	0.60285	0.60251	0.60242
0.54	0.63649	0.62172	0.61050	0.60819	0.60523	0.60452	0.60352	0.60326	0.60287	0.60276
0.56	0.64011	0.62391	0.61163	0.60910	0.60582	0.60502	0.60390	0.60360	0.60316	0.60303
0.58	0.64398	0.62620	0.61276	0.60997	0.60634	0.60546	0.60419	0.60385	0.60335	0.60321
0.60	0.64810	0.62858	0.61386	0.61079	0.60678	0.60579	0.60437	0.60399	0.60342	0.60326
0.62	0.65247	0.63101	0.61489	0.61153	0.60709	0.60600	0.60440	0.60398	0.60333	0.60315
0.64	0.65707	0.63349	0.61583	0.61214	0.60724	0.60602	0.60424	0.60376	0.60303	0.60283
0.66	0.66188	0.63596	0.61663	0.61258	0.60718	0.60582	0.60384	0.60330	0.60248	0.60226
0.68	0.66688	0.63839	0.61723	0.61279	0.60685	0.60535	0.60314	0.60254	0.60162	0.60137
0.70	0.67201	0.64073	0.61758	0.61272	0.60618	0.60453	0.60207	0.60140	0.60038	0.60010
0.72	0.67724	0.64291	0.61762	0.61230	0.60512	0.60329	0.60057	0.59983	0.59869	0.59837
0.74	0.68250	0.64487	0.61726	0.61144	0.60358	0.60156	0.59856	0.59773	0.59647	0.59611
0.75	0.68512	0.64575	0.61690	0.61083	0.60260	0.60048	0.59733	0.59646	0.59513	0.59476

Table 1-B-5—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 8-Inch (200-Millimeter) Meter  
 [D = 7.625 Inches (193.68 Millimeters)]

$\beta$	Pipe Reynolds Number ( $Re_D$ )									
	4000	10,000	50,000	100,000	500,000	$1 \times 10^6$	$5 \times 10^6$	$10 \times 10^6$	$50 \times 10^6$	$100 \times 10^6$
0.02	0.59766	0.59691	0.59635	0.59625	0.59614	0.59612	0.59610	0.59609	0.59609	0.59609
0.04	0.59865	0.59744	0.59652	0.59636	0.59617	0.59614	0.59610	0.59610	0.59609	0.59609
0.06	0.59952	0.59791	0.59669	0.59647	0.59623	0.59618	0.59613	0.59612	0.59612	0.59611
0.08	0.60033	0.59835	0.59687	0.59659	0.59630	0.59624	0.59618	0.59617	0.59616	0.59616
0.10	0.60111	0.59880	0.59706	0.59674	0.59639	0.59632	0.59625	0.59624	0.59623	0.59622
0.12	0.60189	0.59925	0.59727	0.59690	0.59650	0.59643	0.59635	0.59633	0.59632	0.59631
0.14	0.60266	0.59971	0.59749	0.59708	0.59664	0.59655	0.59646	0.59645	0.59643	0.59642
0.16	0.60345	0.60020	0.59775	0.59729	0.59680	0.59670	0.59660	0.59658	0.59656	0.59656
0.18	0.60427	0.60071	0.59803	0.59753	0.59698	0.59688	0.59677	0.59674	0.59672	0.59671
0.20	0.60511	0.60125	0.59833	0.59779	0.59719	0.59708	0.59695	0.59693	0.59690	0.59689
0.22	0.60601	0.60183	0.59867	0.59808	0.59743	0.59731	0.59717	0.59714	0.59710	0.59710
0.24	0.60695	0.60246	0.59905	0.59841	0.59770	0.59756	0.59740	0.59737	0.59733	0.59733
0.26	0.60797	0.60313	0.59947	0.59877	0.59800	0.59785	0.59767	0.59763	0.59759	0.59758
0.28	0.60906	0.60387	0.59992	0.59917	0.59833	0.59816	0.59796	0.59792	0.59787	0.59786
0.30	0.61024	0.60467	0.60042	0.59961	0.59869	0.59851	0.59828	0.59823	0.59817	0.59816
0.32	0.61153	0.60554	0.60097	0.60010	0.59909	0.59888	0.59863	0.59857	0.59850	0.59848
0.34	0.61293	0.60649	0.60157	0.60062	0.59952	0.59929	0.59901	0.59894	0.59885	0.59883
0.36	0.61447	0.60753	0.60223	0.60120	0.59999	0.59973	0.59941	0.59933	0.59923	0.59920
0.38	0.61615	0.60866	0.60294	0.60182	0.60049	0.60020	0.59983	0.59975	0.59963	0.59960
0.40	0.61799	0.60990	0.60371	0.60248	0.60102	0.60070	0.60028	0.60018	0.60004	0.60001
0.42	0.62001	0.61124	0.60453	0.60320	0.60158	0.60122	0.60075	0.60063	0.60047	0.60043
0.44	0.62222	0.61270	0.60541	0.60395	0.60217	0.60177	0.60123	0.60110	0.60091	0.60086
0.46	0.62464	0.61427	0.60635	0.60475	0.60278	0.60233	0.60172	0.60157	0.60134	0.60128
0.48	0.62727	0.61597	0.60734	0.60559	0.60340	0.60290	0.60220	0.60203	0.60177	0.60170
0.50	0.63013	0.61778	0.60837	0.60645	0.60403	0.60346	0.60268	0.60248	0.60218	0.60210
0.52	0.63323	0.61972	0.60943	0.60732	0.60464	0.60401	0.60312	0.60289	0.60255	0.60246
0.54	0.63658	0.62177	0.61052	0.60820	0.60523	0.60452	0.60352	0.60326	0.60287	0.60277
0.56	0.64018	0.62393	0.61161	0.60906	0.60578	0.60498	0.60386	0.60356	0.60312	0.60299
0.58	0.64403	0.62618	0.61269	0.60989	0.60625	0.60536	0.60410	0.60376	0.60325	0.60312
0.60	0.64814	0.62851	0.61372	0.61065	0.60662	0.60563	0.60421	0.60383	0.60326	0.60310
0.62	0.65248	0.63089	0.61468	0.61131	0.60686	0.60576	0.60416	0.60373	0.60309	0.60291
0.64	0.65706	0.63330	0.61554	0.61182	0.60691	0.60569	0.60390	0.60342	0.60270	0.60249
0.66	0.66183	0.63570	0.61623	0.61215	0.60673	0.60538	0.60339	0.60285	0.60203	0.60180
0.68	0.66679	0.63804	0.61671	0.61224	0.60627	0.60476	0.60255	0.60195	0.60103	0.60078
0.70	0.67188	0.64027	0.61691	0.61201	0.60544	0.60378	0.60132	0.60065	0.59963	0.59934
0.72	0.67705	0.64233	0.61676	0.61140	0.60418	0.60234	0.59962	0.59888	0.59774	0.59742
0.74	0.68225	0.64413	0.61619	0.61032	0.60240	0.60037	0.59736	0.59654	0.59527	0.59492
0.75	0.68484	0.64491	0.61571	0.60957	0.60128	0.59916	0.59599	0.59513	0.59379	0.59342

Table 1-B-6—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 10-Inch (250-Millimeter) Meter  
 [ $D = 9.562$  Inches (242.87 Millimeters)]

$\beta$	Pipe Reynolds Number ( $Re_D$ )									
	4000	10,000	50,000	100,000	500,000	$1 \times 10^6$	$5 \times 10^6$	$10 \times 10^6$	$50 \times 10^6$	$100 \times 10^6$
0.02	0.59767	0.59692	0.59636	0.59625	0.59614	0.59612	0.59610	0.59610	0.59609	0.59609
0.04	0.59866	0.59745	0.59653	0.59637	0.59618	0.59615	0.59611	0.59611	0.59610	0.59610
0.06	0.59953	0.59792	0.59671	0.59649	0.59624	0.59620	0.59615	0.59614	0.59613	0.59613
0.08	0.60035	0.59838	0.59689	0.59662	0.59632	0.59627	0.59621	0.59620	0.59618	0.59618
0.10	0.60114	0.59883	0.59709	0.59677	0.59642	0.59635	0.59628	0.59627	0.59626	0.59625
0.12	0.60192	0.59928	0.59730	0.59694	0.59654	0.59646	0.59638	0.59637	0.59635	0.59635
0.14	0.60270	0.59976	0.59754	0.59713	0.59668	0.59660	0.59651	0.59649	0.59647	0.59647
0.16	0.60350	0.60025	0.59780	0.59734	0.59685	0.59676	0.59665	0.59663	0.59661	0.59661
0.18	0.60432	0.60076	0.59808	0.59758	0.59704	0.59694	0.59682	0.59680	0.59678	0.59677
0.20	0.60517	0.60131	0.59840	0.59785	0.59726	0.59714	0.59702	0.59699	0.59696	0.59696
0.22	0.60607	0.60190	0.59874	0.59816	0.59750	0.59738	0.59724	0.59721	0.59718	0.59717
0.24	0.60702	0.60253	0.59913	0.59849	0.59778	0.59764	0.59748	0.59745	0.59741	0.59740
0.26	0.60804	0.60321	0.59955	0.59886	0.59808	0.59793	0.59775	0.59772	0.59767	0.59766
0.28	0.60914	0.60395	0.60001	0.59926	0.59842	0.59825	0.59805	0.59801	0.59796	0.59795
0.30	0.61032	0.60475	0.60052	0.59971	0.59879	0.59860	0.59838	0.59833	0.59827	0.59825
0.32	0.61161	0.60563	0.60107	0.60019	0.59919	0.59898	0.59873	0.59867	0.59860	0.59858
0.34	0.61302	0.60658	0.60167	0.60072	0.59962	0.59939	0.59911	0.59904	0.59896	0.59893
0.36	0.61456	0.60763	0.60233	0.60130	0.60009	0.59983	0.59951	0.59944	0.59933	0.59931
0.38	0.61624	0.60876	0.60304	0.60192	0.60059	0.60030	0.59994	0.59985	0.59973	0.59970
0.40	0.61809	0.61000	0.60381	0.60259	0.60112	0.60080	0.60038	0.60028	0.60014	0.60011
0.42	0.62010	0.61134	0.60463	0.60330	0.60168	0.60132	0.60085	0.60073	0.60057	0.60053
0.44	0.62231	0.61279	0.60551	0.60405	0.60226	0.60186	0.60132	0.60119	0.60100	0.60095
0.46	0.62473	0.61436	0.60643	0.60484	0.60286	0.60241	0.60180	0.60165	0.60143	0.60137
0.48	0.62735	0.61605	0.60741	0.60566	0.60347	0.60297	0.60228	0.60210	0.60185	0.60178
0.50	0.63021	0.61785	0.60843	0.60651	0.60409	0.60352	0.60274	0.60253	0.60224	0.60216
0.52	0.63331	0.61977	0.60947	0.60737	0.60468	0.60405	0.60316	0.60293	0.60259	0.60250
0.54	0.63665	0.62181	0.61054	0.60822	0.60525	0.60454	0.60354	0.60328	0.60289	0.60278
0.56	0.64024	0.62395	0.61161	0.60906	0.60577	0.60497	0.60384	0.60355	0.60310	0.60298
0.58	0.64408	0.62618	0.61265	0.60985	0.60621	0.60532	0.60405	0.60371	0.60321	0.60307
0.60	0.64817	0.62848	0.61365	0.61057	0.60654	0.60555	0.60412	0.60374	0.60317	0.60301
0.62	0.65250	0.63083	0.61457	0.61118	0.60672	0.60562	0.60402	0.60360	0.60295	0.60277
0.64	0.65706	0.63320	0.61536	0.61164	0.60672	0.60549	0.60371	0.60323	0.60250	0.60229
0.66	0.66182	0.63555	0.61599	0.61190	0.60647	0.60511	0.60312	0.60258	0.60176	0.60153
0.68	0.66675	0.63784	0.61639	0.61190	0.60592	0.60441	0.60219	0.60159	0.60067	0.60042
0.70	0.67181	0.64000	0.61650	0.61158	0.60499	0.60332	0.60086	0.60019	0.59916	0.59888
0.72	0.67696	0.64198	0.61624	0.61085	0.60361	0.60176	0.59903	0.59829	0.59715	0.59683
0.74	0.68212	0.64369	0.61553	0.60963	0.60167	0.59964	0.59663	0.59580	0.59453	0.59418
0.75	0.68468	0.64441	0.61497	0.60880	0.60047	0.59834	0.59517	0.59430	0.59297	0.59259

Table 1-B-7—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 12-Inch (300-Millimeter) Meter  
 [D = 11.374 Inches (288.90 Millimeters)]

$\beta$	Pipe Reynolds Number ( $Re_D$ )									
	4000	10,000	50,000	100,000	500,000	$1 \times 10^6$	$5 \times 10^6$	$10 \times 10^6$	$50 \times 10^6$	$100 \times 10^6$
0.02	0.59767	0.59692	0.59636	0.59626	0.59615	0.59613	0.59610	0.59610	0.59609	0.59609
0.04	0.59867	0.59745	0.59654	0.59637	0.59619	0.59616	0.59612	0.59611	0.59611	0.59611
0.06	0.59954	0.59793	0.59672	0.59650	0.59625	0.59621	0.59616	0.59615	0.59614	0.59614
0.08	0.60037	0.59839	0.59691	0.59663	0.59634	0.59628	0.59622	0.59621	0.59620	0.59620
0.10	0.60116	0.59885	0.59711	0.59679	0.59644	0.59637	0.59630	0.59629	0.59628	0.59627
0.12	0.60194	0.59931	0.59733	0.59696	0.59656	0.59649	0.59641	0.59639	0.59638	0.59637
0.14	0.60273	0.59978	0.59757	0.59716	0.59671	0.59663	0.59654	0.59652	0.59650	0.59650
0.16	0.60353	0.60028	0.59783	0.59738	0.59688	0.59679	0.59669	0.59667	0.59665	0.59664
0.18	0.60435	0.60080	0.59812	0.59762	0.59708	0.59698	0.59686	0.59684	0.59681	0.59681
0.20	0.60521	0.60135	0.59844	0.59790	0.59730	0.59719	0.59706	0.59704	0.59701	0.59700
0.22	0.60611	0.60194	0.59879	0.59820	0.59755	0.59743	0.59728	0.59726	0.59722	0.59722
0.24	0.60707	0.60258	0.59918	0.59854	0.59783	0.59769	0.59753	0.59750	0.59746	0.59746
0.26	0.60809	0.60326	0.59960	0.59891	0.59814	0.59799	0.59781	0.59777	0.59773	0.59772
0.28	0.60919	0.60401	0.60007	0.59932	0.59848	0.59831	0.59811	0.59807	0.59802	0.59800
0.30	0.61038	0.60481	0.60058	0.59977	0.59885	0.59866	0.59844	0.59839	0.59833	0.59832
0.32	0.61167	0.60569	0.60113	0.60026	0.59925	0.59905	0.59880	0.59874	0.59867	0.59865
0.34	0.61308	0.60665	0.60174	0.60079	0.59969	0.59946	0.59918	0.59911	0.59902	0.59900
0.36	0.61462	0.60769	0.60240	0.60137	0.60016	0.59990	0.59958	0.59951	0.59940	0.59938
0.38	0.61630	0.60883	0.60311	0.60199	0.60066	0.60037	0.60001	0.59992	0.59980	0.59977
0.40	0.61815	0.61006	0.60388	0.60265	0.60119	0.60087	0.60045	0.60035	0.60021	0.60018
0.42	0.62017	0.61140	0.60470	0.60336	0.60175	0.60139	0.60092	0.60080	0.60064	0.60059
0.44	0.62237	0.61285	0.60557	0.60411	0.60233	0.60193	0.60139	0.60126	0.60107	0.60101
0.46	0.62479	0.61442	0.60649	0.60490	0.60292	0.60247	0.60186	0.60171	0.60149	0.60143
0.48	0.62741	0.61610	0.60747	0.60572	0.60353	0.60302	0.60233	0.60216	0.60190	0.60183
0.50	0.63027	0.61790	0.60847	0.60655	0.60413	0.60357	0.60278	0.60258	0.60229	0.60221
0.52	0.63336	0.61982	0.60951	0.60740	0.60472	0.60408	0.60320	0.60297	0.60263	0.60254
0.54	0.63670	0.62184	0.61056	0.60825	0.60527	0.60456	0.60356	0.60330	0.60291	0.60280
0.56	0.64028	0.62397	0.61162	0.60907	0.60577	0.60498	0.60385	0.60355	0.60311	0.60299
0.58	0.64412	0.62619	0.61264	0.60984	0.60619	0.60530	0.60403	0.60370	0.60319	0.60305
0.60	0.64821	0.62847	0.61362	0.61053	0.60650	0.60551	0.60408	0.60370	0.60313	0.60297
0.62	0.65253	0.63080	0.61451	0.61111	0.60665	0.60555	0.60395	0.60352	0.60288	0.60270
0.64	0.65708	0.63315	0.61527	0.61154	0.60661	0.60538	0.60360	0.60312	0.60239	0.60219
0.66	0.66182	0.63548	0.61586	0.61176	0.60632	0.60496	0.60296	0.60243	0.60161	0.60138
0.68	0.66674	0.63773	0.61621	0.61171	0.60572	0.60421	0.60199	0.60139	0.60047	0.60021
0.70	0.67179	0.63985	0.61627	0.61133	0.60473	0.60306	0.60059	0.59992	0.59890	0.59861
0.72	0.67692	0.64178	0.61594	0.61053	0.60327	0.60142	0.59869	0.59795	0.59680	0.59649
0.74	0.68206	0.64343	0.61514	0.60922	0.60124	0.59921	0.59619	0.59536	0.59410	0.59374
0.75	0.68461	0.64412	0.61453	0.60834	0.59999	0.59785	0.59468	0.59381	0.59247	0.59210

Table 1-B-8—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 16-Inch (400-Millimeter) Meter  
 $[D = 14.688 \text{ Inches (373.08 Millimeters)}]$

$\beta$	Pipe Reynolds Number ( $Re_D$ )									
	4000	10,000	50,000	100,000	500,000	$1 \times 10^6$	$5 \times 10^6$	$10 \times 10^6$	$50 \times 10^6$	$100 \times 10^6$
0.02	0.59767	0.59693	0.59637	0.59626	0.59615	0.59613	0.59611	0.59610	0.59610	0.59610
0.04	0.59868	0.59746	0.59655	0.59638	0.59620	0.59617	0.59613	0.59612	0.59612	0.59611
0.06	0.59956	0.59794	0.59673	0.59651	0.59627	0.59622	0.59617	0.59617	0.59616	0.59615
0.08	0.60038	0.59841	0.59692	0.59665	0.59635	0.59630	0.59624	0.59623	0.59622	0.59621
0.10	0.60118	0.59887	0.59713	0.59681	0.59646	0.59640	0.59633	0.59631	0.59630	0.59630
0.12	0.60197	0.59934	0.59736	0.59699	0.59659	0.59652	0.59644	0.59642	0.59641	0.59640
0.14	0.60276	0.59982	0.59760	0.59719	0.59675	0.59666	0.59657	0.59655	0.59654	0.59653
0.16	0.60356	0.60032	0.59787	0.59742	0.59692	0.59683	0.59673	0.59671	0.59669	0.59668
0.18	0.60439	0.60084	0.59817	0.59767	0.59713	0.59702	0.59691	0.59689	0.59686	0.59686
0.20	0.60526	0.60140	0.59849	0.59795	0.59735	0.59724	0.59711	0.59709	0.59706	0.59705
0.22	0.60616	0.60200	0.59885	0.59826	0.59761	0.59749	0.59734	0.59732	0.59728	0.59728
0.24	0.60712	0.60264	0.59924	0.59860	0.59789	0.59776	0.59760	0.59757	0.59753	0.59752
0.26	0.60815	0.60333	0.59967	0.59898	0.59821	0.59806	0.59788	0.59784	0.59780	0.59779
0.28	0.60925	0.60408	0.60014	0.59940	0.59855	0.59839	0.59819	0.59815	0.59809	0.59808
0.30	0.61044	0.60489	0.60066	0.59985	0.59893	0.59874	0.59852	0.59847	0.59841	0.59840
0.32	0.61174	0.60577	0.60122	0.60034	0.59934	0.59913	0.59888	0.59882	0.59875	0.59873
0.34	0.61315	0.60673	0.60183	0.60088	0.59978	0.59955	0.59926	0.59920	0.59911	0.59909
0.36	0.61469	0.60777	0.60249	0.60146	0.60025	0.59999	0.59967	0.59960	0.59949	0.59947
0.38	0.61638	0.60891	0.60320	0.60208	0.60075	0.60047	0.60010	0.60001	0.59989	0.59986
0.40	0.61823	0.61015	0.60397	0.60275	0.60128	0.60096	0.60055	0.60045	0.60031	0.60027
0.42	0.62025	0.61149	0.60479	0.60345	0.60184	0.60148	0.60101	0.60089	0.60073	0.60069
0.44	0.62246	0.61294	0.60566	0.60420	0.60242	0.60201	0.60148	0.60134	0.60115	0.60110
0.46	0.62487	0.61450	0.60658	0.60498	0.60301	0.60256	0.60195	0.60179	0.60157	0.60151
0.48	0.62749	0.61618	0.60754	0.60579	0.60361	0.60310	0.60241	0.60223	0.60198	0.60191
0.50	0.63035	0.61798	0.60854	0.60662	0.60420	0.60363	0.60285	0.60265	0.60235	0.60227
0.52	0.63343	0.61988	0.60957	0.60746	0.60478	0.60414	0.60325	0.60302	0.60269	0.60259
0.54	0.63677	0.62190	0.61061	0.60829	0.60532	0.60461	0.60360	0.60334	0.60295	0.60285
0.56	0.64035	0.62402	0.61164	0.60909	0.60580	0.60500	0.60387	0.60358	0.60313	0.60301
0.58	0.64418	0.62622	0.61265	0.60984	0.60619	0.60530	0.60403	0.60370	0.60319	0.60305
0.60	0.64826	0.62848	0.61360	0.61051	0.60647	0.60548	0.60405	0.60367	0.60310	0.60294
0.62	0.65258	0.63079	0.61446	0.61106	0.60659	0.60549	0.60389	0.60346	0.60281	0.60264
0.64	0.65711	0.63312	0.61519	0.61145	0.60651	0.60528	0.60350	0.60302	0.60229	0.60208
0.66	0.66185	0.63541	0.61573	0.61162	0.60617	0.60481	0.60281	0.60228	0.60146	0.60123
0.68	0.66675	0.63763	0.61603	0.61152	0.60551	0.60400	0.60178	0.60118	0.60026	0.60000
0.70	0.67179	0.63971	0.61602	0.61107	0.60445	0.60278	0.60031	0.59964	0.59862	0.59833
0.72	0.67690	0.64158	0.61562	0.61019	0.60291	0.60106	0.59833	0.59758	0.59644	0.59612
0.74	0.68202	0.64316	0.61473	0.60878	0.60078	0.59874	0.59572	0.59489	0.59362	0.59327
0.75	0.68456	0.64382	0.61406	0.60784	0.59947	0.59733	0.59415	0.59328	0.59194	0.59157

Table 1-B-9—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 20-Inch (500-Millimeter) Meter  
 $[D = 19.000 \text{ Inches (482.60 Millimeters)}]$

$\beta$	Pipe Reynolds Number ( $Re_D$ )									
	4000	10,000	50,000	100,000	500,000	$1 \times 10^6$	$5 \times 10^6$	$10 \times 10^6$	$50 \times 10^6$	$100 \times 10^6$
0.02	0.59768	0.59693	0.59637	0.59626	0.59615	0.59613	0.59611	0.59611	0.59610	0.59610
0.04	0.59868	0.59747	0.59656	0.59639	0.59621	0.59617	0.59614	0.59613	0.59612	0.59612
0.06	0.59957	0.59796	0.59674	0.59652	0.59628	0.59623	0.59619	0.59618	0.59617	0.59616
0.08	0.60040	0.59842	0.59694	0.59667	0.59637	0.59631	0.59626	0.59624	0.59623	0.59623
0.10	0.60120	0.59889	0.59715	0.59683	0.59648	0.59642	0.59635	0.59633	0.59632	0.59632
0.12	0.60199	0.59936	0.59738	0.59701	0.59662	0.59654	0.59646	0.59645	0.59643	0.59643
0.14	0.60279	0.59984	0.59763	0.59722	0.59677	0.59669	0.59660	0.59658	0.59656	0.59656
0.16	0.60360	0.60035	0.59790	0.59745	0.59696	0.59686	0.59676	0.59674	0.59672	0.59672
0.18	0.60443	0.60088	0.59821	0.59771	0.59716	0.59706	0.59695	0.59693	0.59690	0.59690
0.20	0.60529	0.60144	0.59854	0.59799	0.59740	0.59729	0.59716	0.59713	0.59710	0.59710
0.22	0.60620	0.60204	0.59890	0.59831	0.59766	0.59753	0.59739	0.59737	0.59733	0.59732
0.24	0.60717	0.60269	0.59930	0.59866	0.59795	0.59781	0.59765	0.59762	0.59758	0.59757
0.26	0.60820	0.60338	0.59973	0.59904	0.59827	0.59812	0.59794	0.59790	0.59786	0.59785
0.28	0.60930	0.60413	0.60020	0.59946	0.59862	0.59845	0.59825	0.59821	0.59816	0.59814
0.30	0.61050	0.60495	0.60072	0.59992	0.59900	0.59881	0.59859	0.59854	0.59848	0.59846
0.32	0.61180	0.60583	0.60129	0.60041	0.59941	0.59920	0.59895	0.59890	0.59882	0.59880
0.34	0.61321	0.60680	0.60190	0.60095	0.59985	0.59962	0.59934	0.59927	0.59919	0.59917
0.36	0.61476	0.60784	0.60256	0.60153	0.60033	0.60007	0.59975	0.59967	0.59957	0.59955
0.38	0.61645	0.60898	0.60328	0.60216	0.60083	0.60054	0.60018	0.60009	0.59997	0.59994
0.40	0.61830	0.61022	0.60404	0.60283	0.60136	0.60104	0.60063	0.60053	0.60039	0.60035
0.42	0.62032	0.61156	0.60486	0.60353	0.60192	0.60156	0.60109	0.60097	0.60081	0.60077
0.44	0.62253	0.61301	0.60574	0.60428	0.60249	0.60209	0.60156	0.60142	0.60123	0.60118
0.46	0.62494	0.61458	0.60665	0.60506	0.60308	0.60263	0.60202	0.60187	0.60165	0.60159
0.48	0.62756	0.61625	0.60762	0.60587	0.60368	0.60317	0.60248	0.60231	0.60205	0.60198
0.50	0.63042	0.61804	0.60861	0.60669	0.60427	0.60370	0.60292	0.60272	0.60242	0.60234
0.52	0.63350	0.61995	0.60963	0.60752	0.60484	0.60420	0.60331	0.60309	0.60275	0.60265
0.54	0.63684	0.62196	0.61066	0.60834	0.60537	0.60466	0.60365	0.60339	0.60300	0.60290
0.56	0.64042	0.62407	0.61169	0.60913	0.60584	0.60504	0.60391	0.60361	0.60317	0.60305
0.58	0.64424	0.62626	0.61268	0.60987	0.60622	0.60533	0.60406	0.60372	0.60321	0.60308
0.60	0.64832	0.62851	0.61361	0.61052	0.60648	0.60548	0.60406	0.60368	0.60310	0.60295
0.62	0.65263	0.63081	0.61445	0.61105	0.60657	0.60547	0.60387	0.60344	0.60279	0.60262
0.64	0.65716	0.63311	0.61515	0.61141	0.60647	0.60524	0.60345	0.60297	0.60224	0.60204
0.66	0.66189	0.63539	0.61567	0.61155	0.60609	0.60473	0.60273	0.60219	0.60137	0.60115
0.68	0.66679	0.63758	0.61593	0.61141	0.60539	0.60388	0.60166	0.60105	0.60014	0.59988
0.70	0.67181	0.63963	0.61588	0.61091	0.60428	0.60261	0.60014	0.59947	0.59844	0.59816
0.72	0.67691	0.64146	0.61542	0.60997	0.60268	0.60083	0.59809	0.59735	0.59620	0.59589
0.74	0.68201	0.64300	0.61446	0.60850	0.60048	0.59844	0.59541	0.59459	0.59332	0.59296
0.75	0.68455	0.64363	0.61376	0.60752	0.59912	0.59698	0.59380	0.59293	0.59159	0.59122

Table 1-B-10—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 24-Inch (600-Millimeter) Meter  
 $[D = 23.000 \text{ Inches (584.20 \text{ Millimeters})}]$

$\beta$	Pipe Reynolds Number ( $Re_D$ )									
	4000	10,000	50,000	100,000	500,000	$1 \times 10^6$	$5 \times 10^6$	$10 \times 10^6$	$50 \times 10^6$	$100 \times 10^6$
0.02	0.59768	0.59693	0.59637	0.59627	0.59615	0.59613	0.59611	0.59611	0.59610	0.59610
0.04	0.59869	0.59747	0.59656	0.59639	0.59621	0.59618	0.59614	0.59613	0.59613	0.59613
0.06	0.59957	0.59796	0.59675	0.59653	0.59628	0.59624	0.59619	0.59618	0.59617	0.59617
0.08	0.60041	0.59843	0.59695	0.59668	0.59638	0.59632	0.59626	0.59625	0.59624	0.59624
0.10	0.60121	0.59890	0.59716	0.59684	0.59649	0.59643	0.59636	0.59635	0.59633	0.59633
0.12	0.60201	0.59937	0.59739	0.59703	0.59663	0.59656	0.59648	0.59646	0.59645	0.59644
0.14	0.60280	0.59986	0.59765	0.59724	0.59679	0.59671	0.59662	0.59660	0.59658	0.59658
0.16	0.60361	0.60037	0.59793	0.59747	0.59698	0.59689	0.59678	0.59676	0.59674	0.59674
0.18	0.60445	0.60090	0.59823	0.59773	0.59719	0.59709	0.59697	0.59695	0.59693	0.59692
0.20	0.60532	0.60147	0.59856	0.59802	0.59743	0.59731	0.59719	0.59716	0.59713	0.59713
0.22	0.60623	0.60207	0.59893	0.59834	0.59769	0.59757	0.59742	0.59740	0.59736	0.59736
0.24	0.60720	0.60272	0.59933	0.59869	0.59798	0.59785	0.59769	0.59766	0.59762	0.59761
0.26	0.60823	0.60342	0.59977	0.59908	0.59830	0.59815	0.59798	0.59794	0.59789	0.59788
0.28	0.60934	0.60417	0.60024	0.59950	0.59866	0.59849	0.59829	0.59825	0.59820	0.59818
0.30	0.61054	0.60499	0.60076	0.59996	0.59904	0.59885	0.59863	0.59858	0.59852	0.59851
0.32	0.61184	0.60587	0.60133	0.60046	0.59945	0.59925	0.59900	0.59894	0.59887	0.59885
0.34	0.61325	0.60684	0.60195	0.60100	0.59990	0.59967	0.59938	0.59932	0.59923	0.59921
0.36	0.61480	0.60789	0.60261	0.60158	0.60037	0.60012	0.59980	0.59972	0.59962	0.59959
0.38	0.61649	0.60903	0.60333	0.60221	0.60088	0.60059	0.60023	0.60014	0.60002	0.59999
0.40	0.61834	0.61027	0.60410	0.60288	0.60141	0.60109	0.60068	0.60058	0.60044	0.60040
0.42	0.62036	0.61161	0.60492	0.60358	0.60197	0.60161	0.60114	0.60102	0.60086	0.60082
0.44	0.62257	0.61306	0.60579	0.60433	0.60255	0.60215	0.60161	0.60148	0.60129	0.60123
0.46	0.62498	0.61463	0.60671	0.60511	0.60314	0.60269	0.60208	0.60192	0.60170	0.60164
0.48	0.62761	0.61630	0.60767	0.60592	0.60373	0.60323	0.60253	0.60236	0.60210	0.60203
0.50	0.63046	0.61809	0.60866	0.60674	0.60432	0.60375	0.60297	0.60276	0.60247	0.60239
0.52	0.63355	0.61999	0.60968	0.60757	0.60488	0.60425	0.60336	0.60313	0.60279	0.60270
0.54	0.63688	0.62200	0.61070	0.60838	0.60541	0.60470	0.60369	0.60343	0.60304	0.60294
0.56	0.64046	0.62411	0.61172	0.60917	0.60587	0.60507	0.60394	0.60365	0.60320	0.60308
0.58	0.64429	0.62629	0.61271	0.60989	0.60624	0.60535	0.60408	0.60375	0.60324	0.60310
0.60	0.64836	0.62854	0.61363	0.61054	0.60649	0.60550	0.60407	0.60369	0.60312	0.60296
0.62	0.65267	0.63083	0.61446	0.61105	0.60658	0.60547	0.60387	0.60345	0.60280	0.60262
0.64	0.65720	0.63313	0.61515	0.61140	0.60646	0.60523	0.60344	0.60296	0.60223	0.60202
0.66	0.66192	0.63539	0.61565	0.61153	0.60607	0.60470	0.60270	0.60216	0.60135	0.60112
0.68	0.66682	0.63757	0.61589	0.61137	0.60534	0.60383	0.60160	0.60100	0.60008	0.59983
0.70	0.67184	0.63960	0.61581	0.61084	0.60421	0.60253	0.60006	0.59939	0.59837	0.59808
0.72	0.67693	0.64142	0.61533	0.60987	0.60257	0.60072	0.59798	0.59724	0.59610	0.59578
0.74	0.68203	0.64293	0.61433	0.60836	0.60034	0.59829	0.59526	0.59444	0.59317	0.59281
0.75	0.68456	0.64355	0.61361	0.60736	0.59895	0.59681	0.59363	0.59276	0.59142	0.59105

Table 1-B-11—Discharge Coefficients for Flange-Tapped Orifice Meters: Nominal 30-Inch (750-Millimeter) Meter  
 $[D = 29.000 \text{ Inches (736.60 Millimeters)}]$

$\beta$	Pipe Reynolds Number ( $Re_D$ )									
	4000	10,000	50,000	100,000	500,000	$1 \times 10^6$	$5 \times 10^6$	$10 \times 10^6$	$50 \times 10^6$	$100 \times 10^6$
0.02	0.59768	0.59693	0.59637	0.59627	0.59616	0.59614	0.59611	0.59611	0.59611	0.59610
0.04	0.59869	0.59748	0.59657	0.59640	0.59622	0.59618	0.59615	0.59614	0.59613	0.59613
0.06	0.59958	0.59797	0.59676	0.59653	0.59629	0.59625	0.59620	0.59619	0.59618	0.59618
0.08	0.60041	0.59844	0.59696	0.59668	0.59639	0.59633	0.59627	0.59626	0.59625	0.59625
0.10	0.60122	0.59891	0.59717	0.59685	0.59651	0.59644	0.59637	0.59636	0.59634	0.59634
0.12	0.60202	0.59939	0.59741	0.59704	0.59665	0.59657	0.59649	0.59648	0.59646	0.59646
0.14	0.60282	0.59988	0.59767	0.59726	0.59681	0.59673	0.59664	0.59662	0.59660	0.59660
0.16	0.60363	0.60039	0.59795	0.59749	0.59700	0.59691	0.59681	0.59679	0.59676	0.59676
0.18	0.60447	0.60093	0.59825	0.59776	0.59721	0.59711	0.59700	0.59698	0.59695	0.59695
0.20	0.60534	0.60150	0.59859	0.59805	0.59745	0.59734	0.59721	0.59719	0.59716	0.59715
0.22	0.60626	0.60210	0.59896	0.59837	0.59772	0.59760	0.59746	0.59743	0.59739	0.59739
0.24	0.60723	0.60275	0.59936	0.59872	0.59802	0.59788	0.59772	0.59769	0.59765	0.59764
0.26	0.60826	0.60345	0.59980	0.59911	0.59834	0.59819	0.59801	0.59798	0.59793	0.59792
0.28	0.60937	0.60421	0.60028	0.59954	0.59870	0.59853	0.59833	0.59829	0.59824	0.59822
0.30	0.61057	0.60503	0.60081	0.60000	0.59908	0.59890	0.59867	0.59863	0.59856	0.59855
0.32	0.61188	0.60592	0.60138	0.60050	0.59950	0.59929	0.59904	0.59899	0.59891	0.59889
0.34	0.61329	0.60689	0.60199	0.60105	0.59995	0.59972	0.59943	0.59937	0.59928	0.59926
0.36	0.61484	0.60794	0.60266	0.60163	0.60043	0.60017	0.59985	0.59977	0.59967	0.59965
0.38	0.61653	0.60908	0.60338	0.60226	0.60093	0.60065	0.60028	0.60020	0.60008	0.60005
0.40	0.61838	0.61032	0.60415	0.60293	0.60147	0.60115	0.60073	0.60063	0.60049	0.60046
0.42	0.62041	0.61166	0.60497	0.60364	0.60203	0.60167	0.60120	0.60108	0.60092	0.60087
0.44	0.62262	0.61312	0.60584	0.60439	0.60260	0.60220	0.60166	0.60153	0.60134	0.60129
0.46	0.62503	0.61468	0.60676	0.60517	0.60319	0.60274	0.60213	0.60198	0.60176	0.60170
0.48	0.62766	0.61635	0.60772	0.60597	0.60379	0.60328	0.60259	0.60241	0.60216	0.60209
0.50	0.63051	0.61814	0.60871	0.60679	0.60437	0.60380	0.60302	0.60282	0.60252	0.60244
0.52	0.63360	0.62005	0.60973	0.60762	0.60493	0.60430	0.60341	0.60318	0.60284	0.60275
0.54	0.63693	0.62205	0.61075	0.60843	0.60545	0.60474	0.60374	0.60348	0.60309	0.60298
0.56	0.64051	0.62415	0.61177	0.60921	0.60591	0.60512	0.60399	0.60369	0.60325	0.60312
0.58	0.64434	0.62634	0.61275	0.60993	0.60628	0.60539	0.60412	0.60378	0.60328	0.60314
0.60	0.64841	0.62858	0.61366	0.61057	0.60652	0.60553	0.60410	0.60372	0.60315	0.60299
0.62	0.65272	0.63086	0.61448	0.61107	0.60660	0.60549	0.60389	0.60346	0.60282	0.60264
0.64	0.65724	0.63315	0.61516	0.61141	0.60646	0.60523	0.60344	0.60296	0.60223	0.60203
0.66	0.66197	0.63540	0.61564	0.61152	0.60606	0.60469	0.60269	0.60215	0.60133	0.60111
0.68	0.66686	0.63757	0.61587	0.61134	0.60531	0.60380	0.60158	0.60097	0.60006	0.59980
0.70	0.67188	0.63959	0.61577	0.61080	0.60416	0.60248	0.60001	0.59934	0.59831	0.59803
0.72	0.67697	0.64139	0.61526	0.60980	0.60249	0.60064	0.59790	0.59716	0.59601	0.59570
0.74	0.68206	0.64289	0.61424	0.60825	0.60022	0.59818	0.59515	0.59432	0.59305	0.59270
0.75	0.68459	0.64349	0.61350	0.60724	0.59882	0.59668	0.59349	0.59262	0.59128	0.59091



## APPENDIX 1-C—ADJUSTMENTS FOR INSTRUMENT CALIBRATION AND USE

Note: This appendix is not a part of this standard but is included for informational purposes only.

This appendix discusses the need to consider the determination of flow rate from a holistic viewpoint. To build, operate, and maintain the facility properly, the user must have defined the desired uncertainty for the designer.

The accuracy of the metered quantities depends on a combination of the following:

- a. The design, installation, and operation of the orifice metering facility.
- b. The choice of measurement equipment (charts, transmitters, smart transmitters, analog/digital converters, data loggers, and so forth).
- c. The means of data transmission (analog, pneumatic, digital, manual).
- d. The calculation procedure and means of computation (chart integration, flow computer, mainframe, minicomputer, personal computer, and so forth).
- e. The effects on the operating/calibration equipment of ambient temperature, fluid temperature and pressure, response time, local gravitational forces, atmospheric pressure, and the like.
- f. The traceability chain associated with the portable field standards.

The uncertainty depends not just on the hardware but also on the hardware's performance, the software's performance, the method of calibration, the calibration equipment, the calibration procedures, and the human factor.













