

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

1 <sup>st</sup> through 4 <sup>th</sup> PRINTING (JULY 14, 2011)
--

## CHAPTER 1 SCOPE AND ADMINISTRATION

### **R105.2 Work exempt from a permit. ....**

#### **Building:**

Item 10. ....serve the exit door required by Section ~~311.4~~ 311.2

**R110.2 Change in Use.** Changes in the character or use of an existing structure shall not be made except as specified in Sections ~~3406-3408~~ and ~~3407~~ 3409 of the *International Building Code*.

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1<sup>st</sup> and 2<sup>nd</sup> PRINTING (JULY 14, 2011)</b>
---

## CHAPTER 1 SCOPE AND ADMINISTRATION

**R104.10 Modifications.** ....intent and purpose of this code and that such modification does not lessen health, life and fire safety, or structural requirements ~~or structural~~.

# 2009 International Residential Code and Commentary Errata

(Only errata to Commentary are shown-see International Residential Code Errata for Code Errata)

(Portions of text and tables not shown are unaffected by the errata)

**1<sup>st</sup> and 2<sup>nd</sup> PRINTING (Posted: 9-26-13)**

## CHAPTER 2 DEFINITIONS

### **R202, ATTIC.**

The unfinished space.....of the top story and the roof assembly. ~~Such a space would be the top story, rather than the attic, if it is finished and occupiable.~~

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1<sup>st</sup> and 2<sup>nd</sup> PRINTING (SEPTEMBER 14, 2009)</b>
--

## CHAPTER 2 DEFINITIONS

### **FIRE SEPARATION DISTANCE. ....**

3. To an imaginary line between two buildings on the *lot*.

The distance shall be measured at a right angle from the face of the wall.

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> through 7<sup>th</sup> PRINTING (September 26, 2012)

## CHAPTER 3 BUILDING PLANNING

### R301.2.2.2.5, Item 7

7. When stories above grade plane partially or completely braced by wood wall framing in accordance with Section R603 or steel wall framing in accordance with Section R603 include masonry or concrete construction. When this irregularity applies, the entire story shall be designed in accordance with accepted engineering practice

**Exception:** Fireplaces, chimneys and masonry veneer as permitted by this code. ~~When this irregularity applies, the entire story shall be designed in accordance with accepted engineering practice~~

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> through 5<sup>th</sup> PRINTING (February 28, 2012)

## CHAPTER 3 BUILDING PLANNING

**R301.2.2.3.3 Masonry construction.** Masonry construction in Seismic Design Categories D0 and D1 shall comply with the requirements of Section R606.4412.3. Masonry construction in Seismic Design Category D2 shall comply with the requirements of Section R606.4412.4.

**TABLE R308.3.1(1)**

**TABLE R308.3.1(1)  
MINIMUM CATEGORY CLASSIFICATION OF GLAZING USING CPSC 16 CFR 1201**

EXPOSED SURFACE AREA OF ONE SIDE OF ONE LITE	GLAZING IN STORM OR COMBINATION DOORS (Category Class)	GLAZING IN DOORS (Category Class)	GLAZED PANELS REGULATED BY ITEM 3 OF SECTION R308.4 (Category Class)	GLAZED PANELS REGULATED BY ITEM 2 OF SECTION R308.4 (Category Class)	GLAZING IN DOORS AND ENCLOSURES REGULATED BY ITEM 5 OF SECTION R308.4 (Category Class)	SLIDING GLASS DOORS PATIO TYPE (Category Class)
9 square feet or less	I	I	NR	I	II	II
More than 9 square feet	II	II	II	II	II	II

For SI: 1 square foot = 0.0929 m<sup>2</sup>.  
NR means "No Requirement!"

**R318.1 Subterranean termite control methods.** In areas subject to damage from termites as indicated by Table R301.2(1), methods of protection shall be one of the following methods or a combination of these methods:

1. Chemical termiticide treatment, as provided in Section R318.2.
2. Termite baiting system installed and maintained according to the *label*.
3. Pressure-preservative-treated wood in accordance with the provisions of Section R317.1.
4. Naturally durable termite-resistant wood and used in locations as specified in Section R318.1.
5. Physical barriers as provided in Section R318.3 ~~and used in locations as specified in Section R318.1.~~
6. Cold-formed steel framing in accordance with Sections R505.2.1 and R603.2.1.

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1<sup>st</sup> through 4<sup>th</sup> PRINTING (Posted: 11-29-2011)</b>
--

## **CHAPTER 3 BUILDING PLANNING**

Figure R301.2(5) corrections as follows:

1. At the center of the State of North Dakota, the ground snow load shown as 36 should read 35.
2. At the State of Pennsylvania, the elevation shown as 700 (2 places) should read 1700.


# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1st through 4th PRINTING (JULY 14, 2011)

## CHAPTER 3 BUILDING PLANNING

FIGURE R301.2(7)  
COMPONENT AND CLADDING PRESSURE ZONES

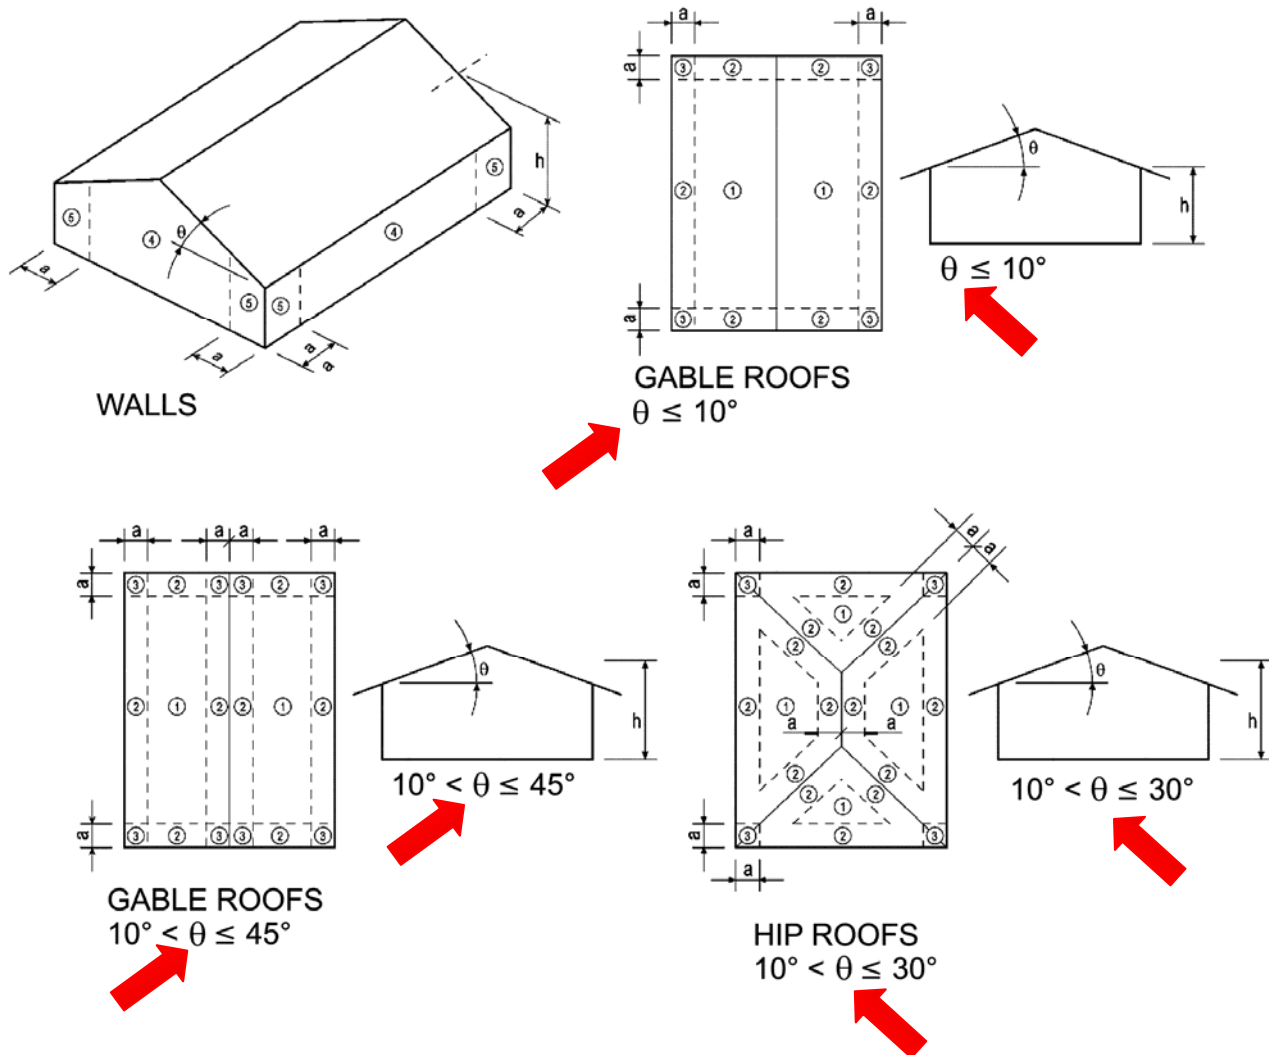

### R301.2.1.2 Protection of openings. ....

**Exception:** Wood structural.....Panels shall be precut so that they can be and attached to the framing....



# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

**TABLE R308.3.1(1) MINIMUM CATEGORY CLASSIFICATION OF GLAZING USING CPSC 16 CFR 1201**

EXPOSED SURFACE AREA OF ONE SIDE OF ONE LITE	GLAZING IN STORM OR COMBINATION DOORS (Category Class)	GLAZING IN DOORS (Category Class)	GLAZED PANELS REGULATED BY ITEM <del>7</del> <u>4</u> OF SECTION R308.4 (Category Class)	GLAZED PANELS REGULATED BY ITEM <del>6</del> <u>2</u> OF SECTION R308.4 (Category Class)	GLAZING IN DOORS AND ENCLOSURES REGULATED BY ITEM 5 OF SECTION R308.4 (Category Class)	SLIDING GLASS DOORS PATIO TYPE (Category Class)
9 square feet or less	I	I	NR	I	II	II
More than 9 square feet	II	II	II	II	II	II

**TABLE R308.3.1(2) MINIMUM CATEGORY CLASSIFICATION OF GLAZING USING ANSI Z97.1**

EXPOSED SURFACE AREA OF ONE SIDE OF ONE LITE	GLAZED PANELS REGULATED BY ITEM <del>7</del> <u>3</u> OF SECTION R308.4 (Category Class)	GLAZED PANELS REGULATED BY ITEM <del>6</del> <u>2</u> OF SECTION R308.4 (Category Class)	DOORS AND ENCLOSURES REGULATED BY ITEM 5 OF SECTION R308.4 <sup>a</sup> (Category Class)
---	--	--	---

**R310.3 Bulkhead enclosures.** .....Bulkhead enclosures shall also comply with Section R311.7.8 9.2

**R311.7.5 Landings for stairways.** ....

**Exception:** A floor ....over the stairs. ~~A flight of stairs shall not have a vertical rise larger than 12 feet (3658 mm) between floor levels or landings. The width of each landing shall not be less than the width of the stairway served. Every landing shall have a minimum dimension of 36 inches (914 mm) measured in the direction of travel.~~

A flight of stairs shall not have a vertical rise larger than 12 feet (3658 mm) between floor levels or landings.

The width of each landing shall not be less than the width of the stairway served. Every landing shall have a minimum dimension of 36 inches (914 mm) measured in the direction of travel.

**R316.6 Specific approval.** ...NFPA 286 with the acceptance criteria of Section R302.9.4, FM4880, ~~UL 723, UL1040~~  
or.....


# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> and 2<sup>nd</sup> PRINTING (JULY 14, 2011)

## CHAPTER 3 BUILDING PLANNING

**FIGURE R301.2.1.5.1(3)**  
**ILLUSTRATION OF WHERE ON A TOPOGRAPHIC FEATURE, WIND SPEED INCREASE IS APPLIED**

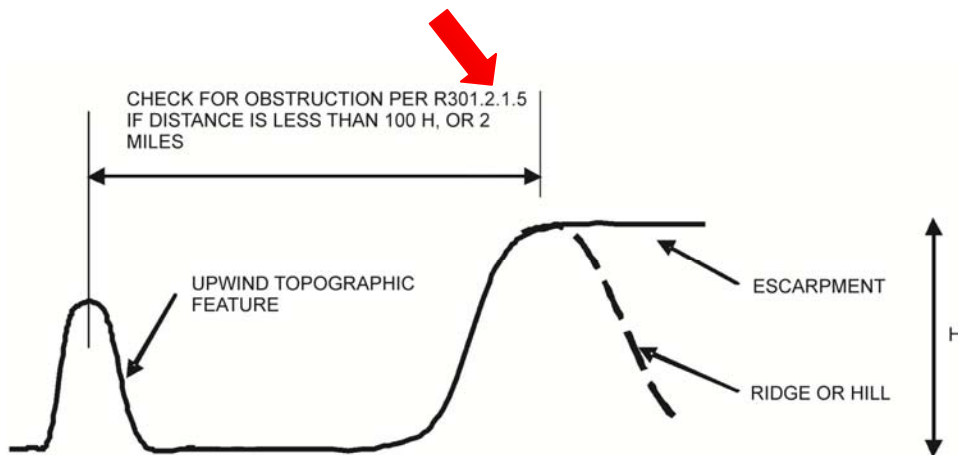

**R301.2.2.1.1 Alternate determination of seismic design category.** ....and to interpolate between values in Tables ~~R602.10.1~~ R602.10.1(2), ~~R603.7~~ R603.9.2(1) and other seismic design requirements of this code.

**TABLE R301.5**  
**MINIMUM UNIFORMLY DISTRIBUTED LIVE LOADS (in pounds er square foot)**

.....

Note g. For attics.....

1. The attic area is accessible by a pull down stairway or framed opening in accordance with Section R807.1.

**TABLE R302.1**  
**EXTERIOR WALLS**

EXTERIOR WALL ELEMENT		MINIMUM FIRE-RESISTANCE RATING	MINIMUM FIRE SEPARATION DISTANCE
Penetrations	All	Comply with Section <del>R317.3</del> <u>R302.4</u>	< 5 feet
		None required	5 feet

### **R308.4 Hazardous locations. ....**

#### **7. Glazing...**

Exceptions:

2. The side .... complying with Sections R311.7.6-7 and ....

#### **8. Glazing ...**

Exceptions:

1. The side ... complying with Sections R311.7.6-7 and ....

**R317.3.2 Fastenings for wood foundations.** Fastenings ... in AF&PA Technical Report No. 7 PWF.

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> and 2<sup>nd</sup> PRINTING (SEPTEMBER 14, 2009)

## CHAPTER 3 BUILDING PLANNING

### FIGURE R301.2.1.5.1(3)

~~ILLUSTRATION OF WHERE ON A TOPOGRAPHIC FEATURE, WIND SPEED INCREASE IS APPLIED~~ UPWIND OBSTRUCTION

TABLE R302.1  
EXTERIOR WALLS

EXTERIOR WALL ELEMENT		MINIMUM FIRE-RESISTANCE RATING	MINIMUM FIRE SEPARATION DISTANCES
Walls	(Fire-resistance rated)	1 hour –tested in accordance with ASTM E 119 or UL 263 with exposure <del>from</del> <u>from</u> both sides	< 5 feet
	(Not fire-resistance rated)	0 hours	≥ 5 feet

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> through 7<sup>th</sup> PRINTING (12-04-2012)

## CHAPTER 4 FOUNDATIONS

TABLE R403.4

		TABLE R403.4 MINIMUM DEPTH OF CRUSHED STONE FOOTINGS (D), (inches)															
		LOAD BEARING VALUE OF SOIL (psf)															
		1500				2000				3000				4000			
		MH, CH, CL, ML				SC, GC, SM, GM, SP, SW				GP, GW							
		Wall width (inches)				Wall width (inches)				Wall width (inches)				Wall width (inches)			
		6	8	10	12	6	8	10	12	6	8	10	12	6	8	10	12
Conventional light-frame construction																	
1-story	1100 plf	6	4	4	4	6	4	4	4	6	4	4	4	6	4	4	4
2-story	1800 plf	8	6	4	4	6	4	4	4	6	4	4	4	6	4	4	4
3-story	2000 plf	16	14	12	10	10	8	6	6	6	4	4	4	6	4	4	4
4-inch brick veneer over light-frame or 8-inch hollow concrete masonry																	
1-story	1500 plf	6	4	4	4	6	4	4	4	6	4	4	4	6	4	4	4
2-story	2700 plf	14	12	10	8	10	8	6	4	6	4	4	4	6	4	4	4
3-story	4000 plf	22	22	20	18	16	14	12	10	10	8	6	4	6	4	4	4
8-inch solid or fully grouted masonry																	
1-story	2000 plf	10	8	6	4	6	4	4	4	6	4	4	4	6	4	4	4
2-story	3600 plf	20	18	16	16	14	12	10	8	8	6	4	4	6	4	4	4
3-story	5300 plf	32	30	28	26	22	22	20	18	14	12	10	8	10	8	6	4

For SI: 1 inch = 25.4 mm, 1 pound per square inch = 6.89 kPa.

1 plf = 14.6 N/m      1 pounds per square foot = 47.9 N/m<sup>2</sup>

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

1 <sup>st</sup> through 6 <sup>th</sup> PRINTING (Posted: 06-06-12)
---

## CHAPTER 4 FOUNDATIONS

**R404.1.2.2 Reinforcement for foundation walls.** Concrete.....Vertical reinforcement for flat basement walls...in accordance with Table R404.1.2(~~9~~) (8). For *basement* walls....

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1<sup>st</sup> through 5<sup>th</sup> PRINTING ( 9-19-2011 )</b>
---

## CHAPTER 4 FOUNDATIONS

**R403.1.8 Foundations on expansive soils.** Foundation and floor slabs for buildings located on expansive soils shall be designed in accordance with Section ~~1805.8~~ 1808.6 of the *International Building Code* .

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1st through 4th PRINTING (JULY 14, 2011)</b>
---

## CHAPTER 4 FOUNDATIONS

TABLE R404.1.1(3)  
10-INCH MASONRY FOUNDATION WALLS WITH REINFORCING....


# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> and 2<sup>nd</sup> PRINTING (JULY 14, 2011)

## CHAPTER 4 FOUNDATIONS

**FIGURE R403.1.7.1  
FOUNDATION CLEARANCE FROM SLOPES**

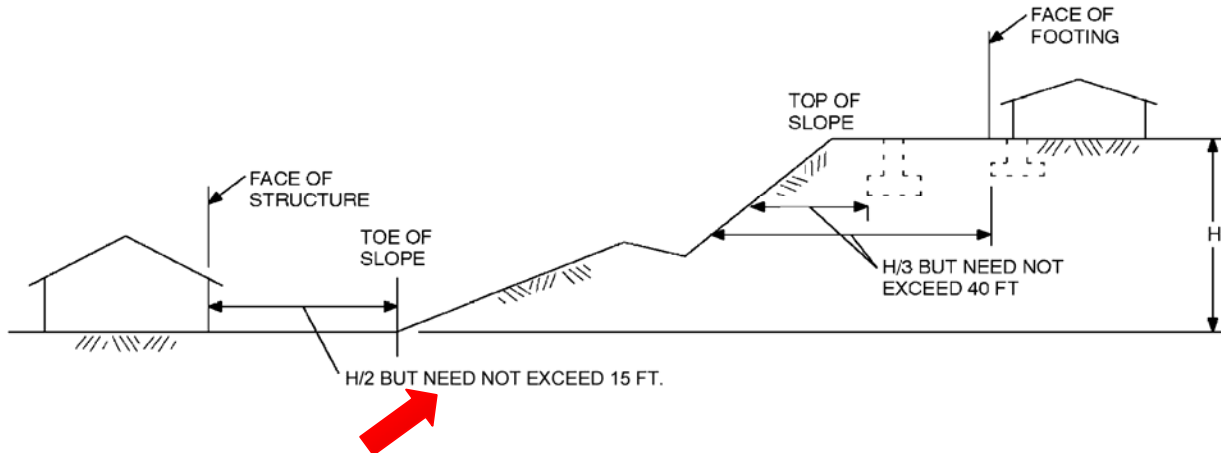

**TABLE R403.4  
MINIMUM DEPTH OF CRUSHED STONE FOOTINGS (*D*), (inches)**

		LOAD BEARING VALUE OF SOIL (psf)															
		1500				2000				3000				4000			
		MH, CH, CL, ML				SC, GC, SM, GM, SP, SW				GP, GW							
		Wall width (inches)				Wall width (inches)				Wall width (inches)				Wall width (inches)			
		6	8	10	12	6	8	10	12	6	8	10	12	6	8	10	12
Conventional light-frame construction																	
1-story	1100 plf	6	4	4	4	6	4	4	4	6	4	4	4	6	4	4	6
2-story	1800 plf	8	6	4	4	6	4	4	4	6	4	4	4	6	4	4	4
3-story	<del>2000</del> 2900 plf	16	14	12	10	10	8	6	6	6	4	4	4	6	4	4	4



# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> and 2<sup>nd</sup> PRINTING (SEPTEMBER 14, 2009)

## CHAPTER 4 FOUNDATIONS

**R404.1.1 Design of masonry foundation walls.** Masonry foundation walls .....accordance with the provisions of ~~ACI 530/ASCE 5/TMS 402~~ TMS 402/ACI 530/ASCE 5 or NCMA TR68-A. When ~~ACI 530/ASCE 5/TMS 402~~ TMS 402/ACI 530/ASCE 5, NCMA TR68-A or the provisions .....

**R404.1.2.3.7.2 Location of reinforcement in wall.** The center of vertical reinforcement in *basement* walls determined from Tables ~~R404.1.2(3)~~ R404.1.2 (2) through R404.1.2(7) shall be located at the centerline of the wall. Vertical reinforcement in *basement* walls determined from Tables ~~R404.1.2(2)~~ or R404.1.2(8) shall be located .....

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

1 <sup>st</sup> through 5 <sup>th</sup> PRINTING (Posted: 12-06-2011)
---

## CHAPTER 5 FLOORS

**R502.1.1 Preservative-treated lumber.** Preservative treated dimension lumber shall also be identified as required by Section ~~R319.1~~ R317.2.

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> and 2<sup>nd</sup> PRINTING (JULY 14, 2011)

## CHAPTER 5 FLOORS

TABLE R503.2.1.1(1)

ALLOWABLE SPANS AND LOADS FOR WOOD STRUCTURAL PANELS FOR ROOF AND SUBFLOOR SHEATHING  
AND COMBINATION SUBFLOOR UNDERLAYMENT<sup>a,b,c</sup>

SPAN RATING	MINIMUM NOMINAL PANEL THICKNESS (Inch)	ALLOWABLE LIVE LOAD (psf) <sup>h,i</sup>		MAXIMUM SPAN (inches)		LOAD (pounds per square foot, at maximum span)		MAXIMUM SPAN (inches)
		SPAN @ 16" o.c.	SPAN @ 24" o.c.	With edge support <sup>d</sup>	Without edge support	Total load	Live load	
Sheathing <sup>e</sup>				Roof <sup>f</sup>				Subfloor <sup>j</sup>
48/24	23/32, 3/4-3/4	-	175	48	36	45	35	24





# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> through 10<sup>th</sup> PRINTING (April 15, 2014)

## CHAPTER 6 WALLS

TABLE R602.3(5)  
SIZE, HEIGHT AND SPACING OF WOOD STUDS<sup>a</sup>

STUD SIZE (inches)	BEARING WALLS					NONBEARING WALLS	
	Laterally unsupported stud height <sup>a</sup> (feet)	Maximum spacing when supporting a roof-ceiling assembly or a habitable attic assembly, only (inches)	Maximum spacing when supporting one floor, plus a roof-ceiling assembly or a habitable attic assembly (inches)	Maximum spacing when supporting two floors, plus a roof-ceiling assembly or a habitable attic assembly (inches)	Maximum spacing when supporting one floor height <sup>a</sup> (inches)	Laterally unsupported stud height <sup>a</sup> (feet)	Maximum spacing (inches)
							

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> through 7<sup>th</sup> PRINTING (Posted: October 3, 2012)

## CHAPTER 6 WALL CONSTRUCTION

TABLE R611.7(1C)

TABLE R611.7(1C)  
UNREDUCED LENGTH,  $U_R$ , OF SOLID WALL REQUIRED IN EACH EXTERIOR SIDEWALL FOR WIND PARALLEL TO RIDGE<sup>a,c,d,e,f,g</sup>

SIDEWALL LENGTH (feet)	ENDWALL LENGTH (feet)	ROOF SLOPE	UNREDUCED LENGTH, U/R, OF SOLID WALL REQUIRED IN SIDEWALLS FOR WIND PARALLEL TO RIDGE (feet)						
			Basic Wind Speed (mph) Exposure						
			85B	90B	100B	110B	120B	130B	Minimum <sup>b</sup>
					85C	90C	100C	110C	
						85D	90D	100D	
One story or top story of two-story									
		< 1:12	0.95	1.06	1.31	1.59	1.89	2.22	0.90

TABLE R611.7(1C)—continued  
UNREDUCED LENGTH,  $U_R$ , OF SOLID WALL REQUIRED IN EACH EXTERIOR SIDEWALL FOR WIND PARALLEL TO RIDGE  
FIRST STORY OF TWO-STORY<sup>a,c,d,e,f,g</sup>

SIDEWALL LENGTH (feet)	ENDWALL LENGTH (feet)	ROOF SLOPE	UNREDUCED LENGTH, $U_R$ , OF SOLID WALL REQUIRED IN SIDEWALLS FOR WIND PARALLEL TO RIDGE (feet)						
			Basic Wind Speed (mph) Exposure						
			85B	90B	100B	110B	120B	130B	Minimum <sup>b</sup>
					85C	90C	100C	110C	
						85D	90D	100D	
		< 1:12	7.34	8.22	10.17	12.29	14.62	17.16	7.85


# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> through 5<sup>th</sup> PRINTING (February 28, 2012)

## CHAPTER 6 WALL CONSTRUCTION

FIGURE R602.10.1.4.1

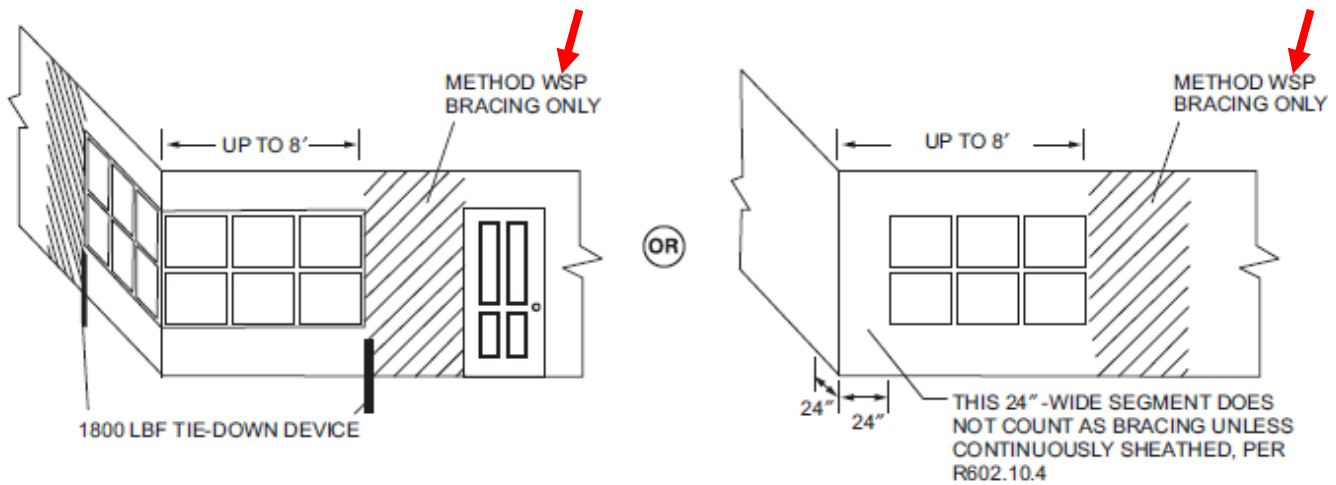


For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 pound force = 4.448 N.

FIGURE R602.10.1.4.1  
BRACED WALL PANELS AT ENDS OF BRACED WALL LINES IN SEISMIC DESIGN CATEGORIES D<sub>0</sub>, D<sub>1</sub> AND D<sub>2</sub>

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

FIGURE R602.10.3.4

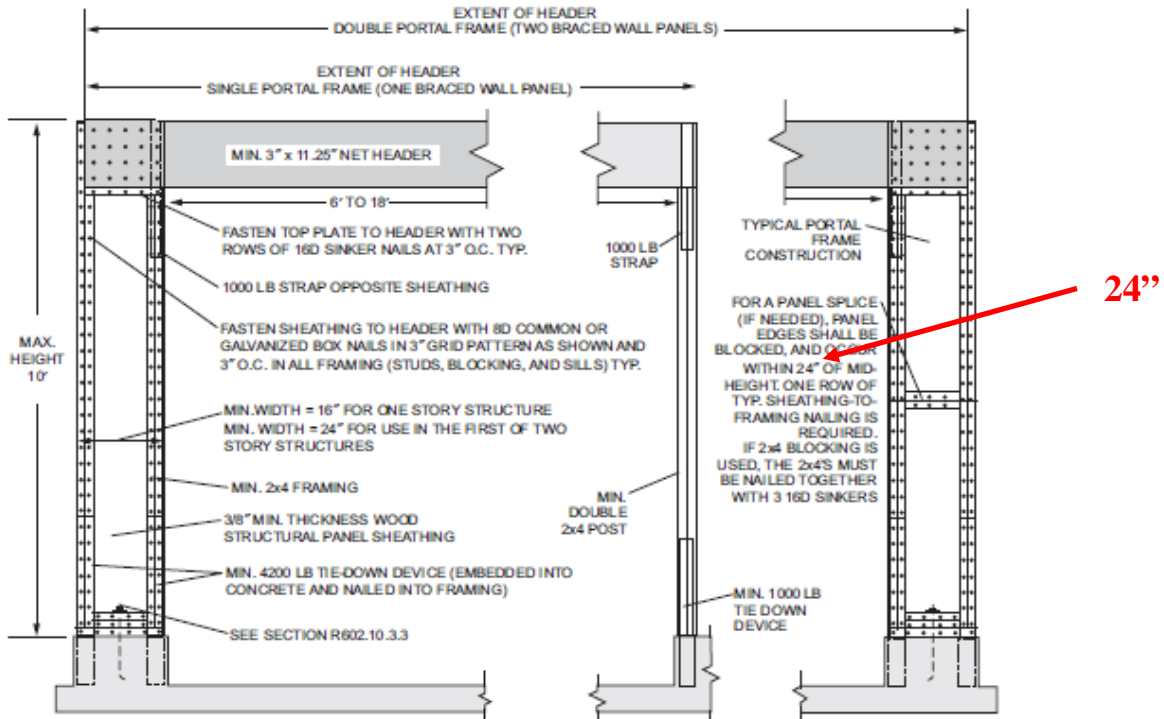

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 pound force = 4.448 N.


FIGURE R602.10.3.3  
METHOD PFH: PORTAL FRAME WITH HOLD-DOWNS

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

FIGURE R603.6(2)


FIGURE R606.11.2

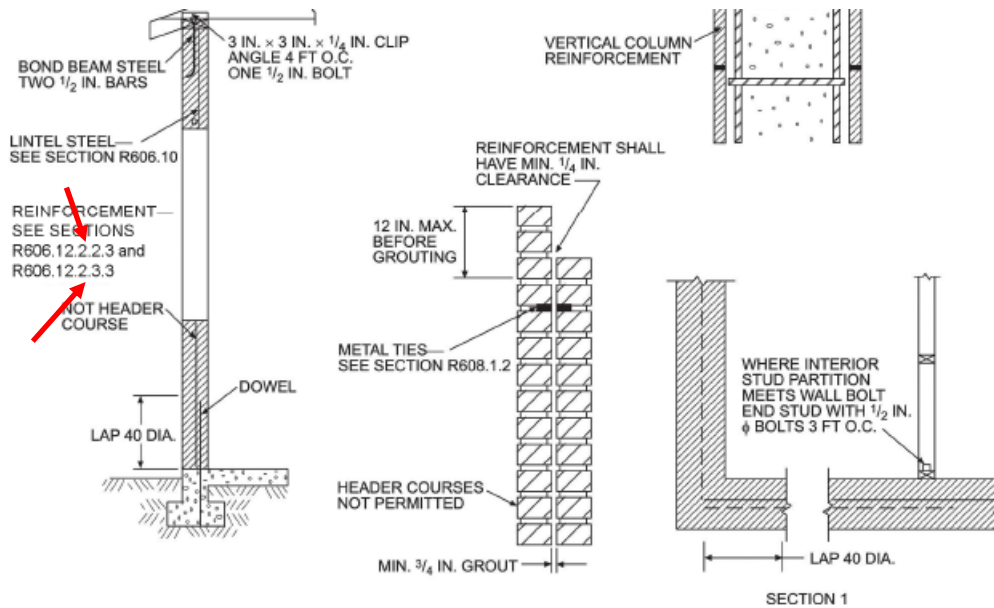

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm.

FIGURE R606.11(2)  
REQUIREMENTS FOR REINFORCED GROUTED MASONRY CONSTRUCTION IN SEISMIC DESIGN CATEGORY C

FIGURE R606.11(3)

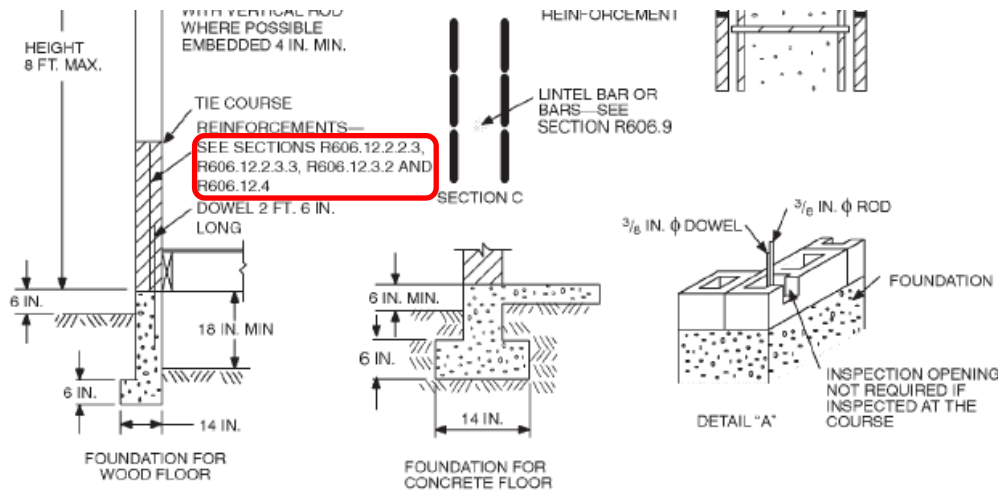

NOTE: A full bed joint must be provided. All cells containing vertical bars are to be filled to the top of wall and provide inspection opening as shown on detail "A."  
Horizontal bars are to be laid as shown on detail "B." Lintel bars are to be laid as shown on Section C.

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm.

FIGURE R606.11(3)  
REQUIREMENTS FOR REINFORCED MASONRY CONSTRUCTION IN SEISMIC DESIGN CATEGORY D<sub>0</sub>, D<sub>1</sub>, OR D<sub>2</sub>



(Portions of text and tables not shown are unaffected by the errata)

**TABLE R611.8(2)**  
**MAXIMUM ALLOWABLE CLEAR SPANS FOR 4-INCH NOMINAL THICK FLAT LINTELS IN LOAD-BEARING WALLS<sup>a, b, c, d, e, f, m</sup>**  
**ROOF CLEAR SPAN 40 FEET AND FLOOR CLEAR SPAN 32 FEET**

LINTEL DEPTH, <i>D</i> <sup>B</sup> (inches)	NUMBER OF BARS AND BAR SIZE IN TOP AND BOTTOM OF LINTEL	STEEL YIELD STRENGTH <sup>C</sup> , <i>f<sub>y</sub></i> (psi)	DESIGN LOADING CONDITION DETERMINED FROM TABLE R611.8(1)									
			1	2		3		4		5		
				30	70	30	70	30	70	30	70	
			Maximum ground snow load (psf)									
			Maximum clear span of lintel (feet - inches)									

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> through 4<sup>th</sup> PRINTING (Posted: 11-29-2011)

## CHAPTER 6 WALL CONSTRUCTION

### TABLE R602.3(1) FASTENER SCHEDULE FOR STRUCTURAL MEMBERS

Other wall sheathing <sup>h</sup>				
34	½" structural cellulosic fiberboard sheathing	1 ½" galvanized roofing nail, 7/16" crown or 1" crown staple 16 ga., 1 1/4" long	3	6

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> through 4<sup>th</sup> PRINTING ( Posted: August 11, 2011 )

## CHAPTER 6 WALL CONSTRUCTION

Table R602.3(1)

TABLE R602.3(1)  
FASTENER SCHEDULE FOR STRUCTURAL MEMBERS

ITEM	DESCRIPTION OF BUILDING MATERIALS	DESCRIPTION OF FASTENER <sup>b,c,e</sup>	SPACING OF FASTENERS	
			Edges (inches) <sup>i</sup>	Intermediate supports <sup>c,e</sup> (inches)
Wood structural panels, subfloor, roof and interior wall sheathing to framing and particle board wall sheathing to framing				
30	3/8" – 1/2"	6d common (2"x 0.113") nail (subfloorwall) <sup>j</sup> 8d common (2 1/2" x 0.131") nail (roof) <sup>f</sup>	6	12 <sup>g</sup>

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)


1st through 4th PRINTING (JULY 14, 2011)

## CHAPTER 6 WALL CONSTRUCTION

### TABLE R602.3(2)....


Note f. Hardboard underlayment shall conform to CPA/ANSI/AA A135.4

### FIGURE R602.10.3.3 METHOD PFH: PORTAL FRAME WITH HOLD-DOWNS

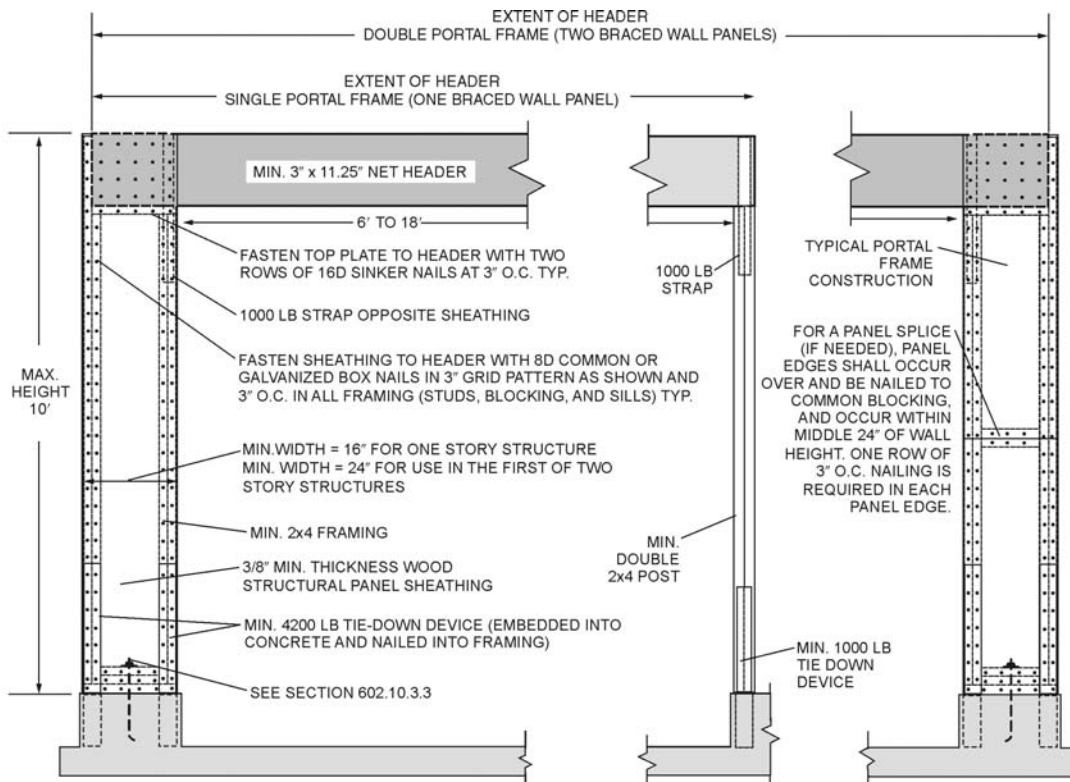

(Portions of text and tables not shown are unaffected by the errata)

## BRACED WALL PANEL CONNECTION OPTION TO PERPENDICULAR RAFTERS OR ROOF TRUSSES



**ROOF CLEAR SPAN 40 FEET AND FLOOR CLEAR SPAN 32 FEET**

LINTEL DEPTH, $D^g$ (inches)	NUMBER OF BARS AND BAR SIZE IN TOP AND BOTTOM OF LINTEL	STEEL YIELD STRENGTH <sup>h</sup> , $f_y$ (psi)	DESIGN LOADING CONDITION DETERMINED FROM TABLE R611.8(1)								
			1	2	3	4	5				
			MAXIMUM GROUND SNOW LOAD (psf)								
				30	70	30	70	30	70	30	70
			Maximum clear span of lintel (feet - inches)								

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> through 4<sup>th</sup> PRINTING (SEPTEMBER 14, 2009)

## CHAPTER 6 WALL CONSTRUCTION

TABLE R602.3(1)  
FASTENER SCHEDULE FOR STRUCTURAL MEMBERS

ITEM	DESCRIPTION OF BUILDING ELEMENTS	NUMBER AND TYPE OF FASTENER <sup>a, b, c</sup>	SPACING OF FASTENERS
<b>Wall</b>			
13	Double top plates, minimum 48 <del>24</del> -inch offset of end joints, face nail in lapped area	8-16d (3 1/2" x 0.135")	—

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> through 3<sup>rd</sup> PRINTING (JULY 14, 2011)

## CHAPTER 6 WALL CONSTRUCTION

**TABLE R602.10.1.2(3)**  
**ADJUSTMENT FACTORS TO THE LENGTH OF REQUIRED SEISMIC WALL BRACING<sup>a</sup>**

ADJUSTMENT BASED ON:			MULTIPLY LENGTH OF BRACING PER WALL LINE BY:	APPLIES TO:
Roof/ceiling dead load for wall supporting <sup>b</sup>	roof only or roof plus one story	≤ 15 psf	1.0	
	roof only	<15 psf ≤ 25 psf	<del>4.4-1.2</del>	
	roof plus one story	<15 psf ≤ 25 psf	<del>4.2-1.1</del>	
Walls with stone or masonry veneer in SDC-C-D <sub>2</sub>		See Section R703.7		
Cripple walls		See Section R602.10.9		

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> and 2<sup>nd</sup> PRINTING (JULY 14, 2011)

## CHAPTER 6 WALL CONSTRUCTION

TABLE R602.3(1)  
FASTENER SCHEDULE FOR STRUCTURAL MEMBERS


ITEM	DESCRIPTION OF BUILDING MATERIALS	DESCRIPTION OF FASTENER	SPACING OF FASTENERS	
			Edges (inches) <sup>i</sup>	Intermediate supports <sup>c,e</sup> (inches)
Wood structural panels. Subfloor, roof and interior wall sheathing to				
31	5/16"—½"	6d common (2" x 0.113) nail (subfloor, wall) 8d common (2 ½"—0.131") nail (roof) <sup>f</sup>	6	12 <sup>g</sup>
<del>32</del> 31				
<del>33</del> 32				
<del>34</del> 33				
<del>35</del> 34				
<del>36</del> 35				
<del>37</del> 36				
<del>38</del> 37				
<del>39</del> 38				
<del>40</del> 39				



# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

**FIGURE R602.3(2)**  
**FRAMING DETAILS**

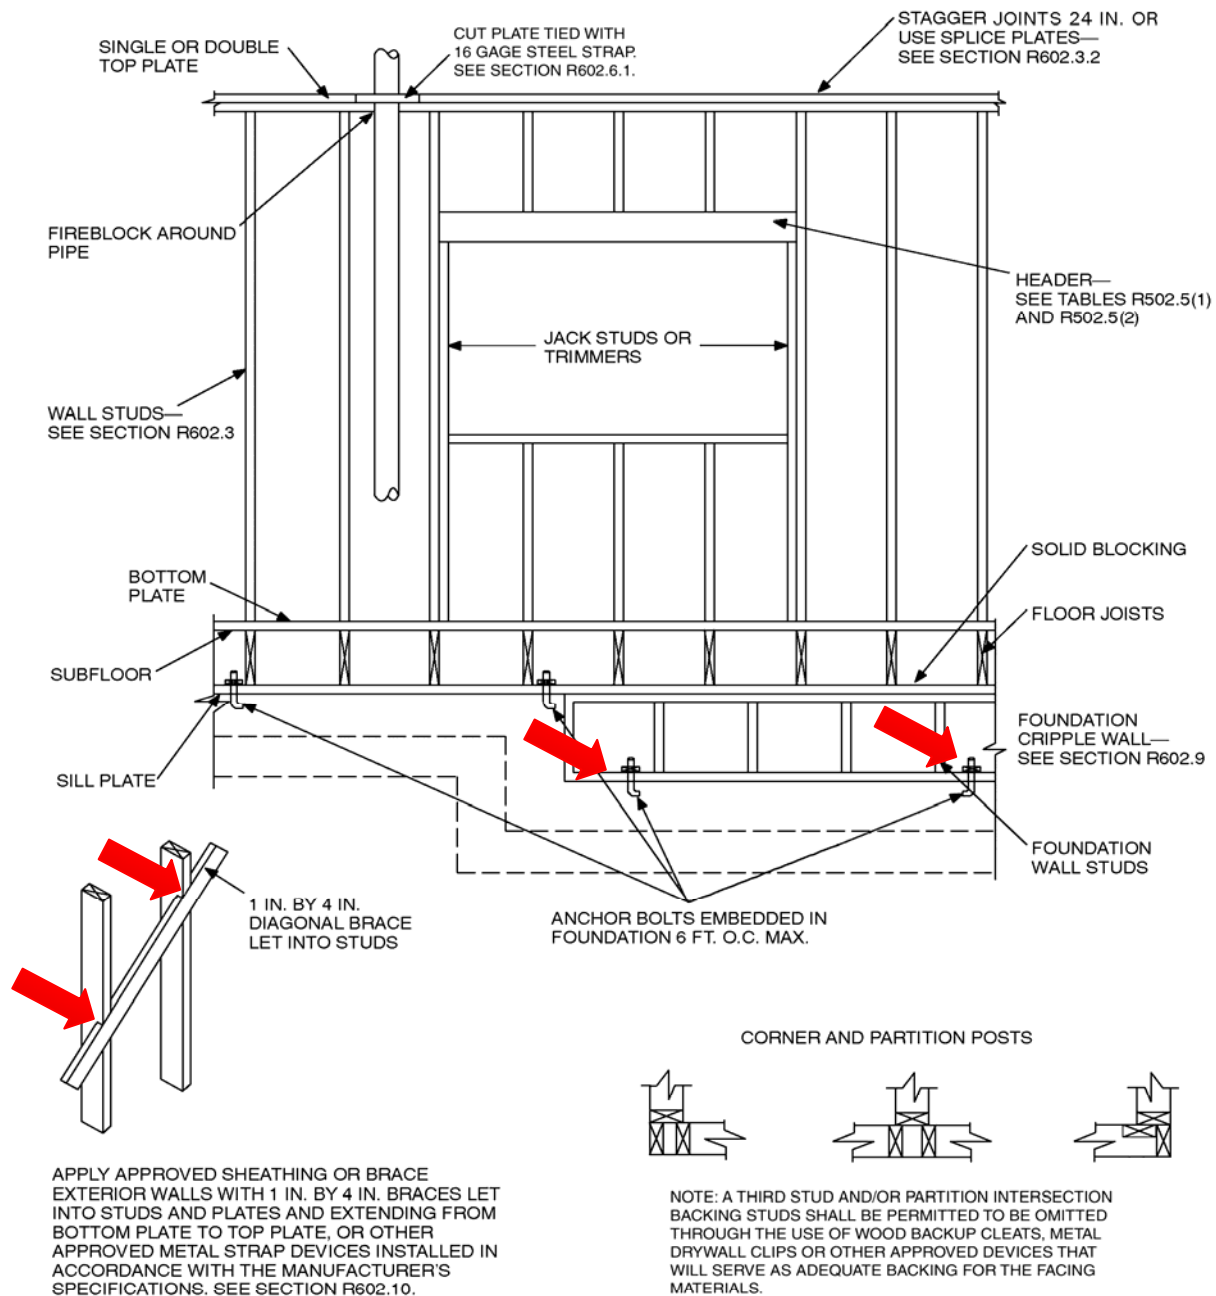

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

FIGURE 602.6.1

## TOP PLATE FRAMING TO ACCOMMODATE PIPING

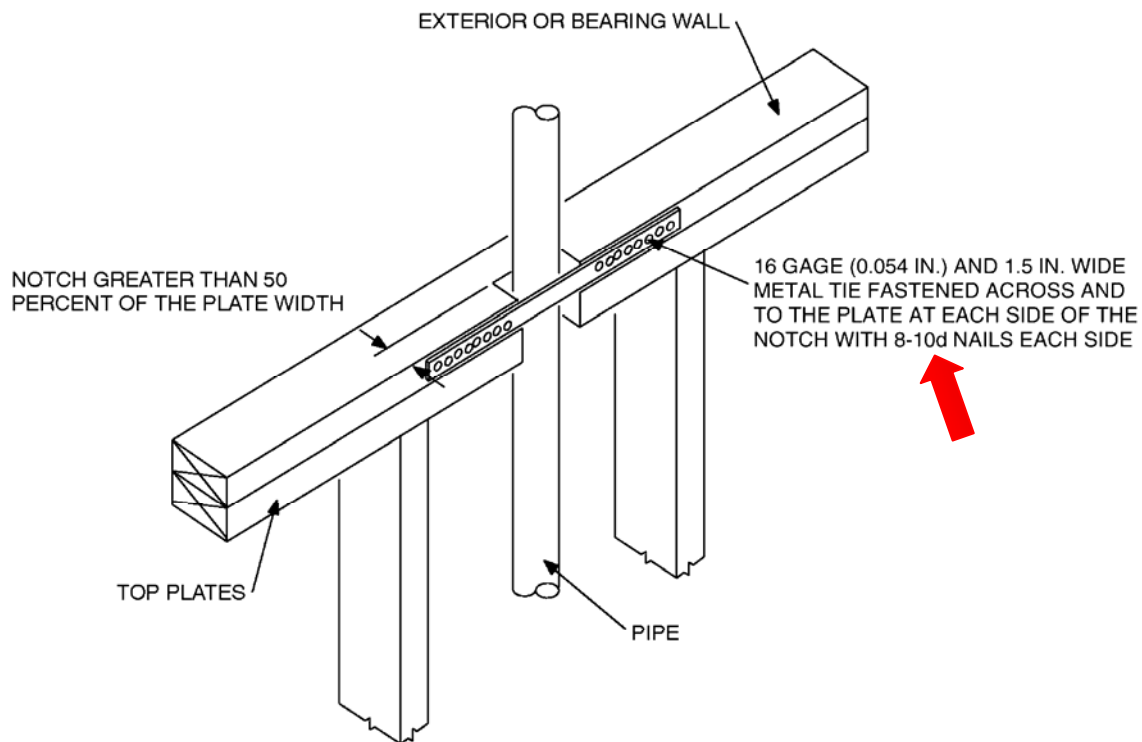


TABLE R602.10.1.2(1)<sup>a,b,c,d,e</sup>

## BRACING REQUIREMENTS BASED ON WIND SPEED (as a function of braced wall line spacing)

EXPOSURE CATEGORY B, 30 FT MEAN ROOF HEIGHT, 10 FT EAVE TO RIDGE HEIGHT, 10 FT WALL HEIGHT, 2 BRACED WALL LINES			MINIMUM TOTAL LENGTH (feet) OF BRACED WALL PANELS REQUIRED ALONG EACH BRACED WALL LINE			
Basic Wind Speed (mph)	Story Location	Braced Wall Line Spacing (feet)	Method LIB <sup>h</sup>	Method GB (double sided) <sup>a</sup>	Methods DWB, WSP, SFB, <u>PBS</u> , PCP, HPS <sup>i</sup> ,	Continuous Sheathing

For SI: 1 foot = 304.8 mm, 1 inch = 25.4 mm, 1 mile per hour = 0.447 m/s, 1 pound force = 4.448 N.

- Tabulated bracing lengths are based on Wind Exposure Category B, a 30-ft mean roof height, a 10-ft eave to ridge height, a 10-ft wall height, and two braced wall lines sharing load in a given plan direction on a given story level. Methods of bracing shall be as described in Sections R602.10.2, R602.10.4 and R602.10.5. Interpolation shall be permitted.
- For other mean roof heights and exposure categories, the required bracing length shall be multiplied by the appropriate factor from the following table:


# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

**Figure R602.10.4.1.1**

## **METHOD CS-PF: CONTINUOUS PORTAL FRAME PANEL CONSTRUCTION**

**REPLACE FIGURE IN ITS ENTIRETY WITH THE FOLLOWING:**

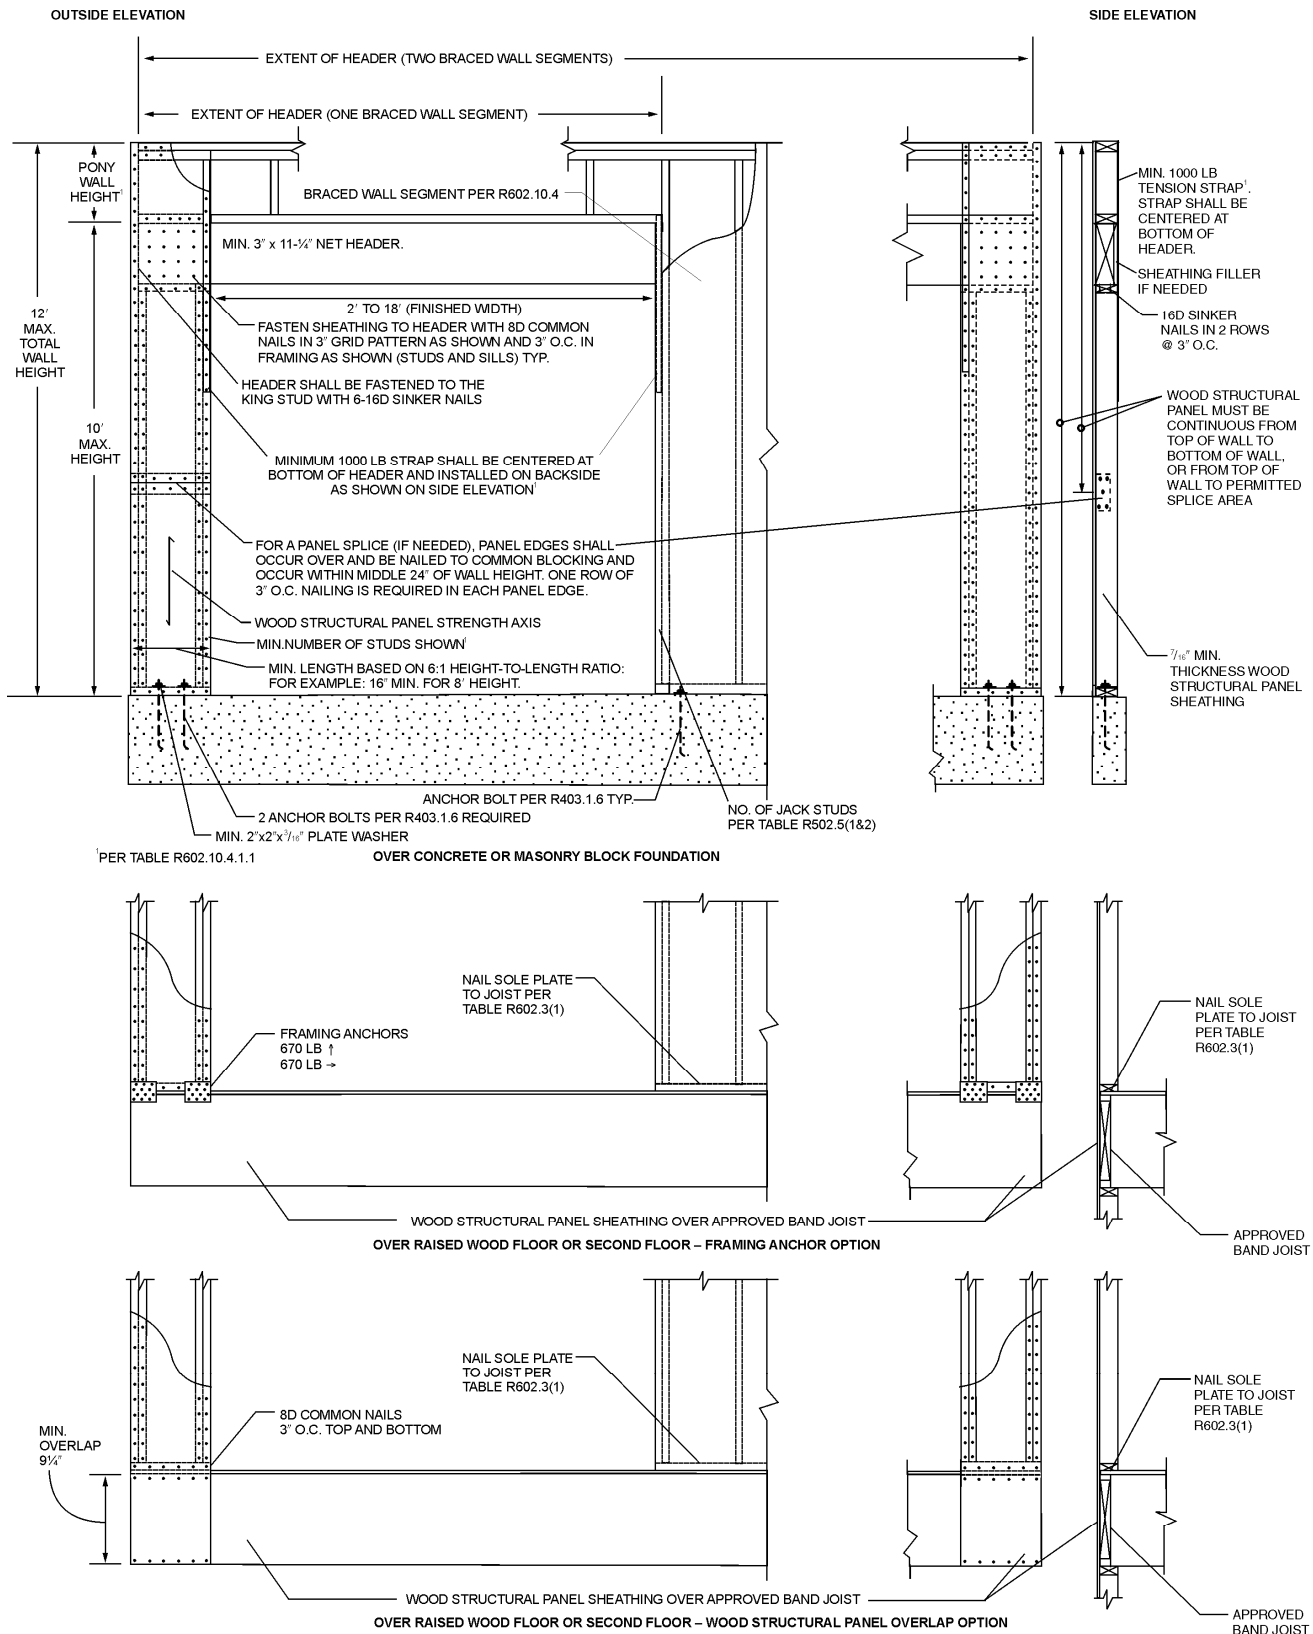

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 pound force = 4.448 N.


NOT TO SCALE

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

FIGURE R602.10.6.2(3)

## BRACED WALL PANEL CONNECTION OPTION TO PERPENDICULAR RAFTERS OR ROOF TRUSSES

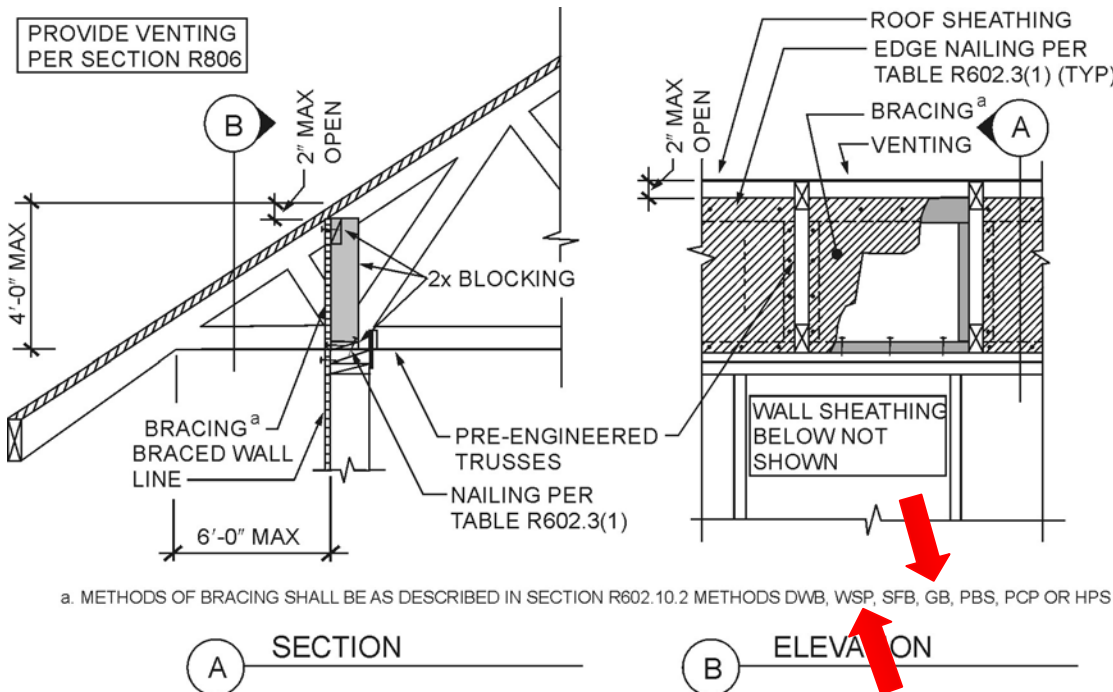

### R603.3.3 Stud bracing.....

3. Sheathing on one side and strapping on the other side fastened in accordance with Figure R603.3.3(2).  
Sheathing shall be installed in accordance with Item 1. Steel straps shall be installed in accordance with Item 2.

TABLE R603.3.2(30)

40-FOOT-WIDE BUILDING SUPPORTING TWO FLOORS, ROOF AND CEILING<sup>a,b,c</sup>

33 ksi STEEL

Figure ~~601.6(2)~~ R603.6(2)

BACK-TO-BACK HEADER

TABLE R603.6(23)

BACK-TO-BACK HEADER

Headers Supporting Two Floors, Roof and Ceiling (50 33 ksi steel)<sup>a,b</sup>

R604.3 Installation. Wood structural....in accordance with Table R602.3(1) or Table R602.3(3). Wood panels....

TABLE R607.1

MORTAR PROPORTIONS<sup>a,b</sup>

.....

Note c. Hydrated lime conforming to the requirements of ASTM C 270.


# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

**R608.2.2 Masonry laid in stack bond.** Where unit masonry is laid with less head joint offset that in Section R607.2.4 R608.2.1, the minimum area.....

**R613.5 Wall construction.** Exterior walls.....Framing shall be attached in accordance with Section Table R602.3(1) unless .....

**FIGURE R613.5(3)**  
**TRUSSED ROOF TO TOP PLATE CONNECTION**

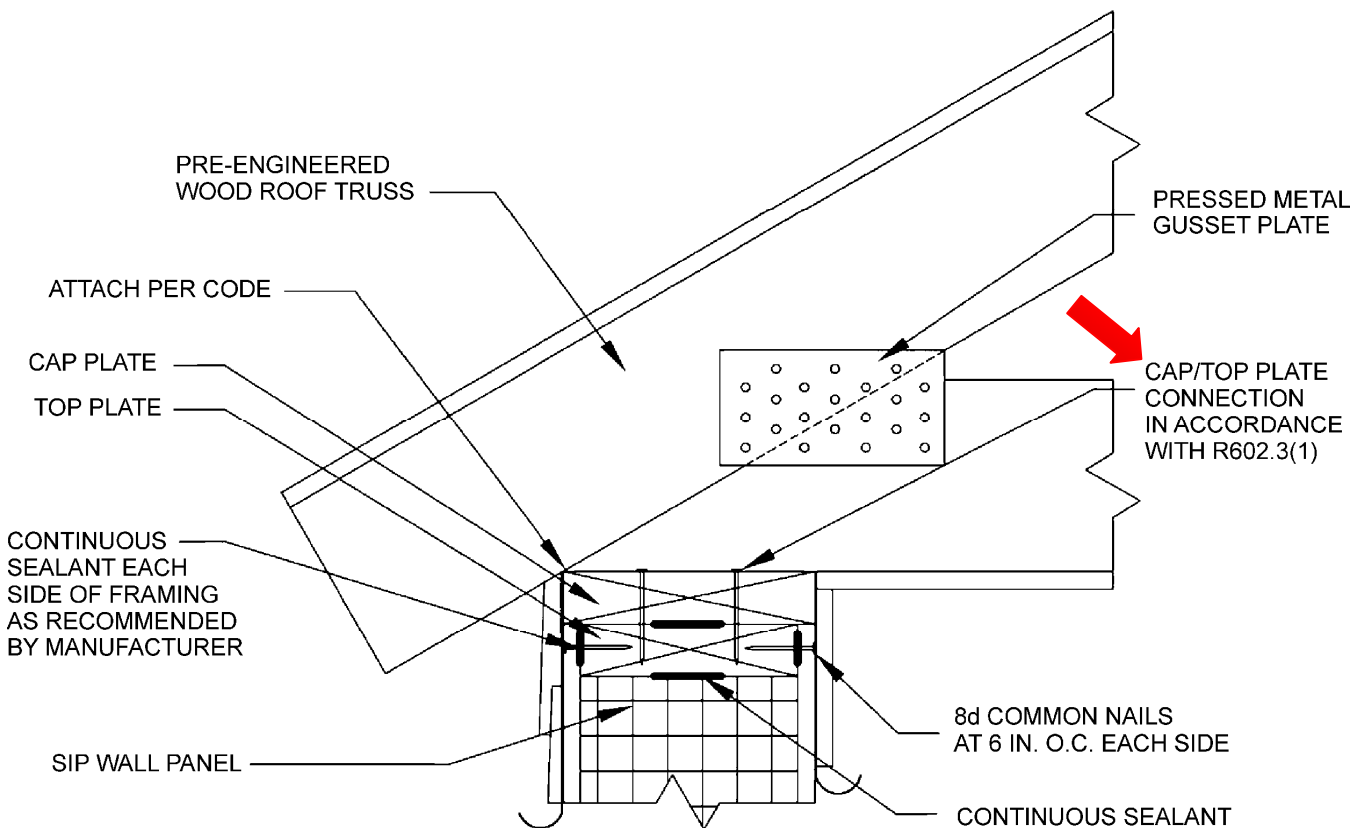

**TABLE R614.10 R613.10**  
**MAXIMUM SPANS FOR 11-7/8 DEEP SIP HEADERS (feet)**


# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> and 2<sup>nd</sup> PRINTING (SEPTEMBER 14, 2009)

## CHAPTER 6 WALL CONSTRUCTION

### FIGURER602.10.4.1.1 METHOD CS-PF: CONTINUOUS PORTAL FRAME PANEL CONSTRUCTION *REPLACE FIGURE IN ITS ENTIRETY WITH THE FOLLOWING:*

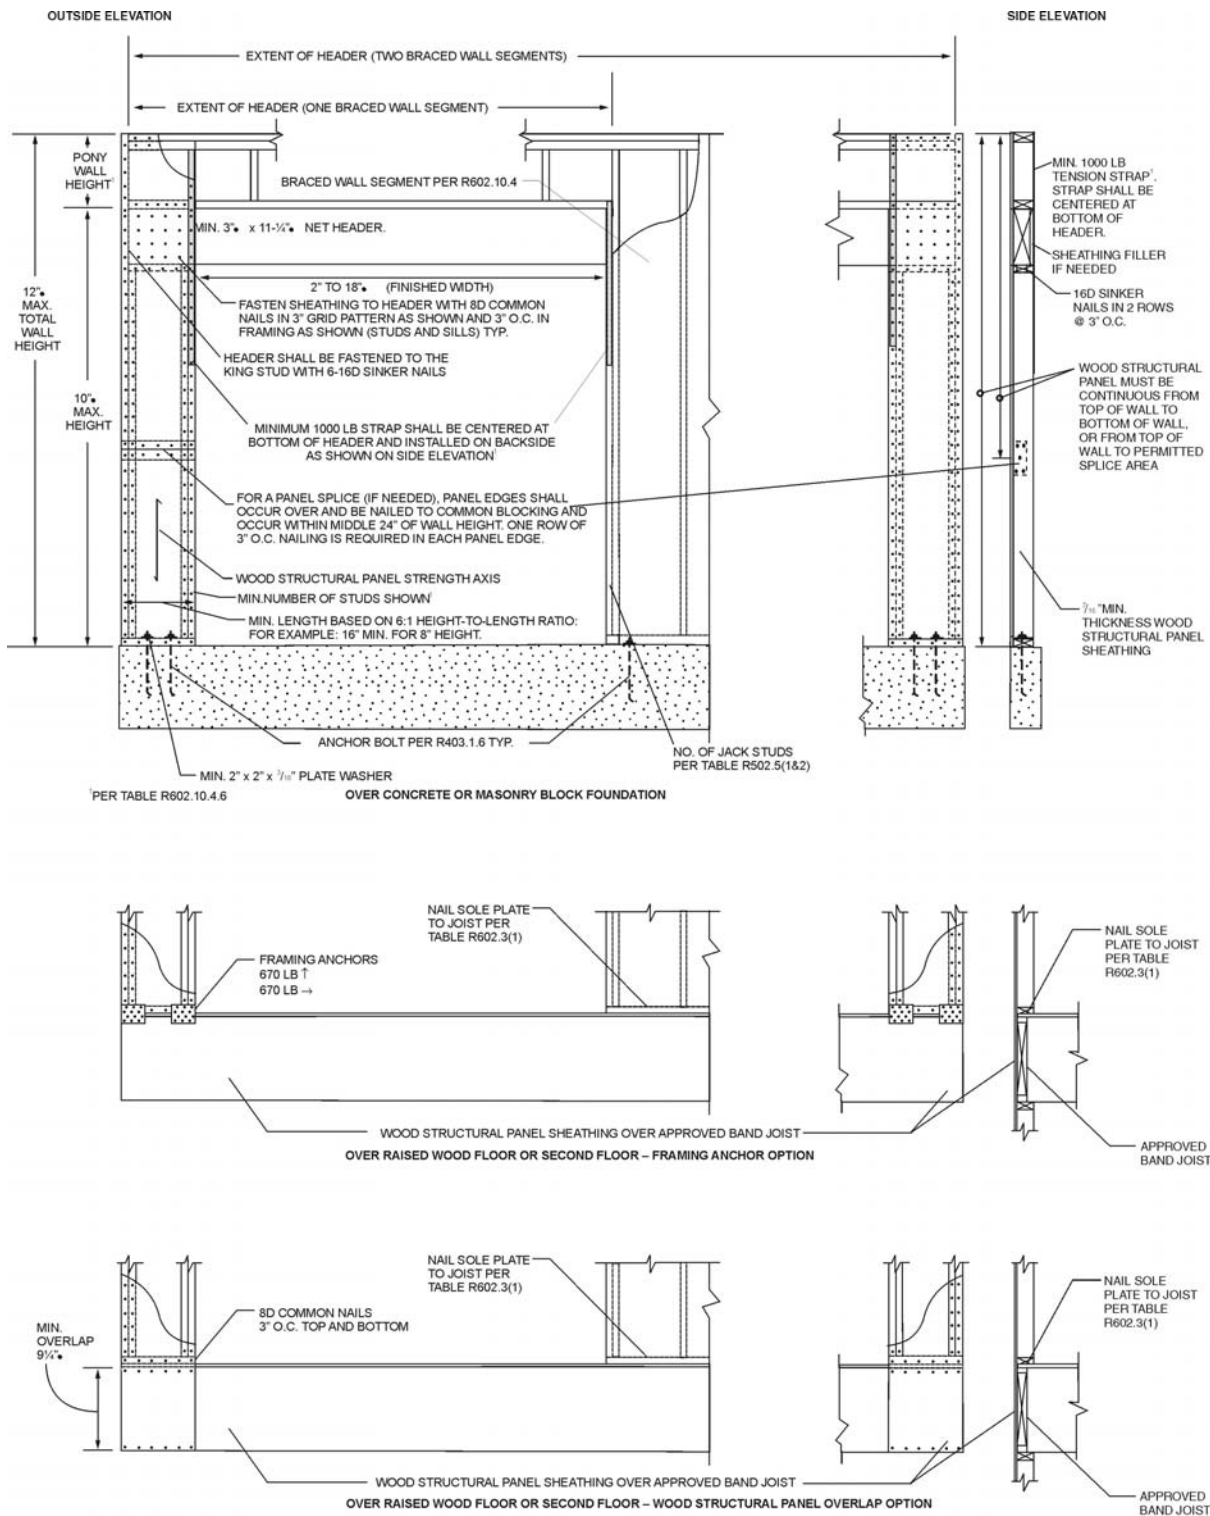

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

**R606.1 General.** Masonry construction shall be designed and constructed in accordance with the provisions of this section or in accordance with the provisions of ~~ACI 530/ASCE 5/TMS 402~~ TMS 402/ACI 530/ASCE 5.

**R606.1.1 Professional registration not required.** When the empirical design provisions of ~~ACI 530/ASCE 5/TMS 402~~ TMS 402/ACI 530/ASCE 5 Chapter 5 or the provisions of this section are used to design masonry, project drawings, typical details and specifications are not required to bear the seal of the architect or engineer responsible for design, unless otherwise required by the state law of the *jurisdiction* having authority.

**R606.12.1 General.** Masonry structures and masonry elements shall comply with the requirements of Sections R606.12.2 through R606.12.4 based on the seismic design category established in Table R301.2(1). Masonry structures and masonry elements shall comply with the requirements of Section R606.12 and Figures R606.11(1), R606.11(2) and R606.11(3) or shall be designed in accordance with ~~ACI 530/ASCE 5/TMS 402~~ TMS 402/ACI 530/ASCE 5.

**R606.12.2.3.1 Connections to masonry shear walls.** Connectors shall be provided to transfer forces between masonry walls and horizontal elements in accordance with the requirements of ~~Section 2.1.8 of ACI 530/ASCE 5/TMS 402~~ Section 1.7.4 of TMS 402/ACI 530/ASCE 5. Connectors shall be designed .....

**R606.12.2.3.2 Connections to masonry columns.** Connectors shall be provided to transfer forces between masonry columns and horizontal elements in accordance with the requirements of ~~Section 2.1.8 of ACI 530/ASCE 5/TMS 402~~ Section 1.7.4 of TMS 402/ACI 530/ASCE 5. Where anchor bolts are used to .....

**R606.12.3.1 Design requirements.** Masonry elements other than those covered by Section R606.12.2.2 shall be designed in accordance with the requirements of Chapter 1 and Sections 2.1 and 2.3 of ~~ACI 530/ASCE 5/TMS 402~~ TMS 402/ACI 530/ASCE 5 and shall meet the minimum ....

**TABLE ~~R614.10~~ R613.10**  
**MAXIMUM SPANS FOR 11-7/8 INCH DEEP SIP HEADERS (feet)**

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> PRINTING (SEPTEMBER 14, 2009)

## CHAPTER 6 WALL CONSTRUCTION

TABLE R602.10.1.5  
ADJUSTMENTS OF BRACING LENGTH FOR BRACED WALL LINES SPACING GREATER THAN 25 FEET<sup>a,b</sup>

TABLE R602.10.4.1.1  
TENSION STRAP CAPACITY REQUIRED FOR RESISTING WIND PRESSURES  
PERPENDICULAR TO 6:1 ASPECT RATIO WALLS<sup>a,b</sup>

MINIMUM WALL STUD FRAMING NOMINAL SIZE AND GRADE	MAXIMUM PONY WALL HEIGHT (feet)	MAXIMUM TOTAL WALL HEIGHT (feet)	MAXIMUM OPENING WIDTH (feet)	BASIC WIND SPEED (mph)					
				85	90	100	85	90	100
				Exposure B			Exposure C		
				Tension strap capacity required (lbf) <sup>a,b</sup>					
2x4 No. 2 Grade	4	12	9	1775	2350	<del>500-3500</del>	3550	DR	DR
			16	4175	DR	DR	DR	DR	DR

TABLE R602.12(2)  
STONE OR MASONRY VENEER WALL BRACING REQUIREMENTS,  
ONE- AND TWO-FAMILY DETACHED DWELLINGS, SEISMIC DESIGN CATEGORIES D<sub>0</sub>, D<sub>1</sub> and D<sub>2</sub>

SEISMIC DESIGN CATEGORY	NUMBER OF STORIES <sup>a</sup>	STORY	MINIMUM SHEATHING AMOUNT ( <del>length</del> <u>percent</u> of braced wall line length in <del>feet</del> <sup>b</sup>	MINIMUM SHEATHING THICKNESS AND FASTENING	SINGLE STORY HOLD DOWN FORCE (lb) <sup>c</sup>	CUMULATIVE HOLD DOWN FORCE (lb) <sup>d</sup>
-------------------------------	--------------------------------------	-------	---	---	--	--



# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> through 7<sup>th</sup> PRINTING (Posted: 09-26-13)

## CHAPTER 7 WALL COVERINGS

FIGURE 703.2.2

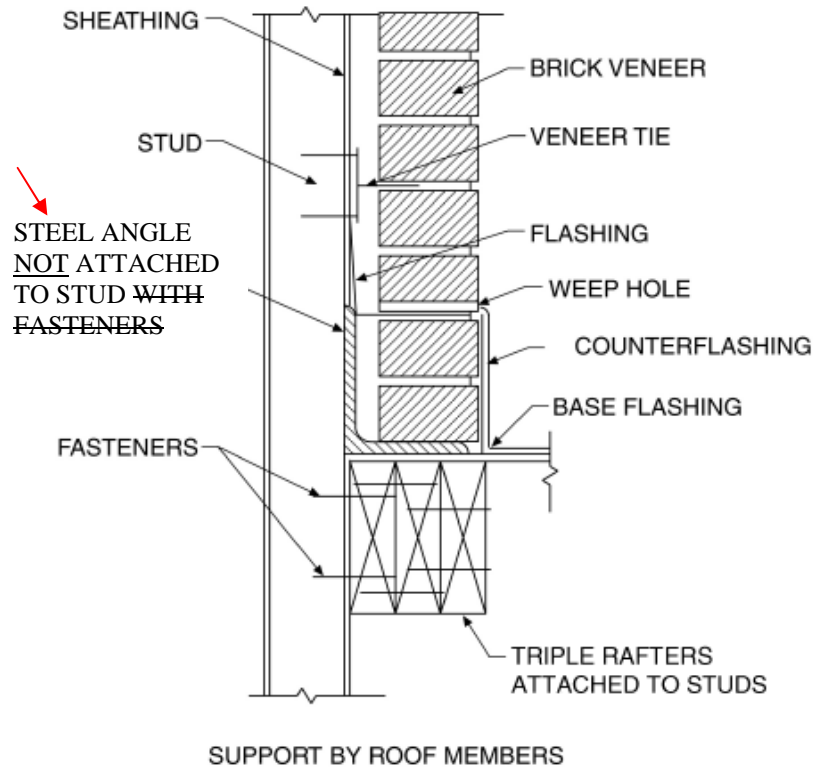


FIGURE R703.7.2.2  
EXTERIOR MASONRY VENEER SUPPORT BY ROOF MEMBERS

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> and 2<sup>nd</sup> PRINTING (JULY 14, 2011)

## CHAPTER 7 WALL COVERING

**TABLE R703.4**  
**WEATHER-RESISTANT SIDING ATTACHMENT AND MINIMUM THICKNESS**

SIDING MATERIAL	NOMINAL THICKNESS <sup>a</sup> (inches)	JOINT TREATMENT	WATER-RESISTIVE BARRIER REQUIRED	TYPE OF SUPPORTS FOR THE SIDING MATERIAL AND FASTENERS <sup>b,c,d</sup>					
				Wood or wood structural panel sheathing	Fiberboard sheathing into stud	Gypsum sheathing into stud	Foam plastic sheathing into stud	Direct to studs	Number or spacing of fasteners
Fiber cement panel siding <sup>g</sup>	5/16	Note q	Yes Note u	6d common corrosion-resistant nail <sup>f</sup>	6d common corrosion-resistant nail <sup>f</sup>	6d common corrosion-resistant nail <sup>f</sup>	6d common corrosion-resistant (12" x 0-0.143") nail <sup>f,v</sup>	4d common corrosion-resistant nail <sup>f</sup>	6" o.c. on edges, 12" o.c. on intermed. studs
Fiber cement lap siding <sup>s</sup>	5-16	Note s	Yes Note u	6d common corrosion-resistant nail <sup>f</sup>	6d common corrosion-resistant nail <sup>f</sup>	6d common corrosion-resistant nail <sup>f</sup>	6d common corrosion-resistant (12" x 0-0.143") nail <sup>f,v</sup>	6d common corrosion-resistant nail or 11 gage roofing nail <sup>f</sup>	Note t

**R703.11.2.2 Basic wind speed exceeding 90 miles per hour or Exposure Categories C and D.....**adjusted for height and exposure using ~~Section~~ Table R301.2(3). The design.....

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> and 2<sup>nd</sup> PRINTING (SEPTEMBER 14, 2009)

## CHAPTER 7 WALL COVERING

### TABLE R703.4 WEATHER-RESISTANT SIDING ATTACHMENT AND MINIMUM THICKNESS

..... Note w. Adhered masonry ..... Sections 6.1 and 6.3 of ~~ACI 530/ASCE 5/TMS 402~~ TMS 402/ACI 530/ASC 5.

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> through 7<sup>th</sup> PRINTING (Posted: June 27, 2013)

## CHAPTER 8 ROOF-CEILING CONSTRUCTION

TABLE R804.3.1.1(7)  
CEILING JOIST SPANS  
SINGLE SPANS WITHOUT BEARING STIFFENERS  
20 PSF LIVE LOAD (LIMITED ATTIC STORAGE)<sup>a, b</sup> 33 KSI STEEL

MEMBER DESIGNATIO N	ALLOWABLE SPAN (feet-inches)					
	Lateral Support of Top (Compression) Flange					
	Unbraced		Mid-span Bracing		Third-point Bracing	
	Ceiling Joist Spacing (inches)					
	16	24	16	24	16	24
350S162-33	8'-2"	6'-10"	9'-9"	6'-10"	9'-11"	6'-10"
350S162-43	8'-10"	7'-10"	11'-0"	9'-5"	11'-0"	9'-7"
350S162-54	9'-6"	8'-6"	11'-9"	10'-3"	11'-9"	10'-3"
350S162-68	10'-4"	9'-2"	12'-7"	11'-0"	12'-7"	11'-0"
350S162-97	12'-10"	10'-8"	13'-9"	12'-0"	13'-9"	12'-0"
550S162-33	9'-2"	8'-3"	12'-2"	8'-5"	12'-6"	8'-5"
550S162-43	10'-1"	9'-1"	13'-7"	11'-8"	14'-5"	12'-2"
550S162-54	10'-9"	9'-8"	14'-10"	12'-10"	15'-11"	13'-6"
550S162-68	11'-7"	10'-4"	16'-4"	14'-0"	17'-5"	14'-11"
550S162-97	13'-4"	11'-10"	18'-5"	16'-2"	20'-1"	17'-4"
800S162-33	—	—	—	—	—	—
800S162-43	11'-4"	10'-1"	16'-5"	13'-6"	18'-1"	13'-6"
800S162-54	12'-0"	10'-9"	17'-4"	15'-6"	19'-6"	27'-0"
800S162-68	12'-10"	11'-6"	18'-5"	16'-6"	20'-10"	18'-3"
800S162-97	14'-7"	12'-11"	20'-5"	18'-3"	22'-11"	20'-5"

Portions of table and footnotes not shown remain unchanged.

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1<sup>st</sup> through 3<sup>rd</sup> PRINTING (JULY 14, 2011)</b>
---

## Effective Use of the International Residential Code

**Chapter 8 Roof-ceiling Construction.** ....concealed spaces in roofs (e.g., enclosed attics and rafter spaces), unvented attic assemblies, and attic access. ~~and the proper clearance of combustible insulation from heat-producing devices.~~

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> and 2<sup>nd</sup> PRINTING (JULY 14, 2011)

## CHAPTER 8 ROOF-CEILING CONSTRUCTION

**R802.3.2 Ceiling joists overlapped.** Ends of ceiling joists.....in accordance with Table ~~R602.3(1)~~ R802.5.1(9) and butted joists.....

**TABLE R804.3**  
**ROOF FRAMING FASTENING SCHEDULE**<sup>a,b</sup>

DESCRIPTION OF BUILDING ELEMENTS	NUMBER AND SIZE OF FASTENERS	SPACING OF FASTENERS
Rafter to ceiling joist	Minimum No. 18 screws, per Table <del>R804.3.4</del> <u>R804.3.1(9)</u>	Evenly spaced, not less than 1/2" from all edges

**R804.3.3.4 Hip framing connections.** .....

2. Jack rafters.....hip member in accordance with Figure ~~R804.3.2.1.2~~ R804.3.2.4 and Table R804.3.2.4.

**R804.3.8.1 Ceiling diaphragm.** At gable endwalls.....with Section R803, in accordance with Table ~~R804.6(3)~~  
R804.3.8(3) to the bottom.....

**R806.2 Minimum area.** The total net.....may be reduced to 1/300 when a Class I or II vapor ~~barrier~~ retarder is installed.....

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1<sup>st</sup> PRINTING (SEPTEMBER 14, 2009)</b>
---

## **CHAPTER 9 ROOF ASSEMBLIES**

**R905.14.4 Foam plastics.** Foam plastic materials and installation shall comply with Section ~~R314~~ R316.

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> through 7<sup>th</sup> PRINTING (Posted: 12-13-12)

## CHAPTER 10 CHIMNEYS AND FIREPLACES

**R1002.5 Masonry heater clearance.** Combustible materials....with NFPA 211 Section ~~8-7~~ 12.6 (clearances....



# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1<sup>st</sup> PRINTING (JULY 14, 2011)</b>
--

## **CHAPTER 10 CHIMNEYS AND FIREPLACES**

**R1003.15.1 Option 1.** Round chimney....clay flue linings are shown in Tables ~~R1001.14(1)~~ R1003.14(1) and ~~R1001.14(2)~~ R1003.14 (2) or as provided....

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> through 4<sup>th</sup> PRINTING (SEPTEMBER 14, 2009)

## CHAPTER 11 ENERGY EFFICIENCY

**TABLE N1102.1**  
**INSULATION AND FENESTRATION REQUIREMENTS BY COMPONENT<sup>a</sup>**

CLIMATE ZONE	FENESTRATION U-FACTOR	SKYLIGHT <sup>b</sup> U-FACTOR	GLAZED FENESTRATION SHGC	CEILING R-VALUE	WOOD FRAME WALL R-VALUE	MASS WALL R-VALUE	FLOOR R-VALUE	BASEMENT <sup>c</sup> WALL R-VALUE	SLAB R-VALUE AND DEPTH	CRAWL SPACE <sup>c</sup> WALL R-VALUE
5 and Marine 4	0.35	0.60	NR	38	20 or 13 + 5 <sup>h</sup>	13/17	<del>30<sup>i</sup></del> 30 <sup>d</sup>	10/13	10, 2 ft	10/13

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> and 2<sup>nd</sup> PRINTING (JULY 14, 2011)

## CHAPTER 11 ENERGY EFFICIENCY

**N1102.2.2 Ceilings without attic spaces.** Where .....requirements of Section ~~402.1.4~~ N1102.1 shall be limited.....

**N1102.4.5 Recessed lighting.** Recessed.....when tested at 1.57 ~~psi~~ psf (75 Pa) pressure differential.....

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1<sup>st</sup> and 2<sup>nd</sup> PRINTING (SEPTEMBER 14, 2009)</b>
--

## **CHAPTER 13 GENERAL MECHANICAL SYSTEM REQUIREMENTS**

**M1308.1 Drilling and notching.** Wood-framed ..... altered in accordance with the provisions of Section ~~R612.9~~ R613.7.

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> through 4<sup>th</sup> PRINTING (SEPTEMBER 14, 2009)

## CHAPTER 16 DUCT SYSTEMS

**TABLE M1601.1(2)**  
**GAGES OF METAL DUCTS AND PLENUMS USED FOR HEATING OR COOLING**

DUCT SIZE	MINIMUM THICKNESS Inches and (mm)	EQUIVALENT GALVANIZED SHEET NO.	MINIMUM THICKNESS (in.)
Exposed rectangular ducts			
14 inches or <u>less</u>	0.0157	28	0.0157
Over 14 <sup>a</sup> inches	0.0187	26	0.018

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> PRINTING (SEPTEMBER 14, 2009)

## CHAPTER 16 DUCT SYSTEMS

TABLE M1601.1.1(1)  
CLASSIFICATION OF FACTORY-MADE AIR DUCTS

DUCT CLASS	MAXIMUM FLAME-SPREAD RATING <u>INDEX</u>
------------	--

TABLE M1601.1.1(2)  
GAGES OF METAL DUCTS AND PLENUMS USED FOR HEATING OR COOLING

DUCT SIZE	GALVANIZED		ALUMINUM
	MINIMUM THICKNESS inches and (mm)	EQUIVALENT GALVANIZED SHEET NO.	MINIMUM THICKNESS (in.)
Round ducts and enclosed rectangular ducts 14 inches or less 16 and 18 inches 20 inches and over	0.0157 ( <del>0.3950 mm</del> )	28	0.0175
	0.0187 ( <del>0.4712 mm</del> )	26	0.018
	0.0236 ( <del>0.6010 mm</del> )	24	0.023
Exposed rectangular ducts 14 inches or <u>less</u> Over 14 <sup>a</sup> inches	0.0157 ( <del>0.3950 mm</del> )	28	0.0175
	0.0187 ( <del>0.4712 mm</del> )	26	0.018

**M1601.5.2 Materials.** The under-floor space, including the sidewall insulation, shall be formed by materials having flame-spread ~~ratings~~ index values not greater than 200 when tested in accordance with ASTM E 84.

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> and 2<sup>nd</sup> PRINTING (SEPTEMBER 14, 2009)

## CHAPTER 21 HYDRONIC PIPING

**M2101.6 Drilling and notching.** Wood-framed ..... altered in accordance with the provisions of Section ~~R614~~ R613.

### TABLE M2101.1 HYDRONIC PIPING MATERIALS

Note b. Standards as listed in Chapter ~~43~~ 44.

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

1 <sup>st</sup> PRINTING (SEPTEMBER 14, 2009)
---

## CHAPTER 21 HYDRONIC PIPING

**M2103.2 Thermal barrier required.** Radiant floor heating systems shall have a thermal barrier in accordance with Sections M2103.2.1 through M2103.2.4.

**Exception:** Insulation shall not be required in engineered systems where it can be demonstrated that the insulation will decrease the efficiency or have a negative effect on the installation.

**M2103.2.4 Thermal barrier material marking.** Insulation materials used in thermal barriers shall be installed so that the manufacturer's *R*-value mark is readily observable upon inspection.

**Exception:** ~~Insulation shall not be required in engineered systems where it can be demonstrated that the insulation will decrease the efficiency or have a negative effect on the installation.~~



# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1<sup>st</sup> and 2<sup>nd</sup> PRINTING (JULY 14, 2011)</b>
---

## **CHAPTER 23 SOLAR SYSTEMS**

**M2301.5 Backflow protection.** .....shall comply with Section ~~P2902.4.5~~ P2902.5.5

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1<sup>st</sup> and 2<sup>nd</sup> PRINTING (SEPTEMBER 14, 2009)</b>
--

## **CHAPTER 24 FUEL GAS**

**G2439.5.6 (~~614.6.5~~ 614.6.6)** Length identification. Where the exhaust duct is .....

**G2439.5.7 (~~614.6.6~~ 614.6.7)** Exhaust duct required. Where space for a *clothes dryer*....

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

1 <sup>st</sup> PRINTING (SEPTEMBER 14, 2009)
---

## CHAPTER 24 FUEL GAS

**G2439.5 (614.6) Domestic clothes dryer exhaust ducts.** Exhaust ducts for domestic *clothes dryers* shall conform to the requirements of Sections ~~G2429.5.1~~ G2439.5.1 through ~~G2429.5.7~~ G2439.5.7.

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

1 <sup>st</sup> and 2 <sup>nd</sup> PRINTING (SEPTEMBER 7, 2010)
--

## CHAPTER 27 PLUMBING FIXTURES

**P2705.1 General.** The installation.....

Item 6. The location of.... ~~....equipment~~ equipment ~~shall not interfere with the operation of windows and doors.~~  
shall not interfere with the operation of windows and doors.

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1<sup>st</sup> through 4<sup>th</sup> PRINTING (Posted: August 11, 2011)</b>
---

## **CHAPTER 28 WATER HEATERS**

**P2803.6.1 #13**.....materials listed in Section ~~P2904.5~~ P2905.5 or materials....

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1<sup>st</sup> and 2<sup>nd</sup> PRINTING (SEPTEMBER 7, 2010)</b>
---

## **CHAPTER 28 WATER HEATERS**

**P2801.1 Required.** Each dwelling .....culinary purposes. ~~Storage tanks~~ Storage tanks.....

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> and 2<sup>nd</sup> PRINTING (SEPTEMBER 7, 2010)

## CHAPTER 29 WATER SUPPLY AND DISTRIBUTION

**P2902.3.3 Backflow preventer with intermediate atmospheric vent.** Backflow preventers.... ASSE 1012 or CSA CAN/CSA B64.3.....

**P2902.5.5 Solar systems.** The potable water.....

**Exception:** Where all solar.....protection measures shall not be required.

### TABLE P2903.1

#### REQUIRED CAPACITIES AT THE POINT OF DISCHARGE

Shower, temperature controlled	3	20
--------------------------------	---	----

**P2904.1 General.** Where installed, residential.....A backflow ~~flow~~ preventer shall not be required to separate.....

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1<sup>st</sup> PRINTING (SEPTEMBER 14, 2009)</b>
---

## **CHAPTER 34 GENERAL REQUIREMENTS**

**E3404.6 Unused openings.** Unused openings, other than those intended for the operation of equipment, ~~those intended for the operation of equipment,~~ those intended for mounting purposes, and those .....



# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1<sup>st</sup> PRINTING (SEPTEMBER 14, 2009)</b>
---

## **CHAPTER 35 ELECTRICAL DEFINITIONS**

**KITCHEN.** An area with a sink and permanent facilities for food preparation ~~and~~ cooking.

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1<sup>st</sup> and 2<sup>nd</sup> PRINTING (SEPTEMBER 14, 2009)</b>
--

## CHAPTER 36 SERVICES

**E3610.2 Securing and protection against physical damage.** Where exposed, a grounding electrode.....or protection where it is ~~and~~ securely fastened .....

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1<sup>st</sup> and 2<sup>nd</sup> PRINTING (SEPTEMBER 14, 2009)</b>
--

## **CHAPTER 37 BRANCH CIRCUIT AND FEEDER REQUIREMENTS**

**E3702.1 Branch-circuit voltage limitations.** The voltage ratings of branch circuits that supply luminaires or receptacles for cord-and-plug-connected loads of up to ~~1,400~~ 1,440 volt-amperes or of less than 1/4 horsepower .....

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

<b>1<sup>st</sup> through 10<sup>th</sup> PRINTING (04-15-2014)</b>
---

## **CHAPTER 39 POWER AND LIGHTING DISTRIBUTION**

**Section E3908.12 Equipment grounding conductor size.** Copper...Where ungrounded ~~connectors~~ conductors are increased in size....


# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> and 2<sup>nd</sup> PRINTING (SEPTEMBER 14, 2009)

## CHAPTER 39 POWER AND LIGHTING DISTRIBUTION

FIGURE E3901.4

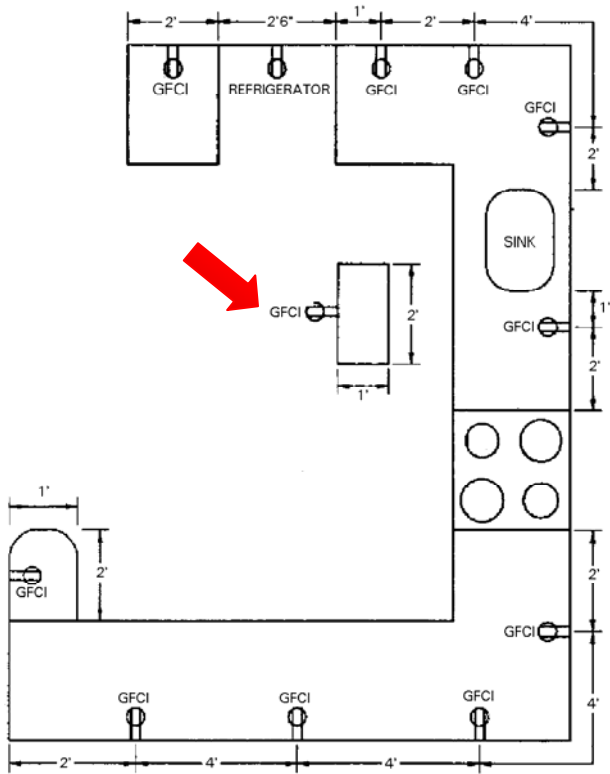

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1<sup>st</sup> through 5<sup>th</sup> PRINTING (February 28, 2012)</b>
---

## **CHAPTER 44 REFERENCED STANDARDS**

AAMA/WDMA/CSA 101/I.S.2/A440-08 North American Fenestration Standards/Specifications-for...

AISI S230-07 Standard for Cold-formed Steel Framing-prescriptive Method for One-and Two-family dwellings with  
supplement 2 dated 2008.

ICC 400-~~06~~ -07 Standard on the Design and Construction of Storm Shelters

TMS 402-05 Building Code requirements for Masonry Structures.....~~R606.11.2.2.2~~

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1<sup>st</sup> and 2<sup>nd</sup> PRINTING ( 10-06-2011 )</b>
--

## **CHAPTER 44 REFERENCED STANDARDS**

### **AFPA**

WFCM-~~08-01~~ Wood Frame Construction Manual for One- and Two- Family Dwellings

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1st through 4th PRINTING (JULY 14, 2011)

## CHAPTER 44 REFERENCED STANDARDS

### ICC

ICC 400-~~06~~ 07 Standard on the Design and Construction of Log Structures.....



# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> and 2<sup>nd</sup> PRINTING (JULY 14, 2011)

## CHAPTER 44 REFERENCED STANDARDS

### ASTM

C1396/C1396M—06a Specification for Gypsum Board.....Table R602.3(1), R702.3.1, R703.3.8, ~~R703.3.8~~ R702.3.8

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> and 2<sup>nd</sup> PRINTING (SEPTEMBER 14, 2009)

## CHAPTER 44 REFERENCED STANDARDS

### TMS

402-05 -08 Building Code Requirements for Masonry Structures.....

602-05 -08 Specifications for Masonry Structures.....~~R606.12.2.2.1~~ R606.12.2.3.1 ~~R606.12.2.2.2~~  
R606.12.2.3.2

### TPI

TPI 1 - ~~2002~~ 2007 National Design Standard for Metal-plate-connected Wood Truss Construction.....

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> and 2<sup>nd</sup> PRINTING (SEPTEMBER 14, 2009)

## APPENDIX F RADON CONTROL METHODS

**AF103.11 Building depressurization.** Joints in air ducts ..... conservation provisions in Chapter 11. Firestopping  
Fireblocking shall meet the requirements contained in Section ~~R602.8~~ R302.11.

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

---

<b>1<sup>st</sup> through 4<sup>th</sup> PRINTING (July 25, 2011)</b>
---

## **APPENDIX H PATIO COVER**

**AH105.1 General**....shall be provided with exits conforming to the provisions of Section ~~R310~~ R311 of this code.

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> through 6<sup>th</sup> PRINTING (07-11-12)

## APPENDIX P SIZING OF WATER PIPING SYSTEM

**AP101.1.1** This appendix outlines.....source, the head ~~charges~~ changes in the system....

**AP103.2.2** Water pipe sizing....

1. Pressure required...and Section 604.5 3 of the *International*....

**AP103.3** Segmented loss method.

3. **Selection of pipe size.**

3.1 Pressure required.....and Section 604.5 3 of the *International*....

**FIGURE AP103.3(7) FRICTION LOSS IN FAIRLY ROUGH PIPE<sup>a</sup>**

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> and 2<sup>nd</sup> PRINTING (SEPTEMBER 7, 2010)

## APPENDIX P SIZING OF WATER PIPING SYSTEM

**TABLE AP201.1**  
**MINIMUM SIZE OF WATER METERS, MAINS AND DISTRIBUTION PIPING BASED ON WATER SUPPLY FIXTURE**  
**UNIT VALUES (w.s.f.u)**

METER AND SERVICE PIPE (inches)	DISTRIBUTION PIPE (inches)	MAXIMUM DEVELOPMENT LENGTH (feet)									
		40	60	80	100	150	200	250	300	400	500
Pressure Range 50 to 60 psi		40	60	80	100	150	200	250	300	400	500
2	2 ½	533	533	533	533	533	533	533	533	<del>353</del> 533	486

# 2009 International Residential Code Errata

(Portions of text and tables not shown are unaffected by the errata)

1<sup>st</sup> through 5<sup>th</sup> PRINTING (February 28, 2012)

## INDEX

### DOORS

~~Exit Egress.....R311.4.1~~ R311.2